

- 2. SANITARY SEWER CLEAN—OUTS, WATER METERS, MANHOLES, AND VALVE LIDS TO BE LOCATED OUTSIDE SIDEWALK WHERE FEASIBLE.
- 3. MINIMUM SIDEWALK WIDTH TO BE 6' MINIMUM IF PLACED AT BACK OF CURB.
- 4. CONCRETE FOR ALL SIDEWALKS (EXCEPT ANY PORTION CONTAIN WITHIN A DRIVEWAY APRON) SHALL BE CLASS "A" - 3,000 PSI.
- 5. MINIMUM REPLACEMENT FOR REPAIRS IS A 5' X 5' PANEL
- 6. 4" STONE BASE MAY BE REQUIRED FOR POOR SOIL CONDITIONS
- 7. MINIMUM DEPTH FOR TUNNELING BELOW SIDEWALK IS 12" 8. MAX ADJACENT GROUND SLOPE WITHOUT RAILING IS 2:1
- 9. MIN GRADE FOR PROPER DRAINAGE IS 1% IN AT LEAST 1 DIRECTION. MAX CROSS SLOPE IS 2%. MAX LONGITUDINAL SLOPE IS 8.3%, 10% IF LIMITED BY EXISTING CONDITIONS, OR NO GREATER THAN THE SLOPE OF THE EXISTING ADJACENT ROAD.


STANDARD SIDEWALK DETAIL

SD 3-10

NTS

APPROVED CITY OF WILMINGTON DATE . _ PERMIT # _








COMMERCIAL / RESIDENTIAL P.O. Box 4041 Wilmington, NC 28406 (910) 791–4441


OFFICE



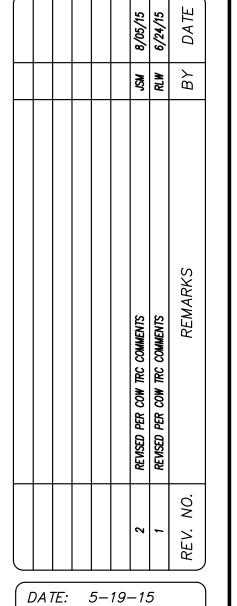

HORZ. SCALE: 1" = 60' VERT. SCALE: N/A DRAWN BY: RLW CHECKED BY: HSR

PROJECT NO.: 14-330

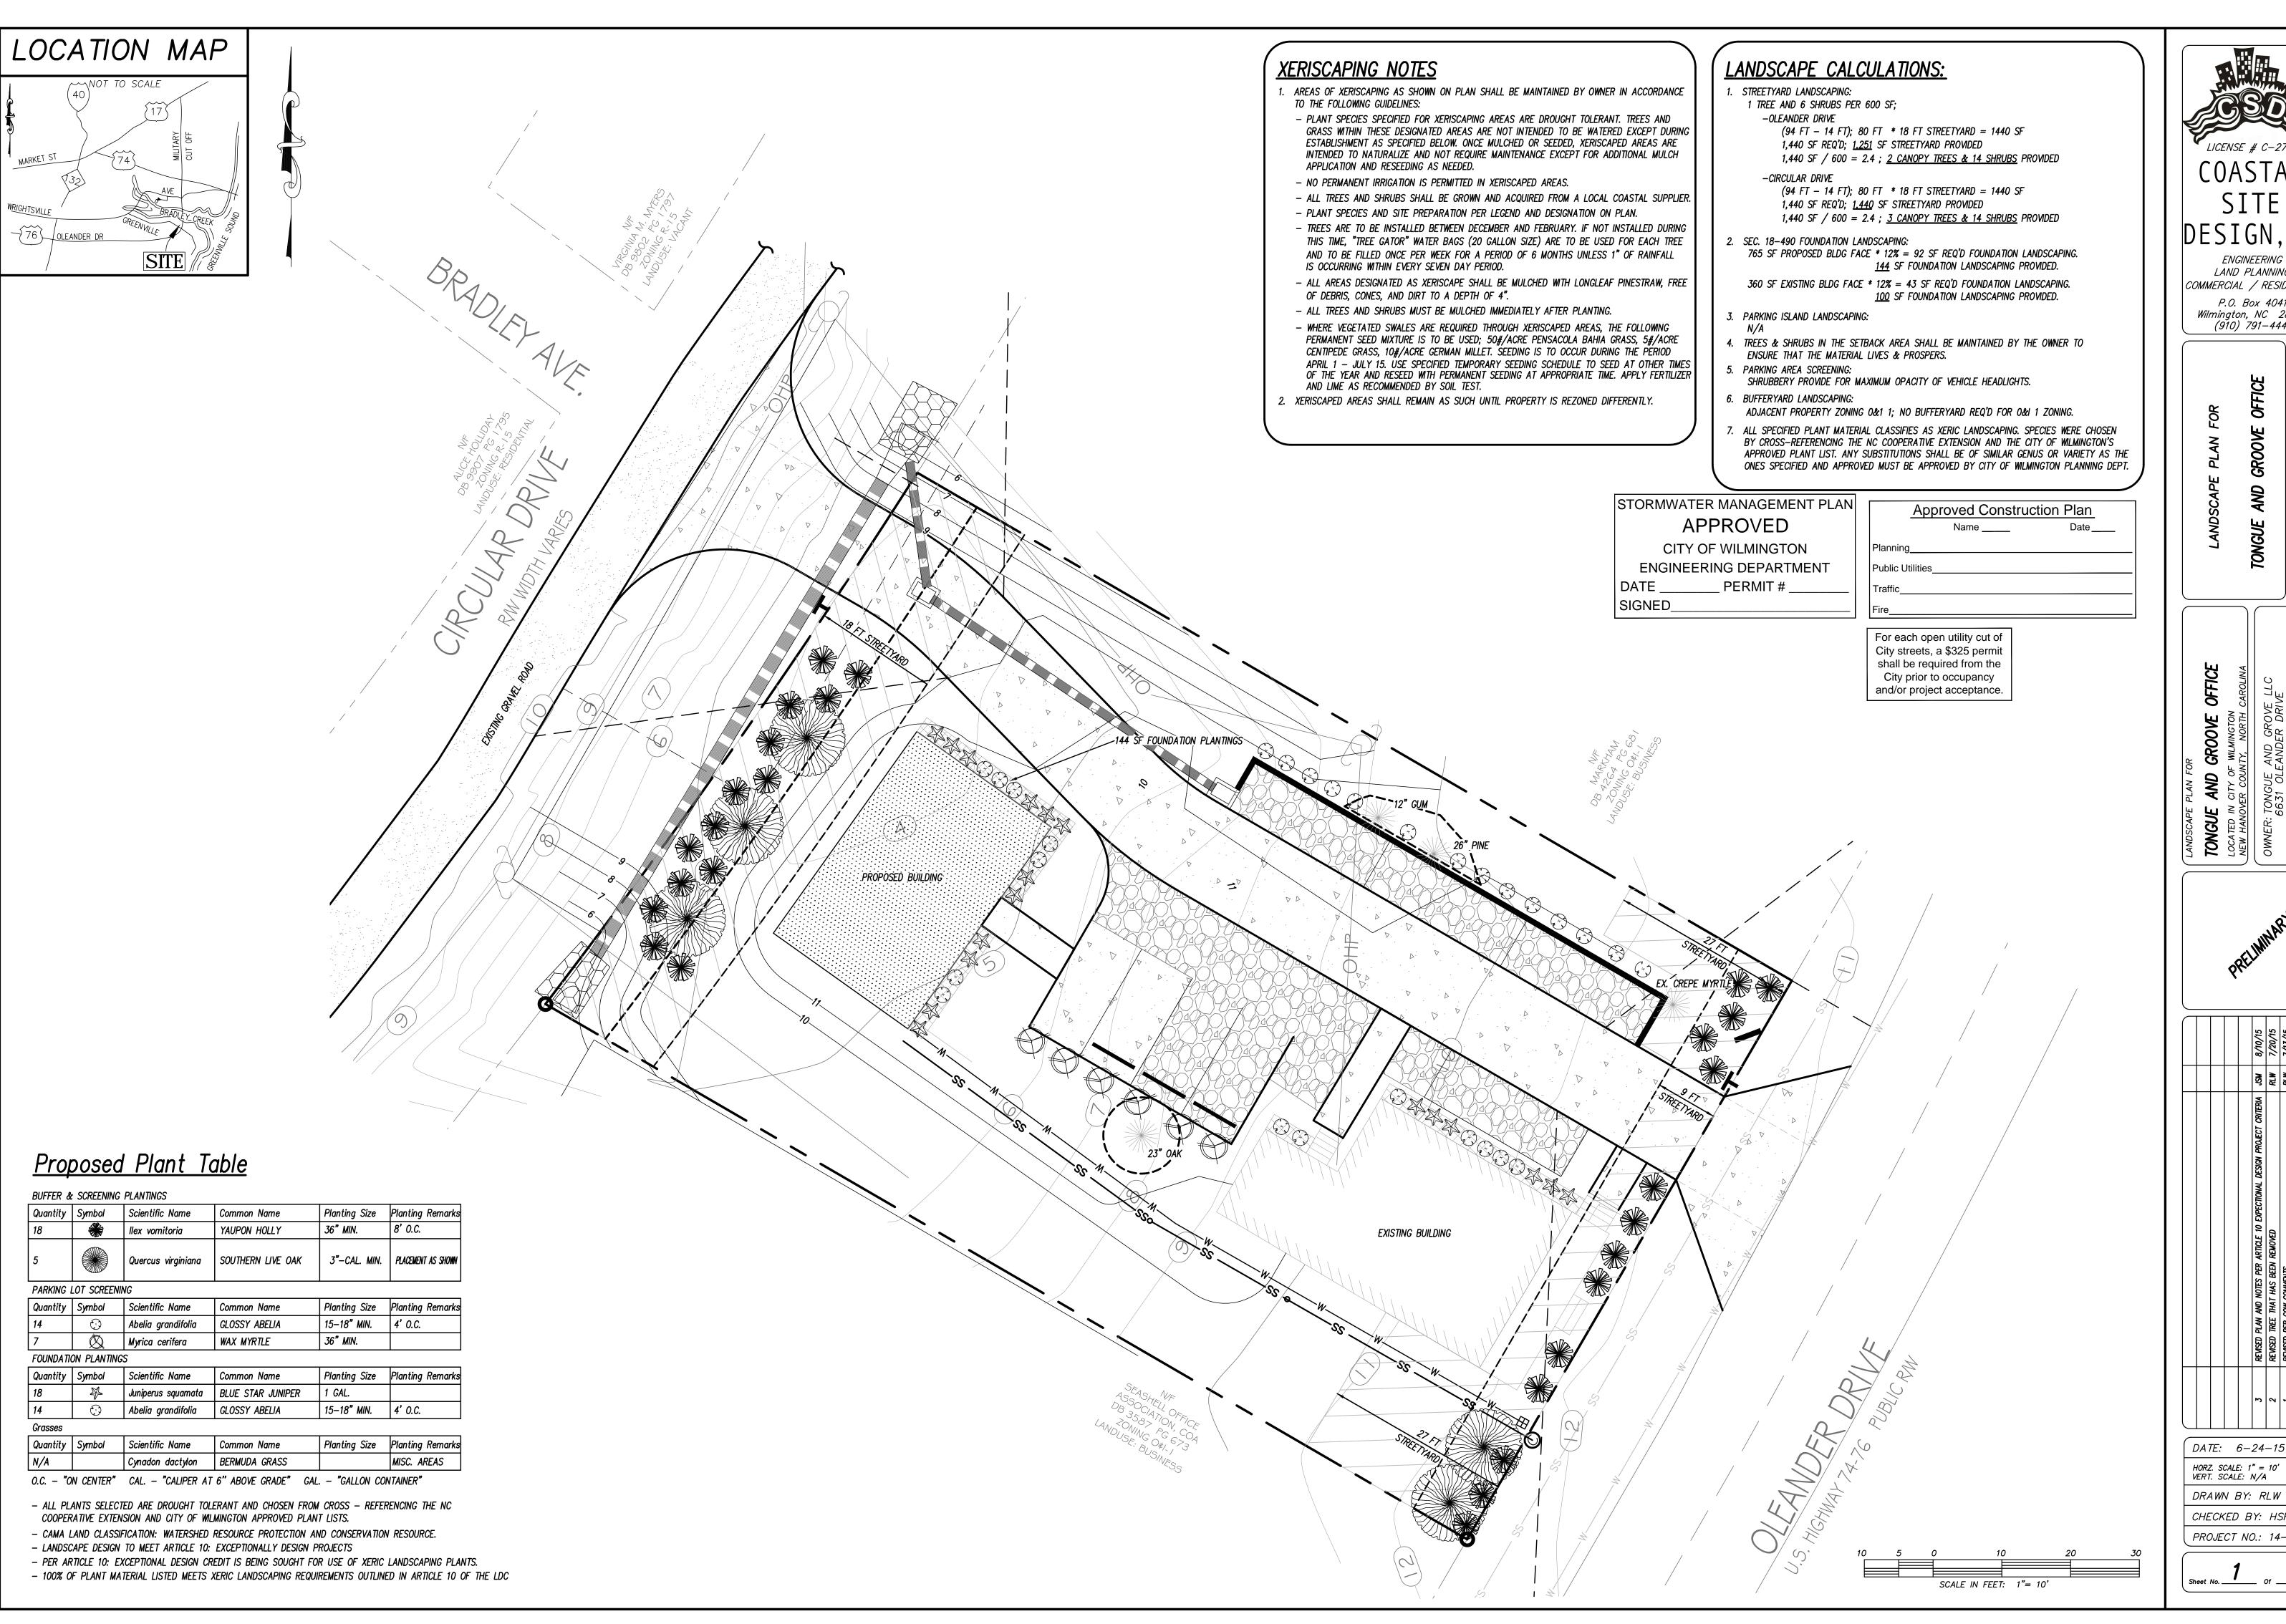

SITE

LAND PLANNING COMMERCIAL / RESIDENTIAL

P.O. Box 4041 Wilmington, NC 28406 (910) 791-4441

DATE: 6-24-15

DRAWN BY: RLW CHECKED BY: HSR

PROJECT NO.: 14-330