


# THE WILMINGTON FOOD BANK

GREENFIELD STREET  
WILMINGTON, NORTH CAROLINA

## CONSTRUCTION DOCUMENTS

OCTOBER 2021  
FEBRUARY 2021

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.
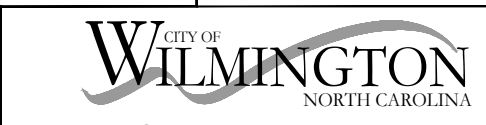
<b>Approved Construction Plan</b>	
Name _____	Date _____
Planning _____	
Traffic _____	
Fire _____	
 Public Services • Engineering Division APPROVED STORMWATER MANAGEMENT PLAN	
Date: _____	Permit # _____
Signed: _____	

**NOTICE REQUIRED**

ALL EXISTING UNDERGROUND UTILITIES SHALL BE PHYSICALLY LOCATED PRIOR TO THE BEGINNING OF ANY CONSTRUCTION IN THE VICINITY OF SAID UTILITIES.

CONTRACTORS SHALL NOTIFY OPERATORS WHO MAINTAIN UNDERGROUND UTILITY LINES IN THE AREA OF PROPOSED EXCAVATION AT LEAST TWO WORKING DAYS, BUT NOT MORE THAN TEN WORKING DAYS PRIOR TO COMMENCEMENT OF EXCAVATION OR DEMOLITION.

CONTRACTORS SHALL CONTACT OVERHEAD ELECTRIC PROVIDER TO COMPLY WITH FEDERAL OSHA 1910.333 MINIMUM APPROACH DISTANCE TO ENERGIZED POWERLINES AND OSH 29 CFR 1926.1407-1411 MUST BE FOLLOWED.

CONTRACTOR SHALL CONTACT AT&T PRIOR TO ANY DEMOLITION TO ALLOW FOR AT&T TO DISCONNECT COMMUNICATIONS CABLES COMING INTO THE SITE.

**CONTACT THESE UTILITIES**

**CITY OF WILMINGTON PLANNING & DEVELOPMENT**

ATTN: JEFF WALTON, PLANNER  
PH: 910-341-3247

ATTN: ZONING INSPECTIONS  
PH: 910-254-0900

**PIEDMONT NATURAL GAS**

ATTN: CATHY PLEASANT  
PH: 910-251-2827

**EMERGENCY DIAL 911**

**POLICE - FIRE - RESCUE**  
ATTN: CITY OF WILMINGTON FIRE & LIFE SAFETY  
PH: 910-343-0696

**CAPE FEAR PUBLIC UTILITY AUTHORITY (WATER & SEWER)**

ENGINEERING/INSPECTIONS  
PH: 910-332-6560

OPERATIONS/MAINTENANCE  
PH: 910-322-6550


**DUKE ENERGY**  
DISTRIBUTION CONSTRUCTION SERVICE  
DEP CSC PH: 1-800-452-2777

TRANSMISSION AGENT  
BILL WILDER  
PH: 910-772-4903

**AT&T**  
ATTN: STEVE DAYVAULT (BUILDING ENGINEERING)  
PH: 910-341-0741

ATTN: JAMES BATSON, ENGINEERING  
PH: 910-341-1621

**SPECTRUM**  
GENERAL PH: 800-892-4357

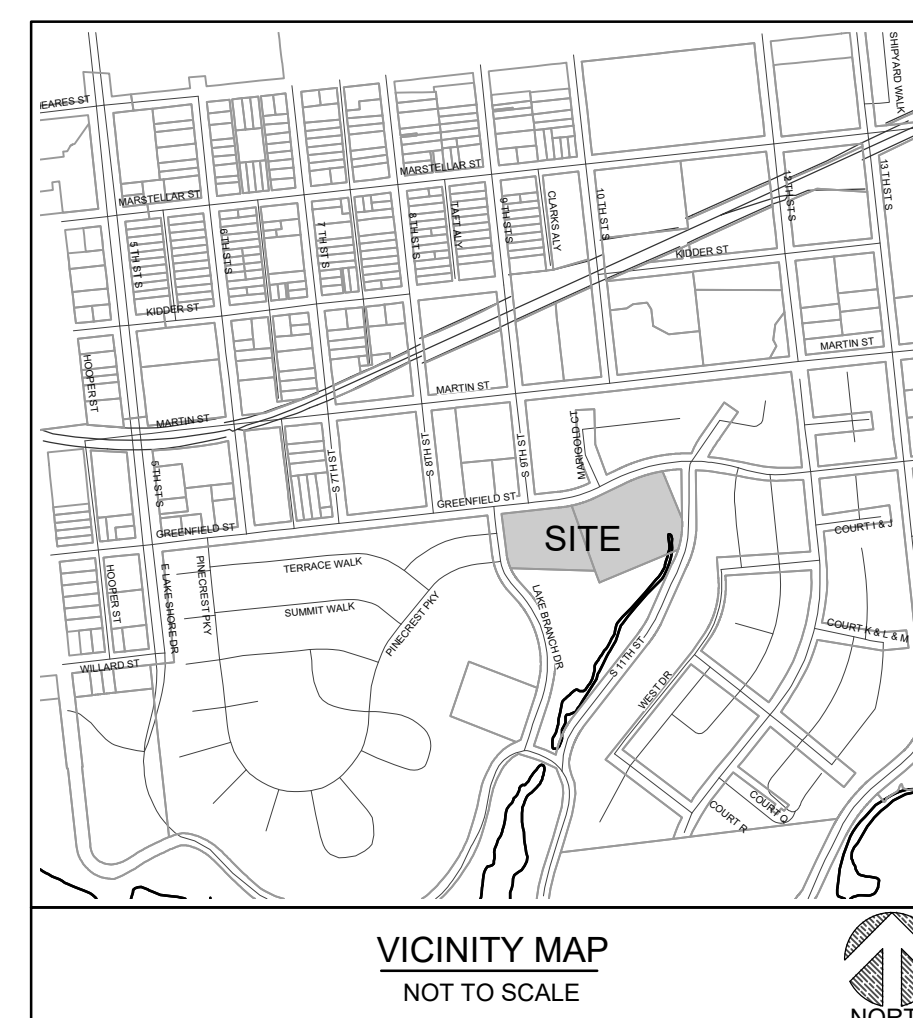

Professional Seal  
redacted on  
electronic copy  
per City of  
Wilmington Policy

**OWNER:**  
FOOD BANK OF CENTRAL & EASTERN NORTH CAROLINA  
1924 CAPITAL BLVD.  
RALEIGH, NC 27604

**ENGINEER (CIVIL):**  
PARAMOUNTE ENGINEERING, INC.  
122 CINEMA DRIVE  
WILMINGTON, NORTH CAROLINA 28403  
ATTN: JERRY BURKS, P.E. (910) 791-6707

**SHEET INDEX**

SHEET NUMBER	SHEET TITLE
C-0.0	COVER SHEET
C-1.0-1.1	GENERAL NOTES
EX-1	EXISTING CONDITIONS PLAN
C-2.0	SITE PLAN
C-2.1	TURNING MOVEMENT EXHIBIT
C-3.0	EROSION CONTROL PLAN
C-4.0	GRADING AND DRAINAGE PLANS
C-5.0	UTILITY PLAN
C-6.0-6.4	SITE & STORM DETAILS
DA-1-2-3	DRAINAGE AREA MAPS
L-2.0	LANDSCAPE PLAN

PREPARED BY:

**PARAMOUNTE**  
ENGINEERING, INC.

122 Cinema Drive  
Wilmington, North Carolina 28403  
(910) 791-6707 (O) (910) 791-6760 (F)  
NC License #: C-2846  
PROJECT # 20484 PE



**COORDINATION NOTES:**

- 1. THE CONTRACTOR IS REQUIRED TO OBTAIN ANY/ALL PERMITS REQUIRED FOR CONSTRUCTION OF THESE PLANS.
2. ALL CONSTRUCTION TO BE IN ACCORDANCE WITH PERMITS ISSUED AND WITH THE CITY OF WILMINGTON, NEW HANOVER COUNTY, CAPE FEAR PUBLIC UTILITY AUTHORITY (CPFA), AND THE STATE OF NORTH CAROLINA.
3. THE CONTRACTOR IS TO ESTABLISH AND CHECK ALL HORIZONTAL AND VERTICAL CONTROLS TO BE USED WITH THE PROJECT. IN ADDITION, THE CONTRACTOR IS TO COMPUTE THE LAYOUT OF THE ENTIRE SITE PLAN IN ADVANCE OF BEGINNING ANY WORK ASSOCIATED WITH THE SUBJECT PLANS. CONTRACTOR SHALL EMPLOY A PROFESSIONAL SURVEYOR TO PERFORM SITE IMPROVEMENT STAKEOUT(S).
4. ANY/TIME WORK IS PERFORMED OFF-SITE OR WITHIN AN EXISTING EASEMENT, THE CONTRACTOR IS TO NOTIFY THE HOLDER OF SAID EASEMENT AS TO THE NATURE OF PROPOSED WORK, AND TO FOLLOW ANY GUIDELINES OR STANDARDS WHICH ARE ASSOCIATED WITH OR REFERENCED IN THE RECORDED EASEMENT.
5. CONTRACTOR SHALL REFER TO ARCHITECTURAL DRAWINGS BY OTHERS FOR ALL BUILDING DIMENSIONS AND DETAILS.

**GENERAL NOTES:**

- 1. TREE INVENTORY AND TOPOGRAPHIC SURVEY COMPLETED BY PARAMOUNT ENGINEERING, INC. THE SURVEY SHALL BE FIELD VERIFIED BY CONTRACTOR AND ANY DISCREPANCIES REPORTED TO THE OWNER AND ENGINEER.
2. REASONABLE CARE HAS BEEN EXERCISED IN SHOWING THE LOCATION OF EXISTING UTILITIES ON THE PLANS. THE EXACT LOCATION OF ALL EXISTING UTILITIES IS NOT KNOWN IN ALL CASES. THE CONTRACTOR SHALL EXPLORE THE AREA AHEAD OF DITCHING OPERATIONS BY OBSERVATIONS, ELECTRONIC DEVICES, HAND DIGGING AND BY PERSONAL CONTACT WITH THE UTILITY COMPANIES IN ORDER TO LOCATE EXISTING UTILITIES IN ADVANCE OF TRENCHING OPERATIONS SO AS TO ELIMINATE OR MINIMIZE DAMAGE TO EXISTING UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL COSTS RESULTING FROM ANY DAMAGE TO THE EXISTING UTILITY LINES INCLUDING LOSS OF UTILITY REVENUES. CONTRACTOR SHALL ARRANGE FOR TEMPORARY SUPPORT OF EXISTING UTILITIES, SUCH AS POLES, CONDUITS, FIBER OPTIC CABLES, TELEPHONE CABLES, WATER LINES, ETC.
3. CONTRACTOR SHALL COMPLY WITH THE LATEST REVISIONS AND INTERPRETATIONS OF THE DEPARTMENT OF LABOR SAFETY AND HEALTH REGULATIONS FOR CONSTRUCTION PROMULGATED UNDER THE OCCUPATIONAL SAFETY AND HEALTH ACT.
4. CONTRACTOR SHALL PLAN AND CONSTRUCT WORK SO AS TO CAUSE MINIMUM INCONVENIENCE TO THE OWNER AND THE PUBLIC. THE CONTRACTOR SHALL PROVIDE, ERECT AND MAINTAIN AT ALL TIMES DURING THE PROGRESS OR TEMPORARY SUSPENSION OF WORK, SUITABLE BARRIERS, FENCES, SIGNS OR FLAGMEN AND WATCHMEN AS NECESSARY TO INSURE THE SAFETY OF THE PUBLIC AS WELL AS THOSE ENGAGED IN THE CONSTRUCTION WORK. CONSTRUCTION SIGNING SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF CONSTRUCTION AND MAINTENANCE OPERATIONS SUPPLEMENT TO THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES BY THE USDOT.
5. ALL MATERIAL CLEARED OR DEMOLISHED BY THE CONTRACTOR IN ORDER TO CONSTRUCT THE WORK SHALL BECOME THE PROPERTY OF THE CONTRACTOR AND SHALL BE PROPERLY DISPOSED OF OFF-SITE.
6. ALL WORK BY THE CONTRACTOR SHALL BE WARRANTED BY THE CONTRACTOR FOR A PERIOD OF ONE YEAR AFTER THE OWNER ACCEPTS THE WORK.
7. CONTRACTOR SHALL CALL THE NORTH CAROLINA ONE-CALL CENTER AT 811 AN ALLOW THE CENTER TO LOCATE EXISTING UTILITIES BEFORE DIGGING.
8. ANY DISCREPANCY IN THIS PLAN AND ACTUAL FIELD CONDITIONS SHALL BE REPORTED TO THE OWNER PRIOR TO START OF CONSTRUCTION. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF ALL SETBACKS, EASEMENTS AND DIMENSIONS SHOWN HEREON BEFORE BEGINNING CONSTRUCTION.
9. CONTRACTOR SHALL MAINTAIN THE SITE IN A MANNER SO THAT WORKMEN AND PUBLIC SHALL BE PROTECTED FROM INJURY, AND ADJOINING PROPERTY PROTECTED FROM DAMAGE.
10. ACCESS TO UTILITIES, FIRE HYDRANTS, STREET LIGHTING, ETC., SHALL REMAIN UNDISTURBED, UNLESS COORDINATED WITH THE RESPECTIVE UTILITY.
11. DO NOT SCALE THIS DRAWING AS IT IS A REPRODUCTION AND SUBJECT TO DISTORTION.
12. THE GENERAL CONTRACTOR SHALL REMOVE ALL DEBRIS FROM THE SITE UPON COMPLETION OF THE PROJECT AND AT LEAST ONCE A WEEK DURING CONSTRUCTION.
13. THE GENERAL CONTRACTOR SHALL KEEP THE AREA OUTSIDE THE "CONSTRUCTION LIMITS" BROOM CLEAR AT ALL TIMES.
14. ALL STREET SURFACES, DRIVEWAYS, CULVERTS, CURB AND GUTTERS, ROADSIDE DRAINAGE DITCHES AND OTHER STRUCTURES THAT ARE DISTURBED OR DAMAGED IN ANY MANNER AS A RESULT OF CONSTRUCTION SHALL BE REPLACED OR REPAIRED IN ACCORDANCE WITH THE SPECIFICATIONS.
15. CONTRACTOR SHALL MAINTAIN AN "AS-BUILT" SET OF DRAWINGS TO RECORD THE EXACT LOCATION OF ALL PIPING PRIOR TO CONCEALMENT. DRAWINGS SHALL BE GIVEN TO THE OWNER UPON COMPLETION OF THE PROJECT WITH A COPY OF THE TRANSMITTAL LETTER TO THE ENGINEER.
16. IF DEPARTURES FROM THE SPECIFICATIONS OR DRAWINGS ARE DEEMED NECESSARY BY THE CONTRACTOR, DETAILS OF SUCH DEPARTURES AND REASONS THEREOF SHALL BE GIVEN TO THE OWNER FOR REVIEW. NO DEPARTURES FROM THE CONTRACT DOCUMENTS SHALL BE MADE WITHOUT THE PERMISSION OF THE OWNER, THE CITY OF WILMINGTON, NEW HANOVER COUNTY, OR CPFA, RESPECTIVELY.
17. CONTRACTOR SHALL VERIFY LOCATION AND ELEVATION OF ALL UNDERGROUND UTILITIES. THE LOCATION OF ALL EXISTING UTILITIES ARE NOT NECESSARILY SHOWN ON PLANS AND WHERE SHOWN ARE ONLY APPROXIMATE. THE CONTRACTOR SHALL ON HIS INITIATIVE AND AT NO EXTRA COST HAVE LOCATED ALL UNDERGROUND LINES AND STRUCTURES AS NECESSARY. NO CLAIMS FOR DAMAGES OR EXTRA COMPENSATION SHALL ACCRUE TO THE CONTRACTOR FROM THE PRESENCE OF SUCH PIPE OTHER OBSTRUCTIONS OR FROM DELAY DUE TO REMOVAL OR REARRANGEMENT OF THE SAME. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO UNDERGROUND STRUCTURES. CONTRACTOR SHALL CALL TOLL FREE 1-800-452-4949 AT LEAST 48 HOURS PRIOR TO CONSTRUCTION. THE CONTRACTOR IS RESPONSIBLE FOR CONTACTING ALL NONSUBSCRIBING UTILITIES.
18. THE CONTRACTOR SHALL OBTAIN AND PAY FOR ALL INSPECTIONS, CERTIFICATIONS, EQUIPMENT, ETC., THAT MAY BE REQUIRED.
19. THE ENGINEER AND/OR OWNER DISCLAIM ANY ROLE IN THE CONSTRUCTION MEANS AND METHODS ASSOCIATED WITH THE PROJECT AS SET FORTH IN THESE PLANS.
20. ALL LOT STRIPING AND DIRECTIONAL ARROWS TO BE REFLECTIVE MARKINGS AND SHALL CONFORM TO MUTCD. ALL PARKING STALL MARKINGS AND LANE ARROWS WITHIN THE PARKING AREAS SHALL BE WHITE.
21. LANDSCAPE PLANTINGS AT ENTRANCE/ EXITS WILL BE INSTALLED AND MAINTAINED SO AS NOT TO INTERFERE WITH SIGHT DISTANCE NEEDS OF DRIVERS IN THE PARKING AREA AND AT ENTRANCE/EXIT LOCATIONS PER LOCAL STANDARDS.
22. ALL DIMENSIONS AND RADI ARE TO OUTSIDE FACE OF BUILDING OR TO FACE OF CURB UNLESS OTHERWISE NOTED.

**TRAFFIC NOTES:**

- 1. ALL PAVEMENT MARKINGS IN PUBLIC RIGHTS-OF-WAY & FOR DRIVEWAY(S) ARE TO BE THERMOPLASTIC & MEET CITY OF WILMINGTON AND/OR NCDOT STANDARDS.
2. TRAFFIC CONTROL DEVICES (INCLUDING SIGNS AND PAVEMENT MARKINGS) IN AREAS OPEN TO PUBLIC TRAFFIC ARE TO MEET MUTCD (MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES) STANDARDS.
3. ALL TRAFFIC CONTROL SIGNS AND MARKINGS NOT WITHIN THE PUBLIC RIGHT-OF-WAY ARE TO BE MAINTAINED BY THE PROPERTY OWNER IN ACCORDANCE WITH MUTCD STANDARDS.
4. ALL PARKING STALL MARKINGS AND LANE ARROWS WITHIN THE PARKING AREAS SHALL BE WHITE.
5. ANY OPEN CUTTING OF A CITY STREET REQUIRES A UTILITY CUT PERMIT. CONTACT 341-5888 FOR MORE DETAILS. IN CERTAIN CASES, AN ENTIRE RESURFACING OF THE AREA BEING OPEN CUT MAY BE REQUIRED.
6. CONTACT TRAFFIC ENGINEERING, AT 341-7888 TO ENSURE THAT ALL EXISTING TRAFFIC SIGNAL FACILITIES AND EQUIPMENT ARE SHOWN ON THE PLAN. CALL TRAFFIC ENGINEERING FORTY-EIGHT (48) HOURS PRIOR TO ANY EXCAVATION IN THE RIGHT OF WAY.
7. ANY BROKEN OR MISSING SIDEWALK PANELS, DRIVEWAY PANELS AND/OR CURBING SHALL BE REPLACED.
8. TACTILE WARNING MATS TO BE INSTALLED AT ALL WHEELCHAIR RAMPS AND CURB CUTS.

**GENERAL EROSION AND SEDIMENT CONTROL NOTES:**

- 1. THE EROSION CONTROL PLAN SHALL INCLUDE PROVISIONS FOR GROUND COVER ON ALL EXPOSED PERIMETER DIKES, SWALES, DITCHES, PERIMETER SLOPES AND ALL SLOPES STEEPER THAN 3:1 WITHIN 7 CALENDAR DAYS FROM THE LAST LAND DISTURBING ACTIVITY. GROUND COVER SHALL BE PROVIDED ON ALL OTHER DISTURBED AREAS WITHIN 14 CALENDAR DAYS FROM THE LAST LAND DISTURBING ACTIVITY.
2. UNLESS OTHERWISE INDICATED, ALL VEGETATIVE AND STRUCTURAL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE CONSTRUCTED AND MAINTAINED IN ACCORDANCE WITH THE MINIMUM STANDARDS AND SPECIFICATIONS OF THE NORTH CAROLINA EROSION AND SEDIMENT CONTROL HANDBOOK. (NO SEPARATE PAYMENT).
3. THE CONTRACTOR SHALL NOTIFY PLAN APPROVING AUTHORITY ONE WEEK PRIOR TO THE PRE-CONSTRUCTION CONFERENCE, ONE WEEK PRIOR TO THE COMMENCEMENT OF LAND DISTURBING ACTIVITY, AND ONE WEEK PRIOR TO FINAL INSPECTION.
4. ALL EROSION AND SEDIMENT CONTROL MEASURES ARE TO BE PLACED PRIOR TO CLEARING AND/OR LAND DISTURBANCE.
5. A COPY OF THE APPROVED EROSION AND SEDIMENT CONTROL PLAN AND PERMIT SHALL BE MAINTAINED ON THE SITE AT ALL TIMES.
6. PRIOR TO COMMENCING LAND DISTURBING ACTIVITIES IN AREAS OTHER THAN INDICATED ON THESE PLANS INCLUDING, BUT NOT LIMITED TO OFF-SITE BORROW OR WASTE AREAS STAGING OR STORAGE AREAS), THE CONTRACTOR SHALL PREPARE AND SUBMIT A SUPPLEMENTARY EROSION CONTROL PLAN TO THE OWNER FOR REVIEW AND TO NEW HANOVER COUNTY FOR APPROVAL. CONTRACTOR SHALL PAY ALL FEES REQUIRED AND SHALL INSTALL NECESSARY MEASURES AT NO SEPARATE PAYMENT. THE CONTRACTOR SHALL PROVIDE THE OWNER AND THE ENGINEER A COPY OF THE AMENDED PERMIT.
7. THE CONTRACTOR IS RESPONSIBLE FOR INSTALLATION OF ANY ADDITIONAL EROSION CONTROL MEASURES NECESSARY TO PREVENT EROSION AND SEDIMENTATION AS DETERMINED BY EITHER THE REVIEWING AGENCY OR THE ENGINEER. (NO SEPARATE PAYMENT).
8. ALL DISTURBED AREAS ARE TO DRAIN TO APPROVED SEDIMENT CONTROL MEASURES AT ALL TIMES DURING LAND DISTURBING ACTIVITIES AND DURING SITE DEVELOPMENT UNTIL FINAL STABILIZATION IS ACHIEVED.
9. ALL AREAS DISTURBED BY CONSTRUCTION UNLESS OTHERWISE IMPROVED SHALL BE SODDED OR SEEDED AS INDICATED AND STABILIZED.
10. DURING DETERIORATING OPERATIONS, WATER SHALL BE PUMPED INTO AN APPROVED FILTERING DEVICE PRIOR TO DISCHARGE TO RECEIVING OUTLET.
11. THE CONTRACTOR SHALL INSPECT ALL EROSION CONTROL MEASURES PERIODICALLY AND AFTER EACH RUNOFF-PRODUCING EVENT. ANY NECESSARY REPAIRS OR CLEANUP TO MAINTAIN THE EFFECTIVENESS OF THE EROSION CONTROL DEVICES SHALL BE MADE IMMEDIATELY.
12. ALL TEMPORARY EROSION CONTROL MEASURES SHALL BE REMOVED BY CONTRACTOR ONCE STABILIZATION OR A SUFFICIENT GROUND COVER HAS BEEN ESTABLISHED OR AS DIRECTED BY THE ENGINEER. (NO SEPARATE PAYMENT). NCDENR'S FINAL APPROVAL IS REQUIRED.
13. TEMPORARY GRAVEL CONSTRUCTION ENTRANCE SHALL BE REQUIRED AT ALL CONSTRUCTION STAGING AREA ENTRANCES AND ALL CONSTRUCTION ACCESS LOCATIONS INTO NON-PAVED AREA. (NO SEPARATE PAYMENT).
14. WHEN CROSSING CREEK OR DRAINAGE WAY, THE DIVISION OF WATER QUALITY SHALL BE CONTACTED PRIOR TO DISTURBING A CREEK. THE CONTRACTOR SHALL INSTALL RIP-RAP WITH FABRIC ALONG DISTURBED BANKS AND CHANNEL AND RESTORE SLOPES TO ORIGINAL CONTOURS, BUT NOT STEEPER THAN 2:1 MAXIMUM. DISTURBED CREEK AREA SHALL BE STABILIZED IMMEDIATELY.

**DEMOLITION NOTES:**

- 1. CONTRACTOR TO COORDINATE WITH THE OWNER TO PROPERLY MAINTAIN OR RELOCATE EXISTING SERVICE CONNECTIONS WHEN NECESSARY.
2. CONTRACTOR IS TO WALK THE SITE AND BECOME FAMILIAR WITH THE SCOPE OF DEMOLITION REQUIRED. ALL DEMOLITION WORK REQUIRED TO CONSTRUCT NEW SITE IMPROVEMENTS WILL BE PERFORMED BY THE CONTRACTOR AND WILL BE CONSIDERED UNCLASSIFIED EXCAVATION.
3. DEMOLITION SHALL INCLUDE BUT IS NOT LIMITED TO THE EXCAVATION, HAULING AND OFFSITE DISPOSAL OF CONCRETE PADS, CONCRETE DITCHES, FOUNDATIONS, SLABS, STEPS, AND STRUCTURES; ABANDONED UTILITIES, BUILDINGS, PAVEMENTS AND ALL MATERIALS CLEARED AND STRIPPED TO THE EXTENT NECESSARY AS DIRECTED BY THE GEOTECHNICAL ENGINEER FOR THE INSTALLATION OF THE NEW IMPROVEMENTS AND WITHIN THE LIMITS OF CLEARING AND GRADING AND AS SHOWN ON THESE PLANS.
4. THE CONTRACTOR SHALL PROTECT ALL ADJACENT PROPERTY, STRUCTURES AND UTILITIES ON THE PROPERTY NOT TO BE DEMOLISHED. DAMAGE TO PROPERTIES OF OTHERS DUE TO THE CONTRACTOR'S ACTIVITIES SHALL BE REPLACED IN KIND BY THE CONTRACTOR AT NO COST TO OWNER.
5. ELECTRIC, TELEPHONE, SANITARY SEWER, WATER AND STORM SEWER UTILITIES THAT SERVICE OFF-SITE PROPERTIES SHALL BE MAINTAINED DURING THE CONSTRUCTION PROCESS BY THE CONTRACTOR.
6. THE CONTRACTOR SHALL PRODUCE A PHOTOGRAPHIC RECORD (DIGITAL) OF DEVELOPMENT COMMENCING WITH A RECORD OF THE SITE AS IT APPEARS BEFORE DEMOLITION HAS BEGUN. AFTERWARDS, A PHOTOGRAPHIC RECORD SHALL BE MAINTAINED WEEKLY DURING CONSTRUCTION AND ENDING WITH A PHOTOGRAPHIC RECORD OF THE DEVELOPMENT AS IT APPEARS AFTER DEMOLITION. THIS RECORD SHALL BE DELIVERED TO THE OWNER.
7. EXISTING CURB AND GUTTER, LIGHTS, SIDEWALK, AND UTILITIES NOT INTENDED FOR DEMOLITION SHALL BE MAINTAINED, PROTECTED AND UNDISTURBED DURING DEMOLITION.
8. ALL EXISTING IMPROVEMENTS INDICATED OR REQUIRED TO BE DEMOLISHED SHALL INCLUDE REMOVAL FROM THE PROPERTY AND PROPER DISPOSAL.
9. CONTRACTOR SHALL COORDINATE RELOCATION OF ALL EXISTING OVERHEAD AND UNDERGROUND UTILITIES INCLUDING CABLE, GAS, TELEPHONE AND ELECTRIC AND ANY OTHER UTILITIES THROUGH THE SITE WITH THE RESPECTIVE COMPANIES.
10. CONTRACTOR SHALL MAINTAIN REQUIRED DISTANCES FROM HIGH VOLTAGE OVERHEAD LINES AND REMOVE TREES SO THEY DO NOT FALL TOWARDS OVERHEAD ELECTRICITY.
11. PROVIDE SMOOTH SAW CUT OF EXISTING PAVEMENTS, CURBS AND GUTTERS AND SIDEWALKS TO BE DEMOLISHED.
12. ALL DEMOLITION WORK SHALL BE DONE IN STRICT ACCORDANCE WITH LOCAL, STATE AND FEDERAL REGULATIONS AS WELL AS OSHA REGULATIONS.
13. EXISTING FIRE HYDRANTS ON OR NEAR THE SITE ARE TO REMAIN IN SERVICE.
14. INFORMATION CONCERNING UNDERGROUND UTILITIES WAS OBTAINED FROM AVAILABLE RECORDS, BUT THE CONTRACTOR MUST DETERMINE THE EXACT LOCATION AND ELEVATIONS.

**EROSION CONTROL AND SEQUENCE OF CONSTRUCTION NOTES:**

- NOTE: THESE EROSION CONTROL AND SEQUENCE OF CONSTRUCTION NOTES ARE INTENDED FOR EACH "PHASE" OF CONSTRUCTION. THE ORDER AND STEPS TAKEN MUST BE IMPLEMENTED AS EACH PART OF THE PROJECT IS DEVELOPED, WHETHER AS A WHOLE OR IN PHASES. ANY EROSION CONTROL DEVICES/MEASURES MUST REMAIN IN PLACE UNTIL THE ENTIRE DISTURBANCE IS STABILIZED AND ALL IMPROVEMENTS WITHIN THE DISTURBANCE LIMITS ARE COMPLETE.
1. CONSTRUCT TEMPORARY GRAVEL CONSTRUCTION ENTRANCES; ESTABLISH THE LIMITS OF DISTURBANCE, TREE PROTECTION FENCING, AND TEMPORARY SILT FENCE.
2. CLEAR AND REMOVE FROM SITE TREES AS DESIGNATED, ROOTS, ROOT MAT, ETC. FROM THE AREA WITHIN THE DESIGNATED CLEARING LIMITS.
3. CONSTRUCT TEMPORARY SEDIMENT BASIN(S) AND ASSOCIATED SKIMMER, OUTLET PIPE, SPILLWAY, ETC.
4. INSTALL REMAINING EROSION CONTROL MEASURES AS SHOWN ON THE PLANS WITHIN THE AREA DISTURBED. ALL EROSION CONTROL MEASURES MUST BE INSTALLED BEFORE COMMENCING CONSTRUCTION.
5. PLANT GRASS OVER ALL GRADED AREAS WITHIN 14 WORKING DAYS OF CEASE OF ANY GRADING ACTIVITY.
6. IMMEDIATELY UPON THE INSTALLATION OF ANY STORM DRAINAGE CATCH BASIN, DROP INLET, ETC., THE CONTRACTOR SHALL INSTALL INLET PROTECTION TO PREVENT SEDIMENT FROM ENTERING THE DRAINAGE SYSTEM.
7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CLEARING AND RESTORING TO PRE-CONSTRUCTION CONDITIONS ANY AREAS OUTSIDE THE PROJECT LIMITS THAT MAY INADVERTENTLY BE DAMAGED DUE TO THE FAILURE OF THE EROSION CONTROL MEASURES.
8. DURING GRADING AND AFTER GRADING HAS BEEN COMPLETE, THE CONTRACTOR SHALL CONTINUE TO MAINTAIN PERMANENT AND TEMPORARY EROSION CONTROL MEASURES UNTIL FINAL APPROVAL BY ENGINEER OR EROSION CONTROL INSPECTOR.
9. UPON RECEIVING FINAL APPROVAL, THE CONTRACTOR CAN REMOVE TEMPORARY EROSION CONTROL MEASURES.
10. THE CONTRACTOR SHALL CONTINUE TO WATER, FERTILIZE, MOW AND MAINTAIN GRASS & PLANTED AREAS UNTIL ALL CONSTRUCTION IS COMPLETE.

**EROSION CONTROL MAINTENANCE PLAN:**

- 1. ALL EROSION AND SEDIMENT CONTROL PRACTICES WILL BE CHECKED FOR STABILITY AND OPERATION FOLLOWING EVERY 1/2-INCH OR GREATER RAINFALL BUT IN NO CASE LESS THAN ONCE EVERY WEEK. ANY NEEDED REPAIRS WILL BE MADE IMMEDIATELY TO MAINTAIN ALL PRACTICES AS DESIGNED.
2. ALL CONSTRUCTION ENTRANCES WILL BE PERIODICALLY TOP DRESSED WITH AN ADDITIONAL 2 INCHES OF #4 STONE TO MAINTAIN PROPER DEPTH. ANY SEDIMENT THAT IS TRACKED INTO THE STREET WILL BE IMMEDIATELY REMOVED.
3. SEDIMENT FENCE / SEDIMENT FENCE OUTLETS - SEDIMENT WILL BE REMOVED BEHIND THE SEDIMENT FENCE WHEN IT BECOMES HALF-FILLED; THE SEDIMENT FENCE WILL BE REPAIRED AS NECESSARY TO MAINTAIN A BARRIER. STAKES MUST BE STEEL AND SPACED 6 FEET WITH EXTRA STRENGTH FABRIC AND WIRE BACKING ARE USED. IF ROCK FILTERS (OR EXCELSIOR WATTLES) ARE DESIGNED AT LOW POINTS IN THE SEDIMENT FENCE THE ROCK OR WATTLE WILL BE REPAIRED OR REPLACED IF IT BECOMES HALF FULL OF SEDIMENT, NO LONGER DRAINS, OR IS DAMAGED.
4. ALL SEEDER AREAS WILL BE FERTILIZED, RESEED AS NECESSARY, AND MULCHED ACCORDING TO SPECIFICATIONS ON THESE PLANS AND CONTRACT SPECIFICATIONS TO MAINTAIN A VIGOROUS, DENSE VEGETATIVE COVER.
5. INLET PROTECTION - SEDIMENT SHALL BE REMOVED FROM HARDWARE CLOTH AND GRAVEL, BLOCK AND GRAVEL, OR ROCK-PIPE INLETS, WHEN IT REACHES HALF-FILLED; ROCK WILL BE CLEANED OR REPLACED WHEN NO LONGER DRAINS. SILT SACKS, BEAVER DAMS, SANDY SACKS, AND SOCKS NEED CHECKING EVERY WEEK AND AFTER RAIN.
6. OUTLET PROTECTION - INSPECT RIP RAP OUTLET STRUCTURES WEEKLY AND AFTER RAINFALL EVENTS TO SEE IF ANY EROSION AROUND OR BELOW THE RIP RAP HAS TAKEN PLACE, OR IF STONES HAVE BEEN DISLODGED. IMMEDIATELY MAKE ALL NEEDED REPAIRS TO PREVENT FURTHER OFFSITE SEDIMENTATION.
7. EMERGENCY SPILLWAY / FOREBAY PROTECTION - AFTER EVERY HIGH-WATER EVENT INSPECT THE INTEGRITY OF THE LINED SPILLWAY AND THE ADJACENT EARTHEN BANKS. IMMEDIATELY MAKE ALL NEEDED REPAIRS TO PREVENT FURTHER DAMAGE. REPAIR ANY VOIDS IN THE RIP RAP LINED APRONS. RE-ESTABLISH ANY LOOSE STONES, AND FIX GAPS IN THE ADJACENT VEGETATIVE COVER.
8. CONCRETE WASHOUTS - CONCRETE WASHOUTS SHOULD BE INSPECTED DAILY AND AFTER HEAVY RAINS. DAMAGES SHOULD BE REPAIRED PROMPTLY. IF FILLED TO OVER 75% CAPACITY WITH RAIN WATER IT SHOULD BE VACUUMED OR ALLOWED TO EVAPORATE TO AVOID OVERFLOWS. BEFORE HEAVY RAINS THE CONTAINERS LIQUID LEVEL SHOULD BE LOWERED OR THE CONTAINER COVERED TO AVOID AN OVER FLOW DURING RAIN. WHEN SOLIDS HAVE HARDENED THEY SHOULD BE REMOVED AND RECYCLED.

PERMANENT SEEDING table with columns: GRASS TYPE, LBS/ ACRE, TIME OF SEEDING, FERTILIZER LIMESTONE. Rows include Bermuda, Hulled Bermuda, Unhulled Bermuda, Centipede, Tall Fescue, Coastal Dativar, Rye, Sweet Sudan, German or Brown Top Millet, Straw Mulch as needed.

TEMPORARY SEEDING table with columns: GRASS TYPE, LBS/ ACRE, TIME OF SEEDING, FERTILIZER LIMESTONE. Rows include Rye Grain, Sweet Sudan, German or Brown Top Millet, Straw Mulch as needed.

STABILIZATION TIME FRAME: IN THE EVENT THAT THE GOVERNING AGENCIES TIMEFRAME FOR STABILIZATION VARY, CONTRACTOR SHALL MEET THE MORE STRINGENT REQUIREMENT.

**NC ACCESSIBILITY NOTES:**

- GENERAL NOTES: SPECIAL ATTENTION SHALL BE GIVEN TO COMPLIANCE WITH AMERICANS WITH DISABILITIES ACT (2010 ADA STANDARDS), THE NORTH CAROLINA BUILDING CODE/ANSI A117.1, AND APPLICABLE LOCAL LAWS & REGULATIONS.
1. IT IS ESSENTIAL THAT CONTRACTORS ARE AWARE OF THE SITE ACCESSIBILITY REQUIREMENTS. PARAMOUNT ENGINEERING HAS DEVELOPED THESE NOTES AND DETAILS TO ASSURE THAT CONTRACTORS ARE AWARE OF THE REQUIREMENTS AT THE POINT IN TIME WHEN THEY ARE BIDDING THE PROJECT. IN ADDITION, PARAMOUNT ENGINEERING HAS MADE A POINT IN THESE NOTES AND DETAILS, AS WELL AS IN OUR DRAWINGS, TO PROVIDE SLOPES / GRADES AND DIMENSIONS THAT COMPLY WITH THE AMERICANS WITH DISABILITIES ACT (2010 ADA STANDARDS), THE NORTH CAROLINA BUILDING CODE/ANSI A117.1 AND APPLICABLE LOCAL LAWS & REGULATIONS. IF THESE SLOPES / GRADES AND DIMENSIONS ARE NOT ACHIEVABLE, THE CONTRACTOR IS REQUIRED TO CONTACT THE OWNER IMMEDIATELY AND BEFORE MOVING FORWARD WITH THE WORK.
2. THE CONTRACTOR SHALL NOTIFY PARAMOUNT ENGINEERING IMMEDIATELY OF ANY CONFLICT BETWEEN THESE NOTES AND DETAILS AND OTHER PROJECT DRAWINGS, WHETHER BY PARAMOUNT ENGINEERING OR OTHERS. THE CONTRACTOR SHALL NOT PROCEED WITH THE WORK FOR WHICH THE ALLEGED CONFLICT HAS BEEN DISCOVERED UNTIL SUCH ALLEGED CONFLICT HAS BEEN RESOLVED. NO CLAIM SHALL BE MADE BY THE CONTRACTOR FOR DELAY OR DAMAGES AS A RESULT OF RESOLUTION OF ANY SUCH CONFLICT(S).
3. THESE ACCESSIBILITY NOTES AND DETAILS ARE INTENDED TO DEPICT SLOPE AND DIMENSIONAL REQUIREMENTS ONLY. REFER TO SIDEWALK, CURBING, AND PAVEMENT DETAILS FOR ADDITIONAL INFORMATION.
4. ACCESSIBLE ROUTE NOTES: AT LEAST ONE ACCESSIBLE ROUTE SHALL BE PROVIDED WITHIN THE SITE FROM ACCESSIBLE PARKING SPACES AND ACCESSIBLE PASSENGER LOADING ZONES; PUBLIC STREETS OR SIDEWALKS; AND PUBLIC TRANSPORTATION STOPS TO THE ACCESSIBLE BUILDING OR FACILITY ENTRANCE THEY SERVE. AT LEAST ONE ACCESSIBLE ROUTE SHALL CONNECT ACCESSIBLE BUILDINGS, ACCESSIBLE FACILITIES, ACCESSIBLE ELEMENTS, AND ACCESSIBLE SPACES THAT ARE ON THE SAME SITE. WALKING SURFACES THAT ARE PART OF AN ACCESSIBLE ROUTE SHALL HAVE A MAXIMUM RUNNING SLOPE OF 5.0% AND A MAXIMUM CROSS SLOPE OF 2.0%. ANY WALKING SURFACE THAT IS PART OF AN ACCESSIBLE ROUTE WITH A RUNNING SLOPE GREATER THAN 5.0% IS A RAMP AND SHALL COMPLY WITH THE GUIDELINES FOR RAMPS OR CURB RAMPS. TRANSITIONS BETWEEN RAMPS, WALKS, LANDINGS, GUTTERS OR STREETS SHALL BE FLUSH AND FREE OF ABRUPT VERTICAL CHANGES (1/4 INCH MAXIMUM VERTICAL CHANGE IN LEVEL PERMITTED). FLOOR SURFACES SHALL BE STABLE, FIRM AND SLIP RESISTANT. THE MINIMUM CLEAR WIDTH OF EXTERIOR ACCESSIBLE ROUTES SHALL BE FORTY-EIGHT (48) INCHES MINIMUM MEASURED BETWEEN HANDRAILS WHERE HANDRAILS ARE PROVIDED (NC BUILDING CODE 1104.1.8 1104.2). WHERE AN ACCESSIBLE ROUTE MAKES A 90 DEGREE TURN AROUND AN OBJECT THAT IS LESS THAN FORTY-EIGHT (48) INCHES IN WIDTH, CLEAR WIDTH SHALL BE FORTY-TWO (42) INCHES MINIMUM APPROACHING THE TURN, FORTY-EIGHT (48) INCHES MINIMUM DURING THE TURN, AND FORTY-TWO (42) INCHES MINIMUM LEAVING THE TURN. THE CLEAR WIDTH APPROACHING AND LEAVING THE TURN MAY BE THIRTY-SIX (36) INCHES MINIMUM WHEN THE CLEAR WIDTH AT THE TURN IS SIXTY (60) INCHES MINIMUM. \* SEE NOTE 7 ABOVE FOR NC CLEAR WIDTH OF EXTERIOR ACCESSIBLE ROUTES' AN ACCESSIBLE ROUTE WITH A CLEAR WIDTH LESS THAN SIXTY (60) INCHES SHALL PROVIDE PASSING SPACES AT INTERVALS OF TWO HUNDRED (200) FEET MAXIMUM. PASSING SPACES SHALL BE EITHER A SIXTY (60) INCH MINIMUM BY SIXTY (60) INCH MINIMUM SPACE, OR AN INTERSECTION OF TWO (2) WALKING SURFACES THAT PROVIDE A COMPLIANT T-SHAPED TURNING SPACE, PROVIDED THE BASE AND ARMS OF THE T-SHAPED SPACE EXTEND FORTY-EIGHT (48) INCHES MINIMUM BEYOND THE INTERSECTION. AN ACCESSIBLE ROUTE WITH A CLEAR WIDTH LESS THAN SIXTY (60) INCHES SHALL COMPLY WITH THE AMERICANS WITH DISABILITIES ACT (2010 ADA STANDARDS), THE NORTH CAROLINA BUILDING CODE/ANSI A117.1, AND APPLICABLE LOCAL LAWS & REGULATIONS. DIRECTIONAL SIGNAGE INDICATING THE ROUTE TO THE NEAREST ACCESSIBLE BUILDING ENTRANCE SHALL BE PROVIDED AT INACCESSIBLE BUILDING ENTRANCES. WHERE POSSIBLE, DRAINAGE INLETS SHALL NOT BE LOCATED ON AN ACCESSIBLE ROUTE. IN THE EVENT THAT A DRAINAGE INLET MUST BE LOCATED ON AN ACCESSIBLE ROUTE, THE GRATE SHALL COMPLY WITH THE AMERICANS WITH DISABILITIES ACT (2010 ADA STANDARDS), THE NC BUILDING CODE, AND APPLICABLE LOCAL LAWS & REGULATIONS. DOORWAYS, DOORWAYS AND GATES THAT ARE PART OF AN ACCESSIBLE ROUTE SHALL COMPLY WITH THE AMERICANS WITH DISABILITIES ACT (2010 ADA STANDARDS), THE NORTH CAROLINA BUILDING CODE/ANSI A117.1, AND APPLICABLE LOCAL LAWS & REGULATIONS. DIRECTIONAL SIGNAGE INDICATING THE ROUTE TO THE NEAREST ACCESSIBLE BUILDING ENTRANCE SHALL BE PROVIDED AT INACCESSIBLE BUILDING ENTRANCES.
12. WHERE POSSIBLE, DRAINAGE INLETS SHALL NOT BE LOCATED ON AN ACCESSIBLE ROUTE. IN THE EVENT THAT A DRAINAGE INLET MUST BE LOCATED ON AN ACCESSIBLE ROUTE, THE GRATE SHALL COMPLY WITH THE AMERICANS WITH DISABILITIES ACT (2010 ADA STANDARDS), THE NC BUILDING CODE, AND APPLICABLE LOCAL LAWS & REGULATIONS.

**RAMP NOTES:**

- 1. ANY PART OF AN ACCESSIBLE ROUTE WITH A RUNNING SLOPE GREATER THAN 5% SHALL BE CONSIDERED A RAMP.
2. THE MAXIMUM RUNNING SLOPE FOR A RAMP SHALL BE 8.33% AND THE MAXIMUM CROSS SLOPE SHALL BE 2.0%.
3. THE CLEAR WIDTH OF AN EXTERIOR RAMP RUN SHALL BE FORTY EIGHT INCHES (NC BUILDING CODE 1104.1), WHERE HANDRAILS ARE PROVIDED ON THE RAMP RUN, THE CLEAR WIDTH SHALL BE MEASURED BETWEEN THE HANDRAILS.
4. THE RISE FOR ANY RAMP RUN SHALL BE THIRTY (30) INCHES MAXIMUM.
5. LANDINGS SHALL BE PROVIDED AT THE TOP AND BOTTOM OF RAMPS. LANDINGS SHALL HAVE A SLOPE NOT STEEPER THAN 2.0% IN ANY DIRECTION. THE LANDING CLEAR WIDTH SHALL BE AT LEAST AS WIDE AS THE WIDEST RAMP RUN LEADING TO THE LANDING. THE LANDING CLEAR LENGTH SHALL BE SIXTY (60) INCHES LONG MINIMUM. RAMPS THAT CHANGE DIRECTION BETWEEN RUNS AT LANDINGS SHALL HAVE A CLEAR LANDING OF SIXTY (60) INCHES MINIMUM.
6. RAMP RUNS WITH A RISE GREATER THAN SIX (6) INCHES SHALL HAVE HANDRAILS ON BOTH SIDES COMPLYING WITH THE AMERICANS WITH DISABILITIES ACT (2010 ADA STANDARDS), THE NC BUILDING CODE/ANSI A117.1, AND APPLICABLE LOCAL LAWS & REGULATIONS.
7. FLOOR SURFACES OF RAMPS AND LANDINGS SHALL BE STABLE, FIRM AND SLIP RESISTANT.
8. EDGE PROTECTION COMPLYING WITH AMERICANS WITH DISABILITIES ACT (2010 ADA STANDARDS), THE NC BUILDING CODE/ANSI A117.1, AND APPLICABLE LOCAL LAWS & REGULATIONS SHALL BE PROVIDED ON EACH SIDE OF RAMP RUNS AND ON EACH SIDE OF RAMP LANDINGS.
9. WHERE DOORWAYS ARE LOCATED ADJACENT TO A RAMP LANDING, MANEUVERING CLEARANCES REQUIRED BY THE AMERICANS WITH DISABILITIES ACT (2010 ADA STANDARDS), THE NC BUILDING CODE/ANSI A117.1 SHALL BE PERMITTED TO OVERLAP THE REQUIRED LANDING AREA. WHERE DOORS THAT ARE SUBJECT TO BEING OPEN ARE ADJACENT TO A RAMP LANDING, LANDINGS SHALL BE SIZED TO PROVIDE A COMPLIANT TURNING SPACE.
10. CURB RAMP NOTES: THE MAXIMUM RUNNING SLOPE OF A CURB RAMP SHALL BE 8.33% AND THE MAXIMUM CROSS SLOPE SHALL BE 2.0%. COUNTER SLOPES OF ADJOINING GUTTERS AND ROAD SURFACES IMMEDIATELY ADJACENT TO THE CURB RAMP SHALL NOT BE STEEPER THAN 5%. THE ADJACENT SURFACES AT TRANSITIONS AT CURB RAMPS TO WALKS, GUTTERS AND STREETS SHALL BE AT THE SAME LEVEL. THE CLEAR WIDTH OF A CURB RAMP SHALL BE 36 INCHES (36) MINIMUM, EXCLUSIVE OF FLARED SIDES, IF PROVIDED. \*NOTE NC BUILDING CODE REQUIRES EXTERIOR ACCESSIBLE ROUTES TO BE 48 INCHES MINIMUM WIDE (1104.1 & 1104.2). LANDINGS SHALL BE PROVIDED AT THE TOP OF CURB RAMPS. THE CLEAR LENGTH OF THE LANDING SHALL BE THIRTY-SIX (36) INCHES MINIMUM. THE CLEAR WIDTH OF THE LANDING SHALL BE AT LEAST AS WIDE AS THE CURB RAMP, EXCLUDING FLARED SIDES, LEADING TO THE LANDING. LANDINGS SHALL HAVE A SLOPE NOT STEEPER THAN 2% IN ANY DIRECTION. IF A CURB RAMP IS LOCATED WHERE PEDESTRIANS MUST WALK ACROSS THE RAMP, OR WHERE IT IS NOT PROTECTED BY HANDRAILS OR GUARDRAILS, IT SHALL HAVE FLARED SIDES. WHERE PROVIDED, CURB RAMP FLARES SHALL NOT EXCEED 10%. CURB RAMPS AND THE FLARED SIDES OF CURB RAMPS SHALL BE LOCATED SO THAT THEY DO NOT PROJECT INTO VEHICULAR TRAFFIC LANES. PARKING SPACES OR PARKING ACCESS AISLES, CURBS AT MARKED CROSSINGS SHALL BE WHOLLY CONTAINED WITHIN THE MARKINGS, EXCLUDING ANY FLARED SIDES. CURB RAMPS SHALL BE LOCATED OR PROTECTED TO PREVENT THEIR OBSTRUCTION BY PARKED VEHICLES. IT IS RECOMMENDED TO PROVIDE CURB RAMPS WITH A TWENTY-FOUR (24) INCH DEEP DETECTABLE WARNING COMPLYING WITH 406.12 A117.1, EXTENDING THE FULL WIDTH OF THE RAMP. REFER TO DETECTABLE WARNING DETAILS AND NOTES FOR PLACEMENT, ORIENTATION AND NOTES. THE NC BUILDING CODE DOES NOT CURRENTLY REQUIRE DETECTABLE WARNING AT CURB RAMPS, NOR DO THE 2010 ADA STANDARDS - HOWEVER US DOT ADA REGULATIONS DO REQUIRE THESE. FLOOR SURFACES OF CURB RAMPS SHALL BE DEEP GROOVED, 1/2 INCH WIDE BY 1/4 INCH DEEP, ONE (1) INCH CENTERS TRANSVERSE TO THE RAMP. WHERE PROVIDED, STOP LINES SHALL BE LOCATED IN ADVANCE OF CURB RAMP. WHERE PROVIDED, PEDESTRIAN ACTIVATED SIGNALS SHALL BE LOCATED ADJACENT TO THE SIDEWALK AND NOT ON THE SIDEWALK. WHERE PROVIDED, DRAINAGE INLETS SHALL BE LOCATED UPSTREAM OF CURB RAMPS AND NOT IN THE RAMP AREA. CURB RAMP TYPE AND LOCATION ARE PER PLAN.

**NC ACCESSIBILITY NOTES CONTD.**

**PARKING SPACE NOTES:**

- 1. ACCESSIBLE PARKING SPACES SHALL BE LOCATED ON THE SHORTEST ACCESSIBLE ROUTES OF TRAVEL FROM ADJACENT PARKING TO AN ACCESSIBLE BUILDING ENTRANCE.
2. ACCESSIBLE PARKING SPACES SHALL BE AT LEAST NINETY-SIX (96) INCHES WIDE. ACCESS AISLES SHALL BE 60 INCHES WIDE. ONE OF SIX ACCESSIBLE SPACES SHOULD PROVIDE A VAN ACCESSIBLE AISLE. THE AISLE SHOULD BE 96 INCHES WIDE (OR ACCESSIBLE SPACE IS 11 FEET AND ACCESS AISLE IS FIVE FEET). WHERE PARKING SPACES AND ACCESS AISLES ARE MARKED WITH LINES, THE WIDTH MEASUREMENTS SHALL BE MADE FROM CENTERLINE OF THE MARKINGS, WHERE PARKING SPACES OR ACCESS AISLES ARE NOT ADJACENT TO ANOTHER PARKING SPACE OR ACCESS AISLES, MEASUREMENTS SHALL BE PERMITTED TO INCLUDE THE FULL WIDTH OF THE LINE DEFINING THE PARKING SPACE OR ACCESS AISLE.
3. PARKING ACCESS AISLES SHALL BE PART OF AN ACCESSIBLE ROUTE TO THE BUILDING OR FACILITY ENTRANCE AND SHALL COMPLY WITH PROVISIONS FOR ACCESSIBLE ROUTES. MARKED CROSSINGS SHALL BE PROVIDED WHERE THE ACCESSIBLE ROUTE MUST CROSS VEHICULAR TRAFFIC LANES. WHERE POSSIBLE, IT IS PREFERABLE THAT THE ACCESSIBLE ROUTE NOT PASS BEHIND PARKED VEHICLES.
4. TWO (2) ACCESSIBLE PARKING SPACES MAY SHARE A COMMON ACCESS AISLE.
5. ACCESS AISLES SHALL EXTEND THE FULL LENGTH OF THE PARKING SPACE THEY SERVE.
6. ACCESS AISLES SHALL BE MARKED SO AS TO DISCOURAGE PARKING IN THEM.
7. ACCESS AISLES SHALL NOT OVERLAP THE VEHICULAR WAY. ACCESS AISLES SHALL BE PERMITTED TO BE PLACED ON EITHER SIDE OF THE PARKING SPACE EXCEPT FOR ANGLED VAN PARKING SPACES WHICH SHALL HAVE ACCESS AISLES LOCATED ON THE PASSENGER SIDE OF THE PARKING SPACES.
8. FLOOR SURFACES OF PARKING SPACES AND ACCESS AISLES SERVING THEM SHALL BE STABLE, FIRM AND SLIP RESISTANT. ACCESS AISLES SHALL BE AT THE SAME LEVEL AS THE PARKING SPACES THEY SERVE. CHANGES IN LEVEL ARE NOT PERMITTED.
9. PARKING SPACES AND ACCESS AISLES SHALL BE LEVEL WITH SURFACE SLOPES NOT EXCEEDING 2.0% IN ALL DIRECTIONS.
10. PARKED VEHICLE OVERHANGS SHALL NOT REDUCE THE REQUIRED CLEAR WIDTH OF AN ACCESSIBLE ROUTE.
11. PARKING SPACES FOR VANS AND ACCESS AISLES AND VEHICULAR ROUTES SERVING THEM SHALL PROVIDE A VERTICAL CLEARANCE OF NINETY-EIGHT (98) INCHES MINIMUM. SIGNS SHALL BE PROVIDED AT ENTRANCES TO PARKING FACILITIES INFORMING DRIVERS OF CLEARANCES AND THE LOCATION OF VAN ACCESSIBLE PARKING SPACES.
12. EACH ACCESSIBLE PARKING SPACE SHALL BE PROVIDED WITH SIGNAGE DISPLAYING THE INTERNATIONAL SYMBOL OF ACCESSIBILITY. SIGNS SHALL BE INSTALLED AT A MINIMUM CLEAR HEIGHT OF SIXTY (60) INCHES ABOVE GRADE AND SHALL NOT INTERFERE WITH AN ACCESSIBLE ROUTE FROM AN ACCESS AISLE. SIGNS LOCATED WHERE THEY MAY BE HIT BY VEHICLES BEING PARKED SHALL BE INSTALLED WITH BOLLARD PROTECTION.
13. SIGNAGE AT ACCESSIBLE PARKING SPACES REQUIRED BY THE NC BUILDING CODE SECTION 1106.1 SHALL COMPLY WITH THE REQUIREMENTS OF NORTH CAROLINA GENERAL STATUTE 20-37.6 AND 136-30 AND THE NCDOT UNIFORM MANUAL ON TRAFFIC CONTROL DEVICES. A SEPARATE SIGN IS REQUIRED FOR EACH SPACE. SIGNS TO INDICATE THE MAXIMUM PENALTY MUST BE PROVIDED AT EACH ACCESSIBLE SPACE.
14. ACCESSIBLE PARKING SPACE, ACCESS AISLE STRIPING, AND INTERNATIONAL SYMBOL OF ACCESSIBILITY SHALL BE PAINTED BLUE (OR ANOTHER COLOR THAT CAN BE DISTINGUISHED FROM PAVEMENT).

**PASSENGER LOADING ZONE NOTES:**

- 1. PASSENGER LOADING ZONES SHALL PROVIDE VEHICULAR PULL-UP SPACE NINETY-SIX (96) INCHES WIDE MINIMUM AND TWENTY (20) FEET LONG MINIMUM.
2. PASSENGER LOADING ZONES SHALL PROVIDE A CLEARLY MARKED ACCESS AISLE THAT IS SIXTY (60) INCHES WIDE MINIMUM AND EXTENDS THE FULL LENGTH OF THE VEHICLE PULL-UP SPACE THEY SERVE.
3. ACCESS AISLE SHALL ADJOIN AN ACCESSIBLE ROUTE AND NOT OVERLAP THE VEHICULAR WAY.
4. VEHICLE PULL-UP SPACES AND ACCESS AISLES SERVING THEM SHALL BE LEVEL WITH SURFACE SLOPES NOT EXCEEDING 2.0% IN ALL DIRECTIONS. ACCESS AISLES SHALL BE AT THE SAME LEVEL AS THE VEHICLE PULL-UP SPACE THEY SERVE. CHANGES IN LEVEL ARE NOT PERMITTED.
5. FLOOR SURFACES OF VEHICLE PULL-UP SPACES AND ACCESS AISLES SERVING THEM SHALL BE STABLE, FIRM AND SLIP RESISTANT.
6. VEHICLE PULL-UP SPACES, ACCESS AISLES SERVING THEM AND A VEHICULAR ROUTE FROM AN ENTRANCE TO THE PASSENGER LOADING ZONE, AND FROM THE PASSENGER LOADING ZONE TO A VEHICULAR EXIT SERVING THEM, SHALL PROVIDE A VERTICAL CLEARANCE OF ONE HUNDRED FOURTEEN (114) INCHES MINIMUM.

**ACCESSIBLE ENTRANCE NOTES:**

- 1. ACCESSIBLE ENTRANCES SHALL BE PROVIDED AS REQUIRED BY THE AMERICANS WITH DISABILITIES ACT (2010 ADA STANDARDS) AND THE NORTH CAROLINA BUILDING CODE, AND APPLICABLE LOCAL LAWS & REGULATIONS.
2. ENTRANCE DOORS, DOORWAYS AND GATES SHALL COMPLY WITH THE AMERICANS WITH DISABILITIES ACT (2010 ADA STANDARDS) THE NC BUILDING CODE/ANSI A117.1 AND SHALL BE ON AN ACCESSIBLE ROUTE.

**GENERAL STORM SEWER NOTES:**

- 1. ALL STORM SEWERS SHALL BE CONSTRUCTED IN ACCORDANCE WITH CITY OF WILMINGTON REQUIREMENTS AS SPECIFIED ON THE DRAWINGS AND IN THE PROJECT SPECIFICATIONS.
2. BEDDING FOR ALL STORM SEWER PIPE SHALL BE AS SPECIFIED ON THE DRAWINGS.
3. ALL STORM SEWER PIPES SHOWN AS RCP ON THE PLANS SHALL BE REINFORCED CONCRETE PIPE CONFORMING TO ASTM C-76, UNLESS INDICATED OTHERWISE ON PLANS.

**ROOF DRAIN NOTE:**

- 1) PROPOSED BUILDING SHALL DIVERT ROOF DRAINAGE TO STORMWATER COLLECTION SYSTEM OR AS SHOWN ON THE PLANS.

**EXISTING UTILITY NOTES:**

- 1. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO VERIFY THE ACTUAL LOCATION AND AVAILABILITY OF ALL EXISTING AND PROPOSED UTILITIES IN THE FIELD PRIOR TO GROUND BREAKING.
2. EXISTING UTILITIES AND STRUCTURES SHOWN, BOTH UNDERGROUND AND ABOVE GROUND, ARE BASED ON A FIELD SURVEY AND THE BEST AVAILABLE RECORD DRAWINGS. THE CONTRACTOR SHALL FIELD VERIFY FIELD CONDITIONS PRIOR TO BEGINNING RELATED CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED TO THE OWNERS REPRESENTATIVE IMMEDIATELY.



For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.

WILMINGTON NORTH CAROLINA Public Services • Engineering Division APPROVED STORMWATER MANAGEMENT PLAN Date: \_\_\_\_\_ Permit # \_\_\_\_\_ Signed: \_\_\_\_\_

Approved Construction Plan Name \_\_\_\_\_ Date \_\_\_\_\_ Planning \_\_\_\_\_ Traffic \_\_\_\_\_ Fire \_\_\_\_\_

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

PROJECT STATUS: CONCESSIONAL LAYOUT: FINAL DESIGN: RELEASED FOR CONSTRUCTION: DRAWING INFORMATION: DATE: 10.13.21 SCALE: AS SHOWN DRAWING: CHECKED: PROJECT STATUS: GENERAL NOTES: THE WILMINGTON FOOD BANK GREENFIELD STREET WILMINGTON, NORTH CAROLINA PROJECT STATUS: CONCESSIONAL LAYOUT: FINAL DESIGN: RELEASED FOR CONSTRUCTION: DRAWING INFORMATION: DATE: 10.13.21 SCALE: AS SHOWN DRAWING: CHECKED: SEAL: Professional Seal redacted on electronic copy per City of Wilmington Policy C-1.0 PEI JOB#: 20484.PE

**GROUND STABILIZATION AND MATERIALS HANDLING PRACTICES FOR COMPLIANCE WITH THE NCG01 CONSTRUCTION GENERAL PERMIT**  
Implementing the details and specifications on this plan sheet will result in the construction activity being considered compliant with the Ground Stabilization and Materials Handling sections of the NCG01 Construction General Permit (Sections E and F, respectively). The permittee shall comply with the Erosion and Sediment Control plan approved by the delegated authority having jurisdiction. All details and specifications shown on this sheet may not apply depending on site conditions and the delegated authority having jurisdiction.

**SECTION E: GROUND STABILIZATION**

Required Ground Stabilization Timeframes		
Site Area Description	Stabilize within this many calendar days after ceasing land disturbance	Timeframe variations
(a) Perimeter dikes, swales, ditches, and perimeter slopes	7	None
(b) High Quality Water (HQW) Zones	7	None
(c) Slopes steeper than 3:1	7	If slopes are 10' or less in length and are not steeper than 2:1, 14 days are allowed. -7 days for slopes greater than 50' in length and with slopes steeper than 4:1 -7 days for perimeter dikes, swales, ditches, perimeter slopes and HQW Zones
(d) Slopes 3:1 to 4:1	14	-10 days for Falls Lake Watershed
(e) Areas with slopes flatter than 4:1	14	-7 days for perimeter dikes, swales, ditches, perimeter slopes and HQW Zones -10 days for Falls Lake Watershed unless there is zero slope

**Note:** After the permanent cessation of construction activities, any areas with temporary ground stabilization shall be converted to permanent ground stabilization as soon as practicable but in no case longer than 90 calendar days after the last land disturbing activity. Temporary ground stabilization shall be maintained in a manner to render the surface stable against accelerated erosion until permanent ground stabilization is achieved.

**GROUND STABILIZATION SPECIFICATION**

Stabilize the ground sufficiently so that rain will not dislodge the soil. Use one of the techniques in the table below:

Temporary Stabilization	Permanent Stabilization
<ul style="list-style-type: none"> <li>Temporary grass seed covered with straw or other mulches and tackifiers</li> <li>Hydroseeding</li> <li>Roller erosion control products with or without temporary grass seed</li> <li>Appropriately applied straw or other mulch</li> <li>Plastic sheeting</li> </ul>	<ul style="list-style-type: none"> <li>Permanent grass seed covered with straw or other mulches and tackifiers</li> <li>Geotextile fabrics such as permanent soil reinforcement matting</li> <li>Hydroseeding</li> <li>Shrubs or other permanent plantings covered with mulch</li> <li>Uniform and evenly distributed ground cover sufficient to restrain erosion</li> <li>Structural methods such as concrete, asphalt or retaining walls</li> <li>Roller erosion control products with grass seed</li> </ul>

**POLYACRYLAMIDES (PAMS) AND FLOCCULANTS**

- Select flocculants that are appropriate for the soils being exposed during construction, selecting from the *NC DWR List of Approved PAMS/Flocculants*.
- Apply flocculants at or before the inlets to Erosion and Sediment Control Measures.
- Apply flocculants at the concentrations specified in the *NC DWR List of Approved PAMS/Flocculants* and in accordance with the manufacturer's instructions.
- Provide ponding area for containment of treated stormwater before discharging offsite.
- Store flocculants in leak-proof containers that are kept under storm-resistant cover or surrounded by secondary containment structures.

**EQUIPMENT AND VEHICLE MAINTENANCE**

- Maintain vehicles and equipment to prevent discharge of fluids.
- Provide drip pans under any stored equipment.
- Identify leaks and repair as soon as feasible, or remove leaking equipment from the project.
- Collect all spent fluids, store in separate containers and properly dispose as hazardous waste (recycle when possible).
- Remove leaking vehicles and construction equipment from service until the problem has been corrected.
- Bring used fuels, lubricants, coolants, hydraulic fluids and other petroleum products to a recycling or disposal center that handles these materials.

**LITTER, BUILDING MATERIAL AND LAND CLEARING WASTE**

- Never burn or burn waste. Place litter and debris in approved waste containers.
- Provide a sufficient number and size of waste containers (e.g. dumpster, trash receptacle) on site to contain construction and domestic wastes.
- Locate waste containers at least 50 feet away from storm drain inlets and surface waters unless no other alternatives are reasonably available.
- Locate waste containers on areas that do not receive substantial amounts of runoff from upland areas and does not drain directly to a storm drain, stream or wetland.
- Cover waste containers at the end of each workday and before storm events or provide secondary containment. Repair or replace damaged waste containers.
- Anchor all lightweight items in waste containers during times of high winds.
- Empty waste containers as needed to prevent overflow. Clean up immediately if containers overflow.
- Dispose waste off-site at an approved disposal facility.
- On business days, clean up and dispose of waste in designated waste containers.

**PAINT AND OTHER LIQUID WASTE**


- Do not dump paint and other liquid waste into storm drains, streams or wetlands.
- Locate paint washouts at least 50 feet away from storm drain inlets and surface waters unless no other alternatives are reasonably available.
- Contain liquid wastes in a controlled area.
- Containment must be labeled, sized and placed appropriately for the needs of site.
- Prevent the discharge of soaps, solvents, detergents and other liquid wastes from construction sites.

**PORTABLE TOILETS**

- Install portable toilets on level ground, at least 50 feet away from storm drains, streams or wetlands unless there is no alternative reasonably available. If 50 foot offset is not attainable, provide relocation of portable toilet behind silt fence or place on a gravel pad and surround with sand bags.
- Provide staking or anchoring of portable toilets during periods of high winds or in high foot traffic areas.
- Monitor portable toilets for leaking and properly dispose of any leaked material. Utilize a licensed sanitary waste hauler to remove leaking portable toilets and replace with properly operating unit.

**EARTHEN STOCKPILE MANAGEMENT**

- Show stockpile locations on plans. Locate earthen-material stockpile areas at least 50 feet away from storm drain inlets, sediment basins, perimeter sediment controls and surface waters unless it can be shown no other alternatives are reasonably available.
- Protect stockpile with silt fence installed along toe of slope with a minimum offset of five feet from the toe of stockpile.
- Provide stable stone access point when feasible.
- Stabilize stockpile within the timeframes provided on this sheet and in accordance with the approved plan and any additional requirements. Soil stabilization is defined as vegetative, physical or chemical coverage techniques that will restrain accelerated erosion on disturbed soils for temporary or permanent control needs.

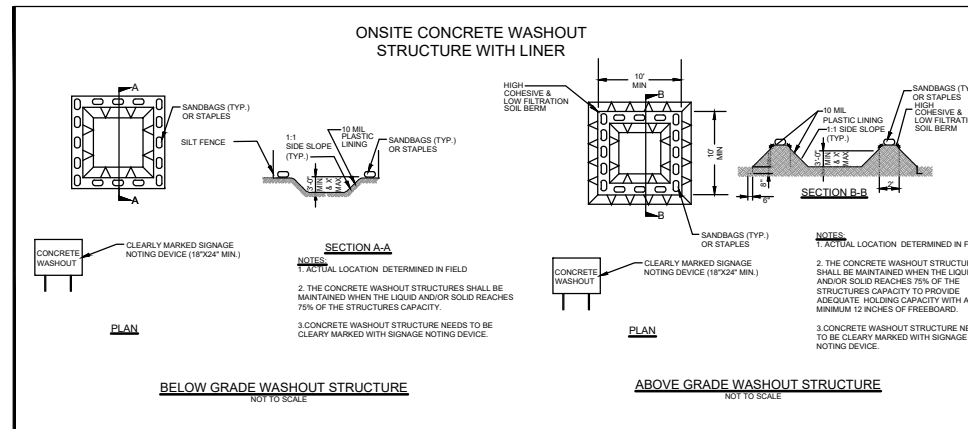

**CONCRETE WASHOUTS**

- Do not discharge concrete or cement slurry from the site.
- Dispose of, or recycle/settled, hardened concrete residue in accordance with local and state solid waste regulations and at an approved facility.
- Manage washout from mortar mixers in accordance with the above item and in addition place the mixer and associated materials on impervious barrier and within lot perimeter silt fence.
- Install temporary concrete washouts per local requirements, where applicable. If an alternate method or product is to be used, contact your approval authority for review and approval. If local standard details are not available, use one of the two types of temporary concrete washouts provided on this detail.
- Do not use concrete washouts for dewatering or storing defective curb or sidewalk sections. Stormwater accumulated within the washout may not be pumped into or discharged to the storm drain system or receiving surface waters. Liquid waste must be pumped out and removed from project.
- Locate washouts at least 50 feet from storm drain inlets and surface waters unless it can be shown that no other alternatives are reasonably available. At a minimum, install protection of storm drain inlet(s) closest to the washout which could receive spills or overflow.
- Locate washouts in an easily accessible area, on level ground and install a stone entrance pad in front of the washout. Additional controls may be required by the approving authority.
- Install at least one sign directing concrete trucks to the washout within the project limits. Post signage on the washout itself to identify this location.
- Remove leavings from the washout when at approximately 75% capacity to limit overflow events. Replace the tarp, sand bags or other temporary structural components when no longer functional. When utilizing alternative or proprietary products, follow manufacturer's instructions.
- At the completion of the concrete work, remove remaining leavings and dispose of in an approved disposal facility. Fill pit, if applicable, and stabilize any disturbance caused by removal of washout.

**HERBICIDES, PESTICIDES AND RODENTICIDES**

- Store and apply herbicides, pesticides and rodenticides in accordance with label restrictions.
- Store herbicides, pesticides and rodenticides in their original containers with the label, which lists directions for use, ingredients and first aid steps in case of accidental poisoning.
- Do not store herbicides, pesticides and rodenticides in areas where flooding is possible or where they may spill or leak into wells, stormwater drains, ground water or surface water. If a spill occurs, clean area immediately.
- Do not stockpile these materials onsite.

**HAZARDOUS AND TOXIC WASTE**

- Create designated hazardous waste collection areas on-site.
- Place hazardous waste containers under cover or in secondary containment.
- Do not store hazardous chemicals, drums or bagged materials directly on the ground.

**NCG01 GROUND STABILIZATION AND MATERIALS HANDLING**

EFFECTIVE: 04/01/19

**PART III SELF-INSPECTION, RECORDKEEPING AND REPORTING**

**SECTION A: SELF-INSPECTION**

Self-inspections are required during normal business hours in accordance with the table below. When adverse weather or site conditions would cause the safety of the inspection personnel to be in jeopardy, the inspection may be delayed until the next business day on which it is safe to perform the inspection. In addition, when a storm event of equal to or greater than 1.0 inch occurs outside of normal business hours, the self-inspection shall be performed upon the commencement of the next business day. Any time when inspections were delayed shall be noted in the Inspection Record.

Inspect	Frequency (during normal business hours)	Inspection records must include:
(1) Rain gauge maintained in good working order	Daily	Daily rainfall amounts. If no daily rain gauge observations are made during weekend or holiday periods, and no individual day rainfall information is available, record the cumulative rain measurement for those unattended days (and this will determine if a site inspection is needed). Days on which no rainfall occurred shall be recorded as "zero." The permittee may use another rain-monitoring device approved by the Division.
(2) E&SC Measures	At least once per 7 calendar days and within 24 hours of a rain event ≥ 1.0 inch in 24 hours	1. Identification of the measures inspected. 2. Date and time of the inspection. 3. Name of the person performing the inspection. 4. Indication of whether the measures were operating properly. 5. Description of maintenance needs for the measure. 6. Description, evidence, and date of corrective actions taken.
(3) Stormwater discharge outfalls (SOW)	At least once per 7 calendar days and within 24 hours of a rain event ≥ 1.0 inch in 24 hours	1. Identification of the discharge outfalls inspected. 2. Date and time of the inspection. 3. Name of the person performing the inspection. 4. Evidence of indicators of stormwater pollution such as oil sheen, floating or suspended solids or discoloration. 5. Indication of visible sediment leaving the site. 6. Description, evidence, and date of corrective actions taken.
(4) Perimeter of site	At least once per 7 calendar days and within 24 hours of a rain event ≥ 1.0 inch in 24 hours	If visible sedimentation is found outside site limits, then a record of the following shall be made: 1. Actions taken to clean up or stabilize the sediment that has left the site levels. 2. Description, evidence, and date of corrective actions taken, and 3. An explanation as to the actions taken to control future releases.
(5) Streams or wetlands onsite or offsite (where accessible)	At least once per 7 calendar days and within 24 hours of a rain event ≥ 1.0 inch in 24 hours	If the stream or wetland has increased visible sedimentation or a stream has visible increased turbidity from the construction activity, then a record of the following shall be made: 1. Description, evidence and date of corrective actions taken, and 2. Records of the required notification to the appropriate Division Regional Office per Part II, Section C, Item (2)(a) of this permit of this permit.
(6) Ground stabilization measures	After each phase of grading	1. The phase of grading (installation of perimeter E&SC measures, clearing and grubbing, installation of storm drainage facilities, completion of all land-disturbing activity, construction or redevelopment, permanent ground cover). 2. Documentation that the required ground stabilization measures have been provided within the required timeframe or an assurance that they will be provided as soon as possible.

NOTE: The rain inspection resets the required 7 calendar day inspection requirement.

**PART III SELF-INSPECTION, RECORDKEEPING AND REPORTING**

**SECTION B: RECORDKEEPING**

The approved E&SC plan as well as any approved deviation shall be kept on the site. The approved E&SC plan must be kept up-to-date throughout the coverage under this permit. The following items pertaining to the E&SC plan shall be documented in the manner described:

Item to Document	Documentation Requirements
(a) Each E&SC Measure has been installed and does not significantly deviate from the locations, dimensions and relative elevations shown on the approved E&SC Plan.	Initial and date each E&SC Measure on a copy of the approved E&SC Plan or complete, date and sign an inspection report that lists each E&SC Measure shown on the approved E&SC Plan. This documentation is required upon the initial installation of the E&SC Measures or if the E&SC Measures are modified after initial installation.
(b) A phase of grading has been completed.	Initial and date a copy of the approved E&SC Plan or complete, date and sign an inspection report to indicate completion of the construction phase.
(c) Ground cover is located and installed in accordance with the approved E&SC Plan.	Initial and date a copy of the approved E&SC Plan or complete, date and sign an inspection report to indicate compliance with approved ground cover specifications.
(d) The maintenance and repair requirements for all E&SC Measures have been performed.	Complete, date and sign an inspection report.
(e) Corrective actions have been taken to E&SC Measures.	Initial and date a copy of the approved E&SC Plan or complete, date and sign an inspection report to indicate the completion of the corrective action.

**2. Additional Documentation**  
In addition to the E&SC Plan documents above, the following items shall be kept on the site and available for agency inspectors at all times during normal business hours, unless the Division provides a site-specific exemption based on unique site conditions that make this requirement not practical:

- This general permit as well as the certificate of coverage, after it is received.
- Records of inspections made during the previous 30 days. The permittee shall record the required observations on the Inspection Record Form provided by the Division or a similar inspection form that includes all the required elements. Use of electronically-available records in lieu of the required paper copies will be allowed if shown to provide equal access and utility as the hard-copy records.
- All data used to complete the Notice of Intent and older inspection records shall be maintained for a period of three years after project completion and made available upon request. [40 CFR 122.41]

**PART III SELF-INSPECTION, RECORDKEEPING AND REPORTING**

**SECTION C: REPORTING**

**1. Occurrences that must be reported**  
Permittees shall report the following occurrences:

- Visible sediment deposition in a stream or wetland.
- Oil spills if:
  - They are 25 gallons or more,
  - They are less than 25 gallons but cannot be cleaned up within 24 hours,
  - They cause sheen on surface waters (regardless of volume), or
  - They are within 100 feet of surface waters (regardless of volume).
- Releases of hazardous substances in excess of reportable quantities under Section 311 of the Clean Water Act (Ref: 40 CFR 110.3 and 40 CFR 117.3) or Section 102 of CERCLA (Ref: 40 CFR 302.4) or G.S. 143-215.85.
- Anticipated bypasses and unanticipated bypasses.
- Noncompliance with the conditions of this permit that may endanger health or the environment.

**2. Reporting Timeframes and Other Requirements**

After a permittee becomes aware of an occurrence that must be reported, he shall contact the appropriate Division regional office within the timeframes and in accordance with the other requirements listed below. Occurrences outside normal business hours may also be reported to the Division's Emergency Response personnel at (800) 662-7956, (800) 858-0368 or (919) 733-3300.

Occurrence	Reporting Timeframes (After Discovery) and Other Requirements
(a) Visible sediment deposition in a stream or wetland	<ul style="list-style-type: none"> <li><b>Within 24 hours</b>, an oral or electronic notification.</li> <li><b>Within 7 calendar days</b>, a report that contains a description of the sediment and actions taken to address the cause of the deposition. Division staff may waive the requirement for a written report on a case-by-case basis.</li> <li>If the stream is named on the <a href="#">NC 303(a)</a> list as impaired for sediment-related causes, the permittee may be required to perform additional monitoring, inspections or apply more stringent practices if staff determine that additional requirements are needed to assure compliance with the federal or state impaired-waters conditions.</li> </ul>
(b) Oil spills and release of hazardous substances per Item 1(b)-(c) above	<ul style="list-style-type: none"> <li><b>Within 24 hours</b>, an oral or electronic notification. The notification shall include information about the date, time, nature, volume and location of the spill or release.</li> </ul>
(c) Anticipated bypasses (40 CFR 122.41(m)(3))	<ul style="list-style-type: none"> <li><b>A report at least ten days before the date of the bypass, if possible</b> The report shall include an evaluation of the anticipated quality and effect of the bypass.</li> </ul>
(d) Unanticipated bypasses (40 CFR 122.41(m)(3))	<ul style="list-style-type: none"> <li><b>Within 24 hours</b>, an oral or electronic notification.</li> <li><b>Within 7 calendar days</b>, a report that includes an evaluation of the quality and effect of the bypass.</li> </ul>
(e) Noncompliance with the conditions of this permit that may endanger health or the environment (40 CFR 122.41(l)(7))	<ul style="list-style-type: none"> <li><b>Within 24 hours</b>, an oral or electronic notification.</li> <li><b>Within 7 calendar days</b>, a report that contains a description of the noncompliance, and its causes; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time noncompliance is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance. [40 CFR 122.41(l)(6)].</li> <li>Division staff may waive the requirement for a written report on a case-by-case basis.</li> </ul>



For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.

**CITY OF WILMINGTON**  
NORTH CAROLINA  
Public Service • Engineering Division  
APPROVED STORMWATER MANAGEMENT PLAN

Date: \_\_\_\_\_ Permit # \_\_\_\_\_

Signed: \_\_\_\_\_

**Approved Construction Plan**

Name \_\_\_\_\_ Date \_\_\_\_\_

Planning \_\_\_\_\_

Traffic \_\_\_\_\_

Fire \_\_\_\_\_

**NCG01 SELF-INSPECTION, RECORDKEEPING AND REPORTING**

EFFECTIVE: 04/01/19

REVISIONS:

CLIENT INFORMATION:  
FOOD BANK OF CENTRAL & EASTERN NORTH CAROLINA  
1924 CAPITAL BLVD.  
RALEIGH, NC 27604

**PARAMOUNT ENGINEERING**  
122 Cinema Drive  
Wilmington, North Carolina 28403  
(910) 791-6707 (O) (910) 791-6766 (F)  
NC License #: C-2846

**GENERAL NOTES**  
THE WILMINGTON FOOD BANK  
GREENFIELD STREET  
WILMINGTON, NORTH CAROLINA

PROJECT STATUS:  
CONCEPTUAL LAYOUT:  
FINAL DESIGN LOGS:  
RELEASED FOR CONSTRUCTION


DRAWING INFORMATION:  
DATE: 10/13/17  
SCALE: PER  
DRAWN BY: PEI  
CHECKED: PEI

Professional Seal redacted on electronic copy per City of Wilmington Policy

**C-1.1**

PEI JOB#: 20484.PE

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

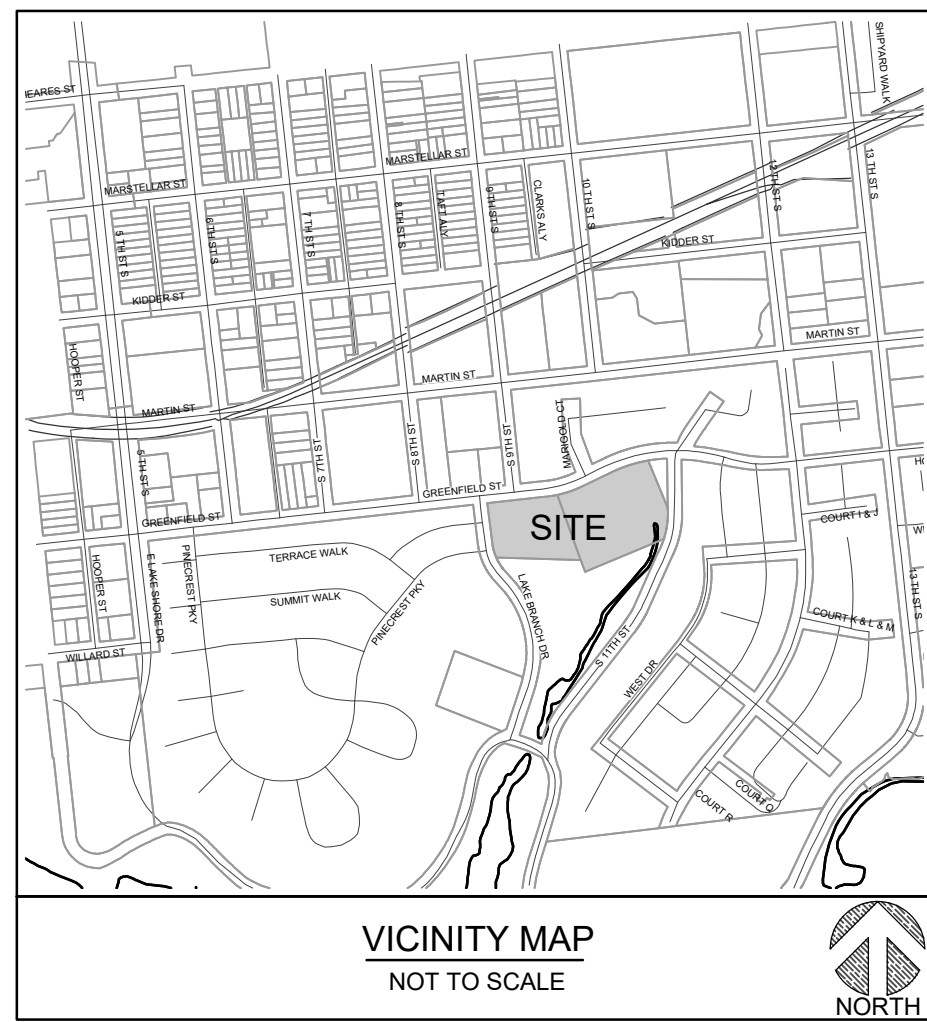

VICINITY MAP  
NOT TO SCALE

- LEGEND:**
- IPF IRON PIPE FOUND
  - IRF IRON ROD FOUND
  - PKF PK NAIL FOUND
  - PKS PK NAIL SET
  - CMF CONCRETE MONUMENT FOUND
  - IRON ROD SET
  - STREET LIGHT
  - RIGHT OF WAY LINE
  - SETBACK LINE
  - EASEMENT LINE
  - BOUNDARY LINE
  - ADJOINER LINE
  - FORMER R/W LINE

**SITE DATA:**

PROJECT ADDRESS: 1000 GREENFIELD STREET  
 R05418-004-004-000  
 PARCEL ID: R05418-004-001-000

CURRENT ZONING: UMX

GROSS SITE AREA: ± 5.141 ACRES (± 223,942SF)

OWNER INFORMATION: FOOD BANK OF CENTRAL & EASTERN NC  
 1924 CAPITAL BLVD  
 RALEIGH, NC 27604

FLOOD INFORMATION: THIS PARCEL IS NOT LOCATED IN A FEMA FLOOD ZONE

CAMA LAND USE CLASSIFICATION: URBAN


**NOTES**

1. AREA CALCULATED BY COORDINATE METHOD.
2. ALL ELEVATIONS ARE (NAVD 88)
3. THIS PARCEL IS NOT LOCATED WITHIN A SPECIAL FLOOD HAZARD AREA AS SHOWN ON FEMA FLOOD MAP NO. 3720312700K BEARING AN EFFECTIVE DATE OF 8/28/2018.
4. UTILITIES AS SHOWN ARE PLOTTED FROM INFORMATION VISIBLE IN THE FIELD AND FROM INFORMATION PROVIDED BY UTILITY COMPANIES. ADDITIONAL UTILITIES NOT SHOWN MAY EXIST. THE APPROPRIATE UTILITY COMPANIES SHOULD BE CONTACTED PRIOR TO LAND DISTURBING ACTIVITIES.
5. THIS LOT IS SUBJECT TO ALL UTILITY EASEMENTS, RESTRICTIONS, OR COVENANTS OF RECORD.

**EXISTING TREE INVENTORY**

- (1) 12" AMERICAN HOLLY
- (1) 8" CEDAR
- (1) 22" OAK
- (1) 17" OAK
- (1) 19" PECAN

\*ALL TREES TO REMAIN

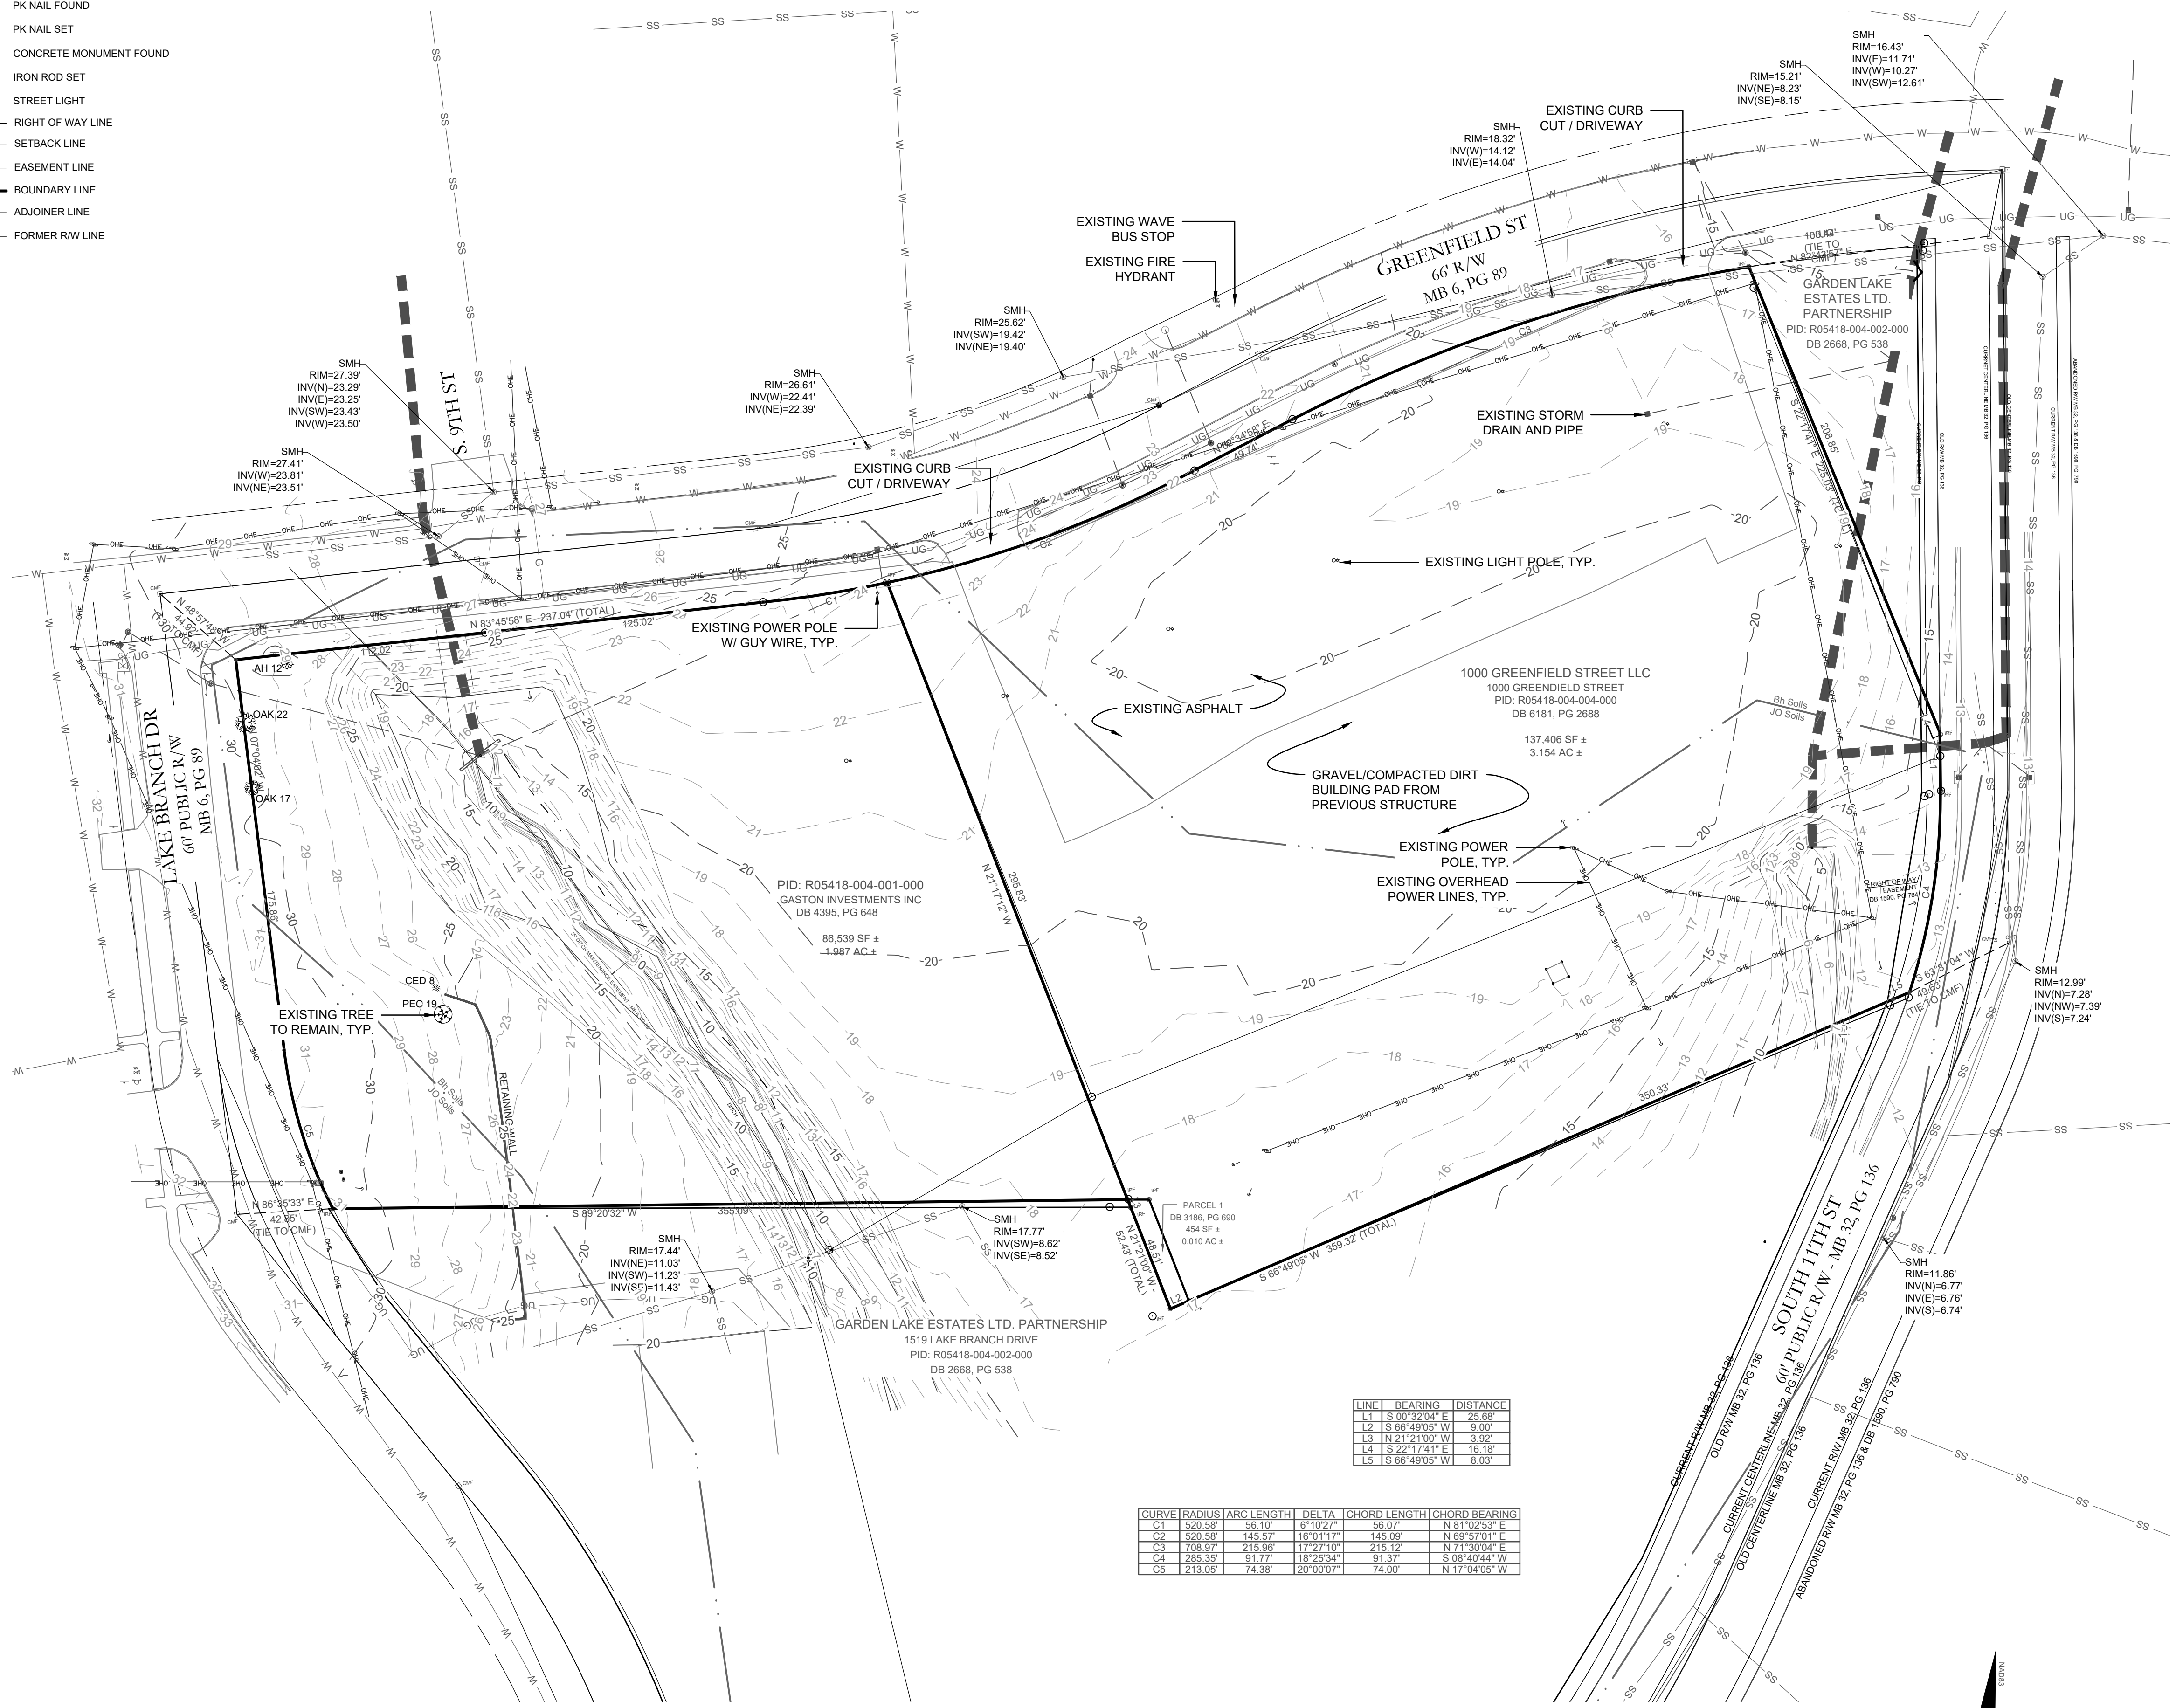

LINE	BEARING	DISTANCE
L1	S 00°32'04" E	25.68'
L2	S 66°49'05" W	9.00'
L3	N 21°12'10" W	3.92'
L4	S 22°17'41" E	16.18'
L5	S 66°49'05" W	8.03'

CURVE	RADIUS	ARC LENGTH	DELTA	CHORD LENGTH	CHORD BEARING
C1	520.58'	56.70'	6°10'27"	56.07'	N 81°02'53" E
C2	500.58'	145.57'	18°01'17"	145.09'	N 69°57'01" E
C3	708.97'	215.96'	17°27'10"	215.12'	N 71°30'04" E
C4	285.35'	91.77'	18°25'34"	91.37'	S 08°40'44" W
C5	213.02'	74.92'	20°00'07"	74.00'	N 17°04'52" W

**CERTIFICATE OF ACCURACY AND MAPPING**

I, JOSHUA W. TAYLOR, CERTIFY THAT THIS PLAT WAS DRAWN UNDER MY SUPERVISION FROM AN ACTUAL SURVEY MADE UNDER MY SUPERVISION (DEED DESCRIPTIONS RECORDED IN THE REFERENCES NOTED ON THIS DRAWING), THAT THE BOUNDARIES NOT SURVEYED ARE SHOWN AS DASHED LINES AS DRAWN FROM INFORMATION NOTED, THAT THE RATIO OF PRECISION IS 1:10,000, AND THAT THIS MAP MEETS THE REQUIREMENTS OF THE STANDARDS OF PRACTICE FOR LAND SURVEYING IN NORTH CAROLINA (21 NCAC 56.1600). THIS \_\_\_\_\_ DAY OF \_\_\_\_\_ A.D.,

I, JOSHUA W. TAYLOR, CERTIFY THAT THIS SURVEY IS OF AN EXISTING PARCEL OR PARCELS OF LAND OR ONE OR MORE EXISTING EASEMENTS AND DOES NOT CREATE A NEW STREET OR CHANGE AN EXISTING STREET.

JOSHUA W. TAYLOR, PLS LICENSE NO. L-5217

**CITY OF WILMINGTON**  
 NORTH CAROLINA  
 Public Services • Engineering Division  
 APPROVED STORMWATER MANAGEMENT PLAN

Date: \_\_\_\_\_ Permit # \_\_\_\_\_  
 Signed: \_\_\_\_\_


NCDENR PWSS WATER PERMIT #: \_\_\_\_\_ GPD  
 WATER CAPACITY: \_\_\_\_\_ GPD  
 DWQ SEWER PERMIT #: \_\_\_\_\_ GPD  
 SEWER CAPACITY: \_\_\_\_\_ GPD  
 SEWER SHED # AND PLANT: \_\_\_\_\_  
 SEWER TO FLOW THROUGH NEI: YES or NO (CIRCLE ONE)

**Approved Construction Plan**

Name \_\_\_\_\_ Date \_\_\_\_\_

Planning \_\_\_\_\_  
 Traffic \_\_\_\_\_  
 Fire \_\_\_\_\_

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.



FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

<p><b>REVISIONS:</b></p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>NO.</th> <th>DATE</th> <th>DESCRIPTION</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>12/1/21</td> <td>EXISTING LIGHTS CALLED OUT IN LEGEND</td> </tr> <tr> <td>2</td> <td>02/02/22</td> <td>REV 2 ADDITIONAL NOTES ADDED PER TRC COMMENTS</td> </tr> </tbody> </table>	NO.	DATE	DESCRIPTION	1	12/1/21	EXISTING LIGHTS CALLED OUT IN LEGEND	2	02/02/22	REV 2 ADDITIONAL NOTES ADDED PER TRC COMMENTS	<p><b>CLIENT INFORMATION:</b></p> <p>FOOD BANK OF CENTRAL &amp; EASTERN NORTH CAROLINA        1924 CAPITAL BLVD.        RALEIGH, NC 27604</p>	<p><b>PARAMOUNT ENGINEERING, INC.</b>        122 Cinema Drive        Wilmington, North Carolina 28403        (910) 791-6707 (O) (910) 791-6760 (F)        NC License #: C-2846</p>
NO.	DATE	DESCRIPTION									
1	12/1/21	EXISTING LIGHTS CALLED OUT IN LEGEND									
2	02/02/22	REV 2 ADDITIONAL NOTES ADDED PER TRC COMMENTS									
<p><b>EXISTING CONDITIONS</b></p> <p>THE WILMINGTON FOOD BANK        GREENFIELD STREET        WILMINGTON, NORTH CAROLINA</p>											
<p><b>PROJECT STATUS</b></p> <p>ORIGINAL LAYOUT: _____        MODIFIED LAYOUT: _____        FINAL DESIGN LAYOUT: _____        RELEASED FOR CONSTRUCTION: _____</p>											
<p><b>DRAWING INFORMATION</b></p> <p>DATE: 10.13.21        SCALE: 1"=40'        DRAWN BY: JET        CHECKED BY: JET</p>											
<p><b>SEAL</b></p> <p>Professional Seal        - redacted on        electronic copy        per City of        Wilmington Policy</p>											
<p><b>EX-1</b></p> <p>PEI JOB#: 20484.PE</p>											



**SITE DATA:**  
 PROJECT ADDRESS: 1000 GREENFIELD STREET  
 PARCEL ID: R05418-004-004-000  
 R05418-004-001-000  
 CURRENT ZONING: UMX  
 PROPOSED USE: FOOD PANTRY & DISTRIBUTION  
 PROJECT SITE AREA: ± 5.141 ACRES (± 223,942 SF)  
 OWNER INFORMATION: FOOD BANK OF CENTRAL & EASTERN NC  
 1924 CAPITAL BLVD  
 RALEIGH, NC 27604  
 FLOOD INFORMATION: THIS PARCEL IS NOT LOCATED IN A FEMA FLOOD ZONE  
 CAMA LAND USE CLASSIFICATION: URBAN  
 PROPOSED BUILDING SIZE: ± 32,000 SF  
 PROPOSED LOT COVERAGE: 14.3% (± 32,000 SF / ± 223,942 SF)  
 BUILDING CONSTRUCTION TYPE: TYPE 5B-SPRINKLED  
 PROPOSED DISTURBED AREA: ± 140,000 SF

**VICINITY MAP**  
 NOT TO SCALE

**LEGEND**



---	PROPERTY LINE
---	WETLANDS
---	EXISTING CONTOURS
---	RIGHT OF WAY
SS	SANITARY SEWER
W	WATER LINE
FM	FORCEMAIN LINE
LOD	LIMIT OF DISTURBANCE (LOD)
---	SILT FENCE
---	POND OUTLINE
S	SANITARY SEWER MANHOLE
---	FIRE HYDRANT ASSEMBLY
---	WHEELSTOP
---	BUILDING HATCH
---	CONCRETE PAVEMENT
---	LIGHT DUTY ASPHALT

**DIMENSIONAL REQUIREMENTS:**  
 UMX DISTRICT  
 SITE DOES NOT BORDER SINGLE FAMILY RESIDENTIAL DISTRICTS - NO MINIMUM BUILDING SETBACKS ARE REQUIRED  
 MINIMUM LOT AREA: NONE INSIDE 1945 CORPORATE LIMIT; 5 AC. OUTSIDE  
 MAXIMUM FRONT SETBACK: 10'  
 MAXIMUM BUILDING HEIGHT: 35' or 2-STORIES  
 PROPOSED BUILDING HEIGHT: 30' / 1-STORY  
 \*SEE PLAN FOR PROPOSED SETBACKS

**PARKING DATA:**  
 THERE ARE NO MINIMUM PARKING REQUIREMENTS PARKING SHALL NOT EXCEED 1 SPACE / 200 SF (SOCIAL SERVICES)  
 BUILDING SF: ±32,000 SF  
 MAX PARKING ALLOWED: 160 SPACES  
 32,000 / 200  
 TOTAL PARKING PROVIDED: 73 SPACES  
 BICYCLE PARKING (SEC. 18-528)  
 TOTAL REQUIRED: 32 SPACES  
 1 SPACES / 1,000 SF  
 TOTAL PROVIDED: 35 SPACES  
 ADA PARKING  
 TOTAL REQUIRED: 3 SPACES  
 TOTAL PROVIDED: 4 SPACES  
**TRAFFIC / TRIP GENERATION:**  
 1. WPMO / NCDOT GRANTED A WAIVER FOR TRAFFIC STUDY  
**IMPERVIOUS DATA:**  
 EXISTING IMPERVIOUS: 43,164 SF  
 EXISTING IMPERVIOUS TO BE REMOVED: 43,164 SF  
 PROPOSED BUILDINGS: 32,000 SF  
 PROPOSED PARKING & SIDEWALKS: 54,121 SF  
 TOTAL NEW IMPERVIOUS: 86,121 SF (38%)  
 TOTAL NET IMPERVIOUS: 42,957 SF

**HISTORICAL & ARCHAEOLOGY NOTES**  
 1. NO KNOWN HISTORIC OR ARCHEOLOGICAL SITES EXIST.  
**CONSERVATION RESOURCES**  
 1. NO KNOWN CONSERVATION RESOURCES EXIST ON SITE; ADDITIONAL DETERMINATION WILL OCCUR DURING CITY REVIEW PROCESS  
**CAMA AREAS OF ENVIRONMENTAL CONCERNS**  
 1. NO KNOWN CAMA AEC EXIST ON SITE  
**SOLID WASTE**  
 1. SOLID WASTE WILL BE HANDLED WITH THE PROPOSED TRASH COMPACTOR AND REMOVAL BY THE CITY OF WILMINGTON  
**FENCE NOTE**  
 1. CHAIN LINK FENCE TO BE 9 GA. OR HIGHER GALVANIZED STEELWIRES, 2" MESH WITH TOP SELVAGE KNUCKLES FOR FABRIL 60" HIGH AND UNDER; TOP AND BOTTOM SELVAGES TWISTED AND BARBED FOR FABRIC OVER 60" HIGH; MID RAIL, TOP AND BOTTOM RAIL REQUIRED  
 2. GATE TO BE AUTOMATED WITH BATTERY BACKUP. USE SLIDESMART DC OR APPROVED EQUAL

**GENERAL NOTES**  
 1. SITE PLAN WAS REVIEWED IN THE TRC REVIEW PROCESS. THIS PLAN ADDRESSES COMMENTS RECEIVED AT THOSE MEETINGS, BUT IS NOT AN APPROVED PLAN.  
 2. CONTRACTOR SHALL MAINTAIN AN ALL-WEATHER ACCESS FOR EMERGENCY VEHICLES AT ALL TIMES DURING CONSTRUCTION  
 3. LANDSCAPING OR PARKING CANNOT BLOCK OR IMPEDE THE FDC OR FIRE HYDRANTS. A 3-FOOT CLEAR SPACE SHALL BE MAINTAINED AROUND THE CIRCUMFERENCE OF THE HYDRANT AND FDC  
 4. ADDITIONAL FIRE PROTECTION AND ACCESSIBILITY REQUIREMENTS MAY BE REQUIRED DUE TO ANY SPECIAL CIRCUMSTANCES CONCERNING THE PROJECT.  
 5. CONTRACTOR SHALL SUBMIT A RADIO SIGNAL STRENGTH STUDY FOR ALL COMMERCIAL BUILDINGS THAT DEMONSTRATES THAT EXISTING EMERGENCY RESPONDER RADIO SIGNAL LEVELS MEET SECTION 510 REQUIREMENTS OF THE 2018 NC FIRE CODE.  
 6. NEW HYDRANTS MUST BE BROUGHT INTO SERVICE PRIOR TO COMBUSTIBLE MATERIALS DELIVERED TO THE JOB SITE.  
 7. ALL PROPOSED VEGETATION WITHIN SIGHT TRIANGLES SHALL NOT INTERFERE WITH CLEAR VISUAL SIGHT LINES FROM 30' - 10' PER SECTION 18-556 COW LDC.  
 8. ANY REQUIRED INSTALLATION OR RELOCATION OF TRAFFIC SIGNS IS THE RESPONSIBILITY OF THE PROJECT DEVELOPER. PLEASE COORDINATE WITH CITY TRAFFIC SIGNS AND MARKING MANAGER OR SUPERVISOR PRIOR TO INSTALLATION OF ANY TRAFFIC SIGNS OR MARKINGS IN PUBLIC ROW.  
 9. CONTACT 811 PRIOR TO CONTACTING CITY OF WILMINGTON, TRAFFIC ENGINEERING REGARDING THE UTILITIES IN ROW.  
 10. CONTACT TRAFFIC ENGINEERING AT (910) 341-7888 TO DISCUSS STREET LIGHTING OPTIONS.

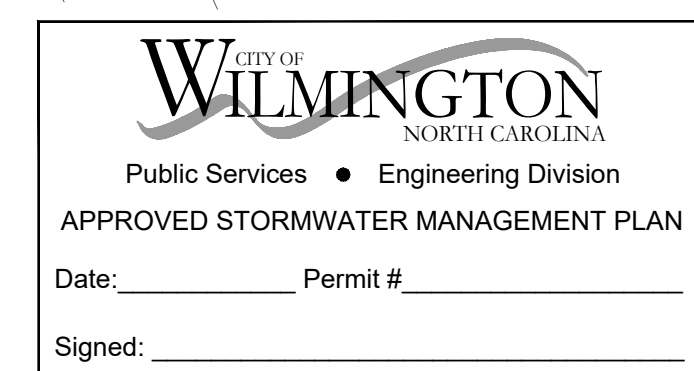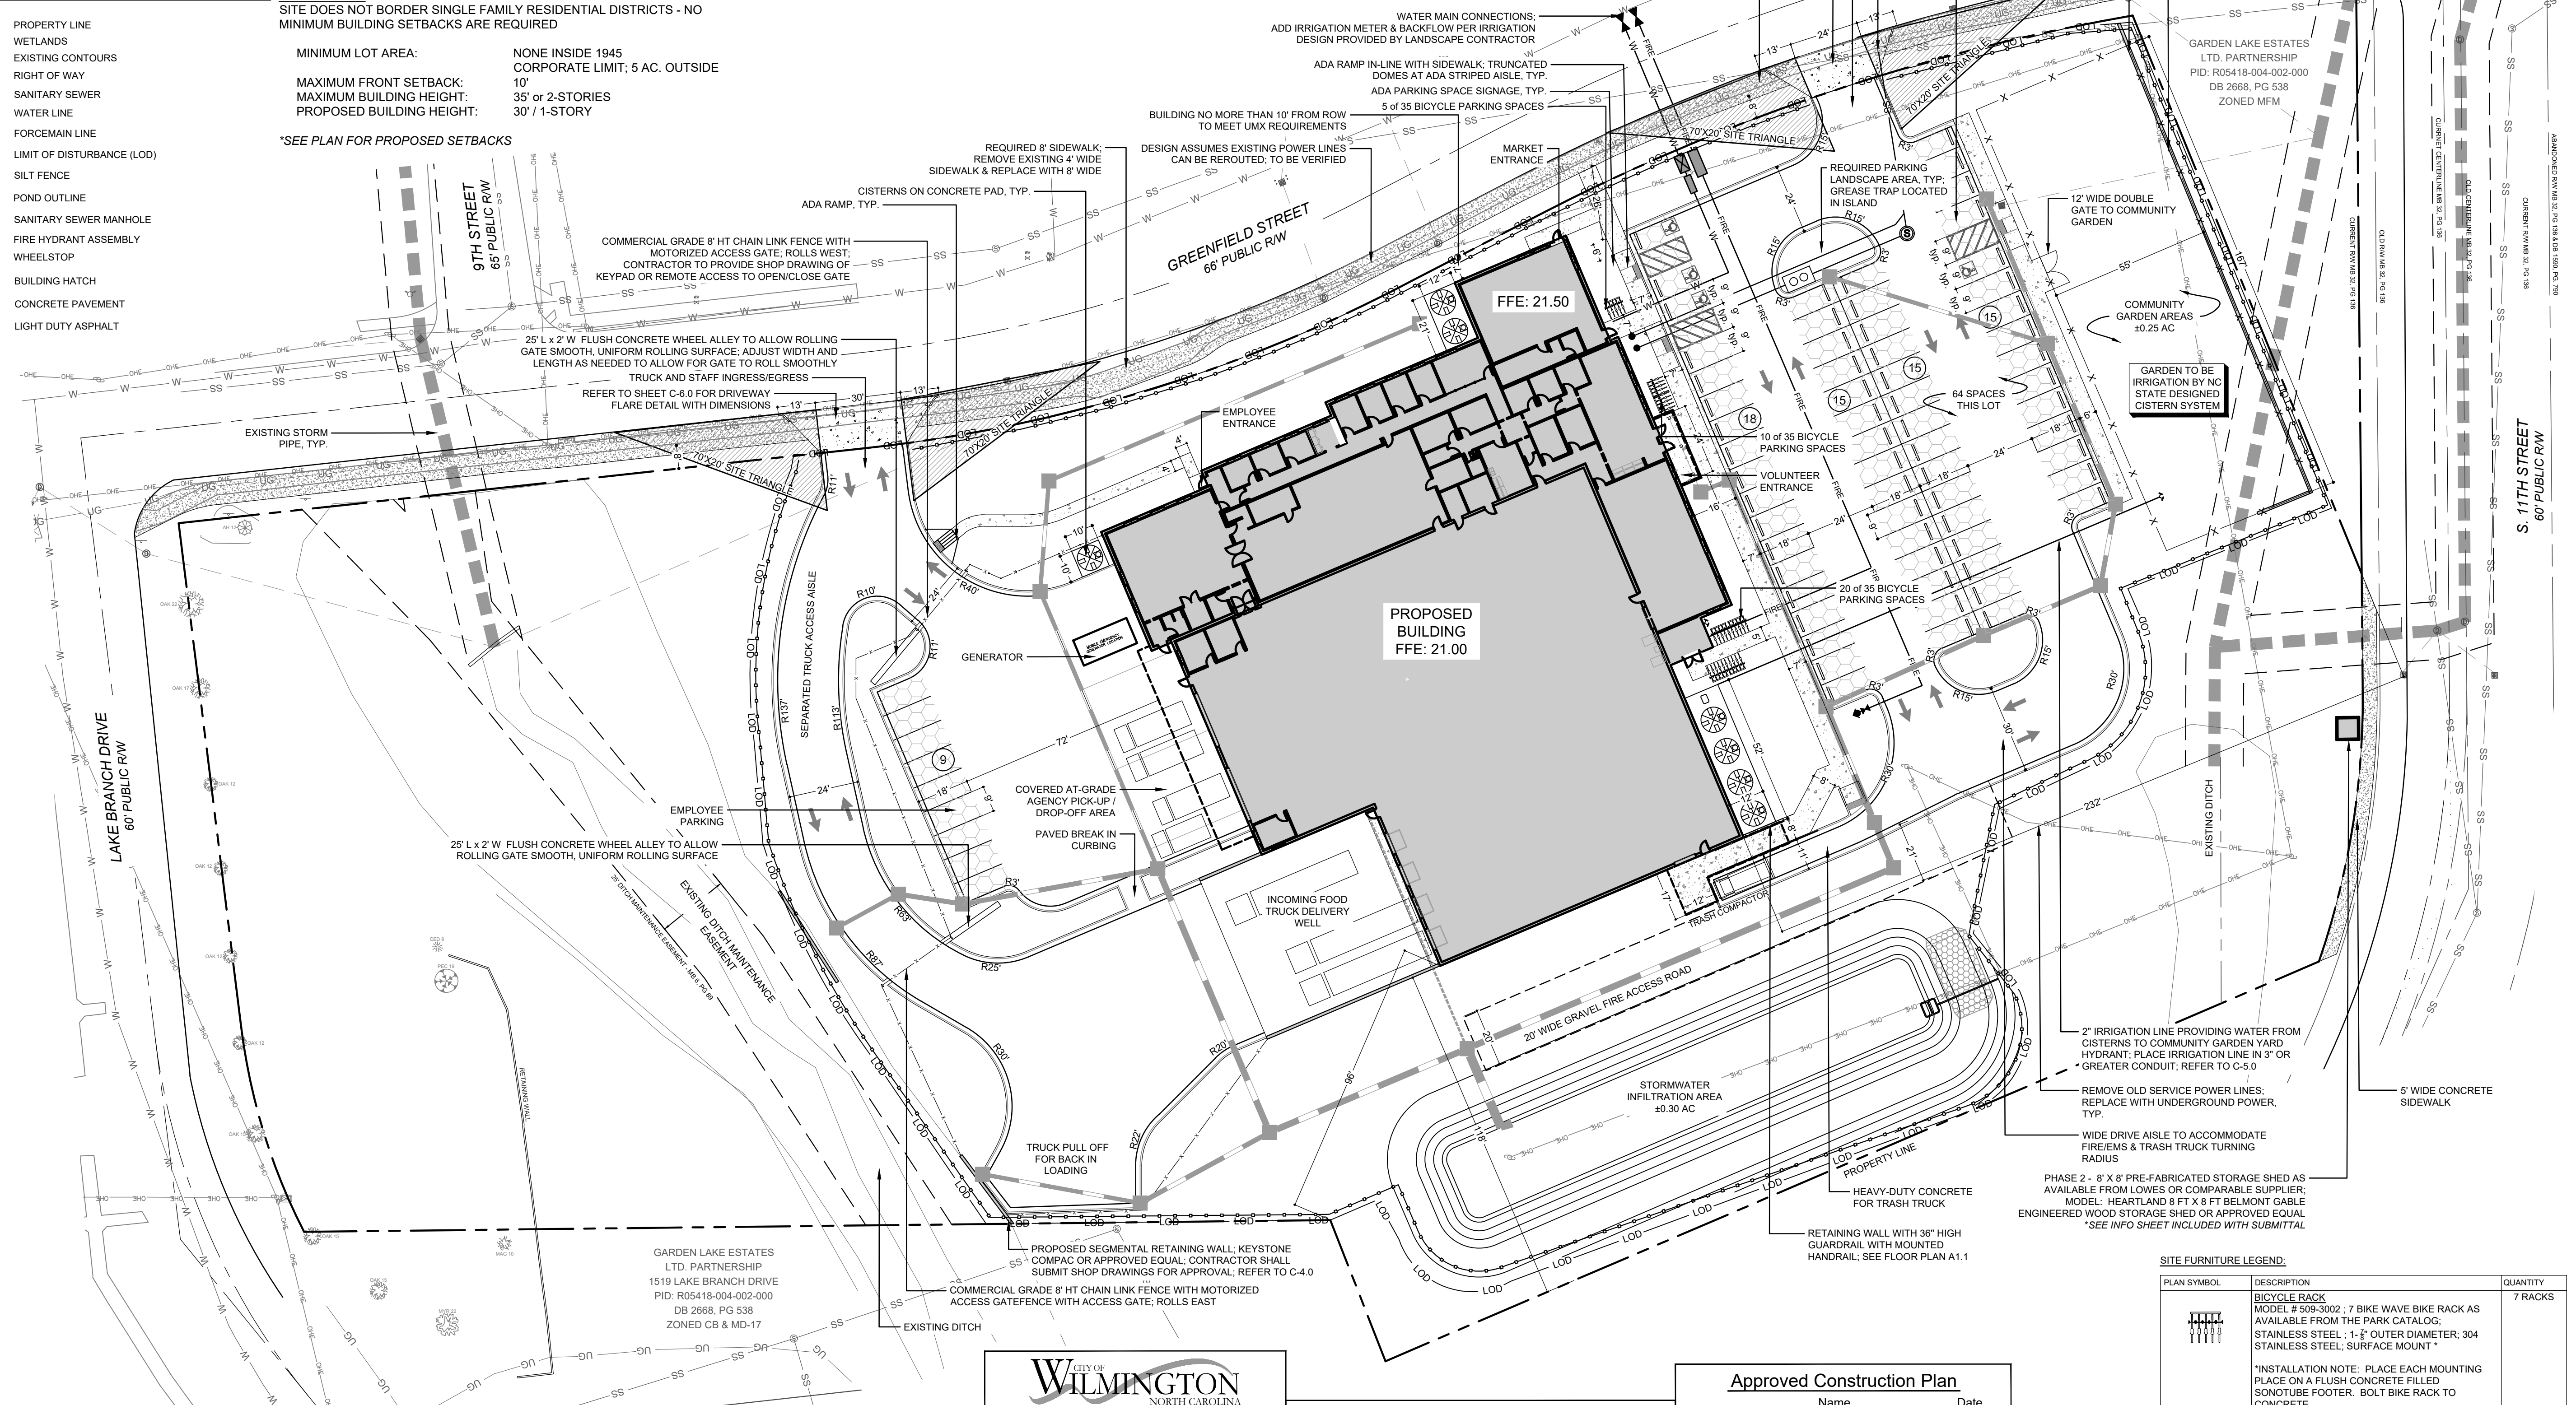


NC DENR PWSS WATER PERMIT #: \_\_\_\_\_  
 WATER CAPACITY: \_\_\_\_\_ GPD  
 DWQ SEWER PERMIT #: \_\_\_\_\_  
 SEWER CAPACITY: \_\_\_\_\_ GPD  
 SEWER SHED # AND PLANT: \_\_\_\_\_  
 SEWER TO FLOW THROUGH NET: YES or NO (CIRCLE ONE)

**Approved Construction Plan**

Name	Date
Planning	_____
Traffic	_____
Fire	_____

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.

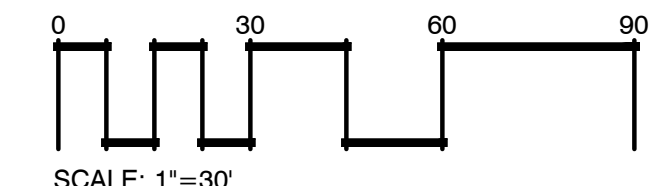

**SITE FURNITURE LEGEND:**

PLAN SYMBOL	DESCRIPTION	QUANTITY
[Symbol]	BICYCLE RACK MODEL # 509-3002; 7 BIKE WAVE BIKE RACK AS AVAILABLE FROM THE PARK GATALOG; STAINLESS STEEL; 1-1/2" OUTER DIAMETER; 304 STAINLESS STEEL; SURFACE MOUNT *	7 RACKS

\*INSTALLATION NOTE: PLACE EACH MOUNTING PLACE ON A FLUSH CONCRETE FILLED SONOTUBE FOOTER. BOLT BIKE RACK TO CONCRETE

**REVISIONS:**

REV.	DATE	DESCRIPTION
1	11/16/21	ADDITIONAL NOTES ADDED
2	1/22/21	REV. 2 REVISIONS ADDED
3	2/02/22	REV. 3 TRC COMMENT REVISIONS

**CLIENT INFORMATION:**  
 FOOD BANK OF CENTRAL & EASTERN NORTH CAROLINA  
 1924 CAPITAL BLVD.  
 RALEIGH, NC 27604

**PARAMOUNT ENGINEERING, INC.**  
 122 Cinema Drive  
 Wilmington, North Carolina 28403  
 (910) 791-6707 (O) (910) 791-6766 (F)  
 NC License #: C-2546


**SITE PLAN**  
 THE WILMINGTON FOOD BANK  
 GREENFIELD STREET  
 WILMINGTON, NORTH CAROLINA

**PROJECT STATUS**  
 CONCEPTUAL LAYOUT: \_\_\_\_\_  
 FINAL DESIGN LAYOUT: \_\_\_\_\_  
 RELEASED FOR CONSTRUCTION: \_\_\_\_\_  
**DRAWING INFORMATION**  
 DATE: 10/13/21  
 SCALE: 1" = 30'  
 DRAWING: \_\_\_\_\_  
 CHECKED: \_\_\_\_\_

Professional Seal redacted on electronic copy per City of Wilmington Policy

**C-2.0**  
 PEI JOB #: 20484.PE

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

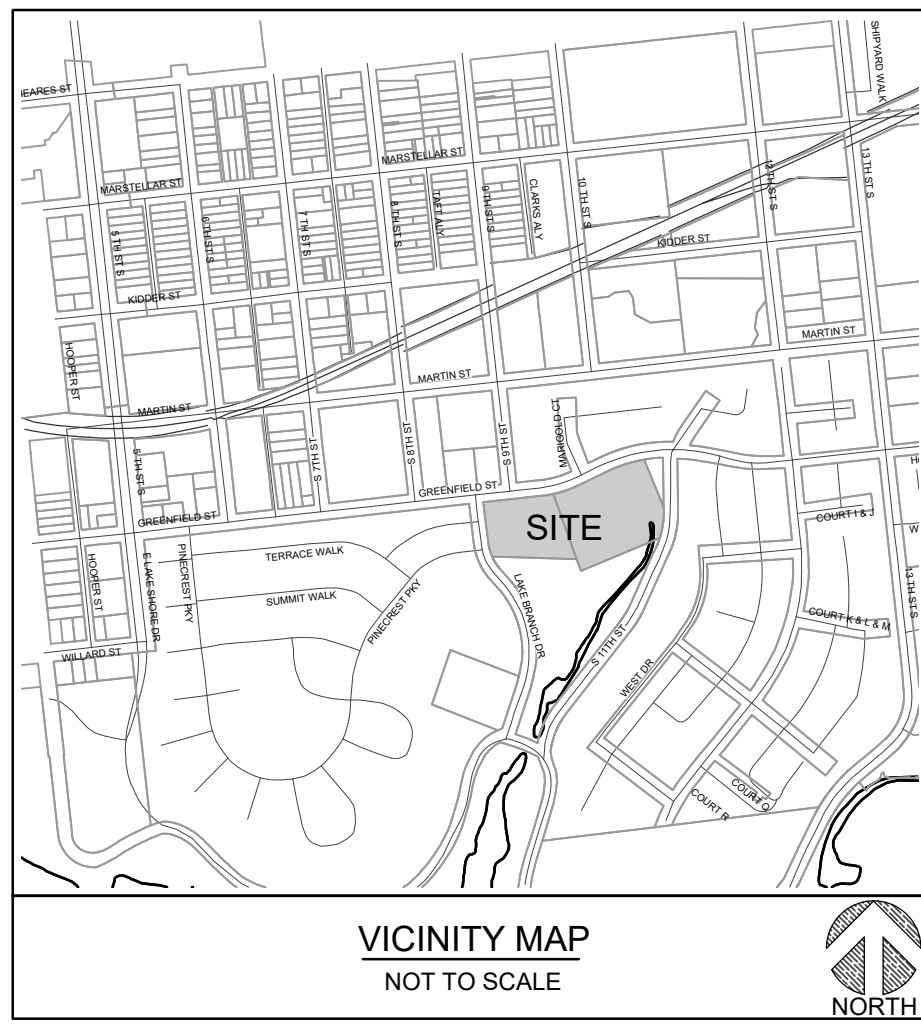


**PHASE I EROSION CONTROL NOTES:**

- 1) SITE CONTRACTOR TO FOLLOW TYPICAL SEQUENCE OF EROSION CONTROL MEASURES ON GENERAL NOTES, SHEET C-1.0
- 2) THE PONDS WILL BE USED AS SEDIMENT STORAGE DEVICES WITH DIVERSION DITCHES CARRYING THE MAJORITY OF CLEARING DRAINAGE TO THE SEDIMENT BASINS. AS PHASE 2 IS CONSTRUCTED, STORM DRAIN AND GRADING WILL REDIRECT DRAINAGE AS NECESSARY. SILT FENCE SHALL REMAIN IN-PLACE DURING PHASE I AND II CONSTRUCTION ACTIVITIES.
- 3) PHASE II EROSION CONTROL CAN BE FOUND ON THE FINAL GRADING AND DRAINAGE SHEETS, C-4.0-4.2.

**LEGEND**

EXISTING CONTOUR	---
PROPOSED CONTOUR	—
LIMITS OF DISTURBANCE	— LOD
PROPERTY BOUNDARY	—
WETLANDS	WET
CONSTRUCTION ENTRANCE	[Pattern]
RIP RAP APRON	[Pattern]
SANITARY SEWER	SS
TEMPORARY DIVERSION DITCH	>>
WATTLE OR CHECK DAM	—
DRAINAGE AREA	—
SILT FENCE	—

VICINITY MAP  
NOT TO SCALE

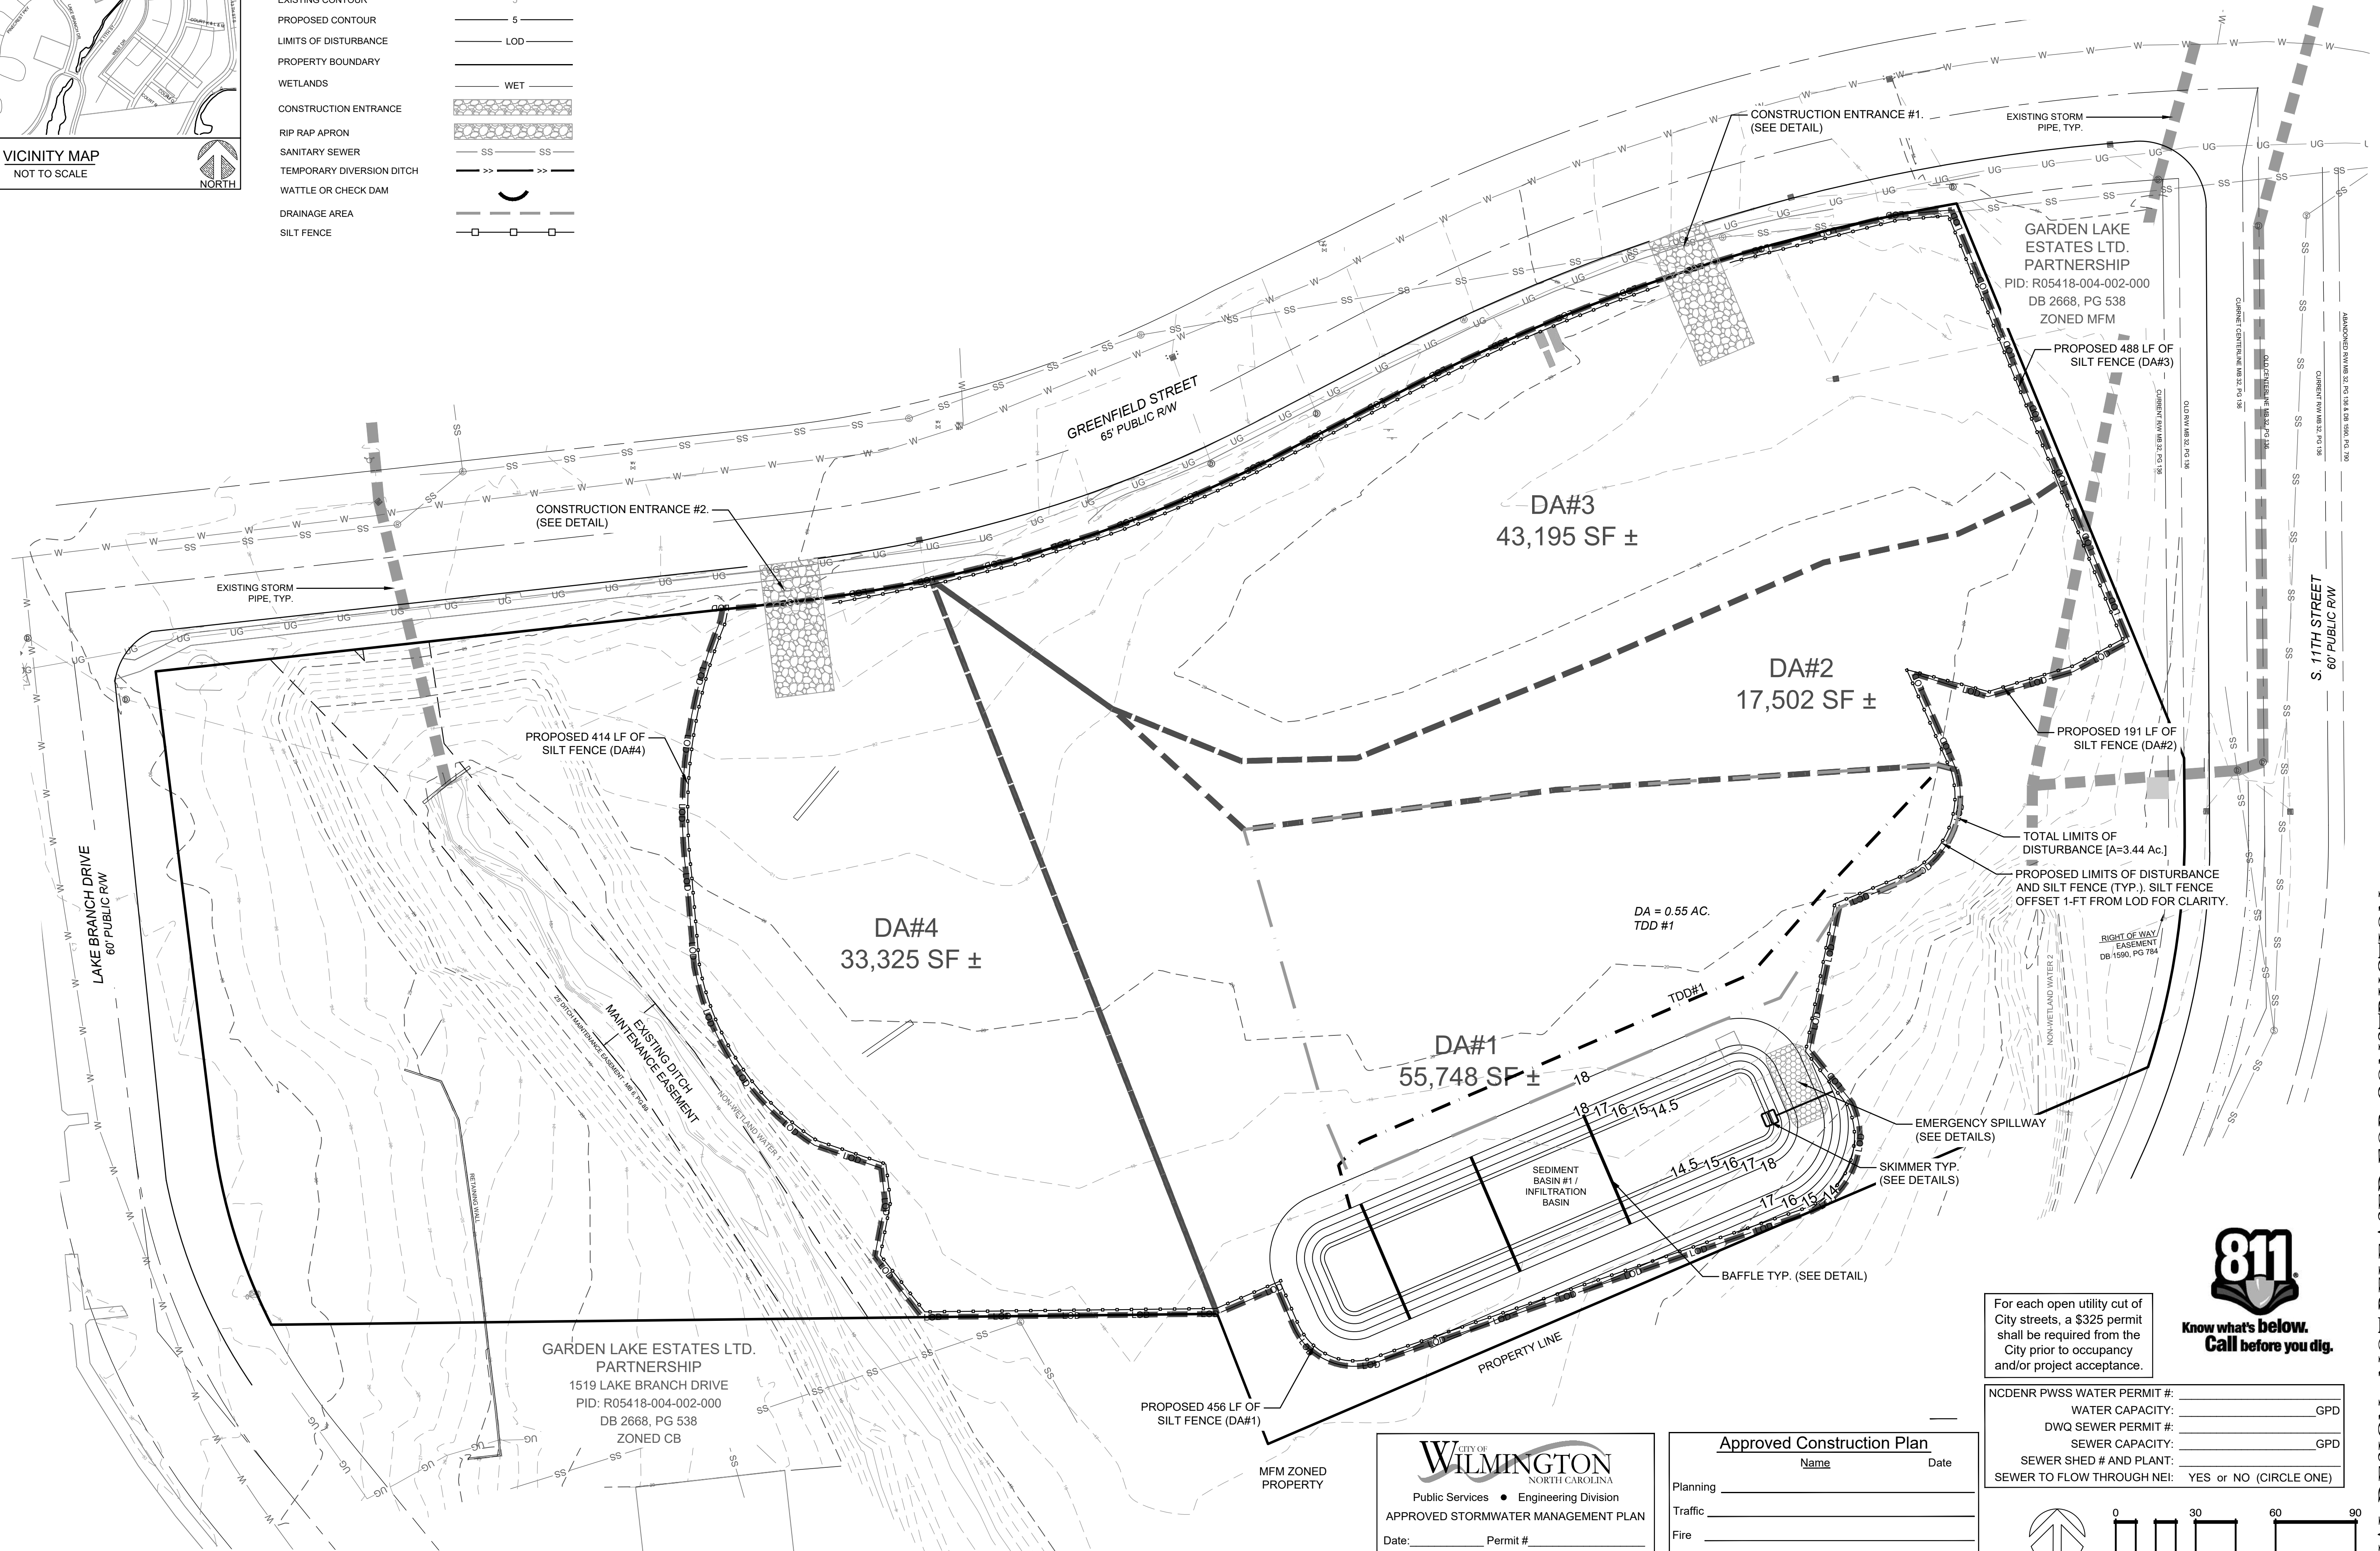

GARDEN LAKE ESTATES LTD.  
PARTNERSHIP  
1519 LAKE BRANCH DRIVE  
PID: R05418-004-002-000  
DB 2668, PG 538  
ZONED CB

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.




NCDNR PWSS WATER PERMIT #:	_____
WATER CAPACITY:	_____ GPD
DWQ SEWER PERMIT #:	_____
SEWER CAPACITY:	_____ GPD
SEWER SHED # AND PLANT:	_____
SEWER TO FLOW THROUGH NEI:	YES or NO (CIRCLE ONE)

**CITY OF WILMINGTON**  
NORTH CAROLINA  
Public Services • Engineering Division  
APPROVED STORMWATER MANAGEMENT PLAN  
Date: \_\_\_\_\_ Permit # \_\_\_\_\_  
Signed: \_\_\_\_\_

**Approved Construction Plan**

Name	Date
Planning	_____
Traffic	_____
Fire	_____

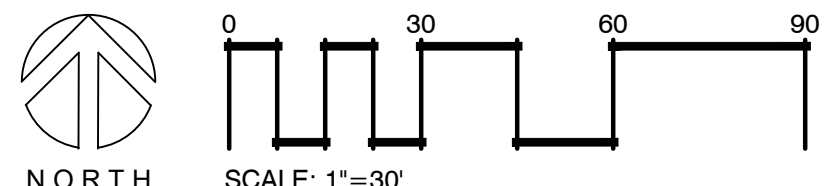

**REVISIONS:**


**PARAMOUNTE**  
ENGINEERING INC.  
122 Cinema Drive  
Wilmington, North Carolina 28403  
(910) 791-6707 (O) (910) 791-6760 (F)  
N.C. License #: C-2846


**EROSION CONTROL PLAN**  
PHASE 1  
THE WILMINGTON FOOD BANK  
GREENFIELD STREET  
WILMINGTON, NORTH CAROLINA

**PROJECT STATUS**  
DESIGN: \_\_\_\_\_  
DRAWING INFORMATION  
DATE: 10/2/21  
SCALE: 1"=30'  
DRAWN: GIB  
CHECKED: GIB

Professional Seal  
redacted on  
electronic copy  
per City of  
Wilmington Policy

**C-3.0**  
PEI JOB#: 20484.PE

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

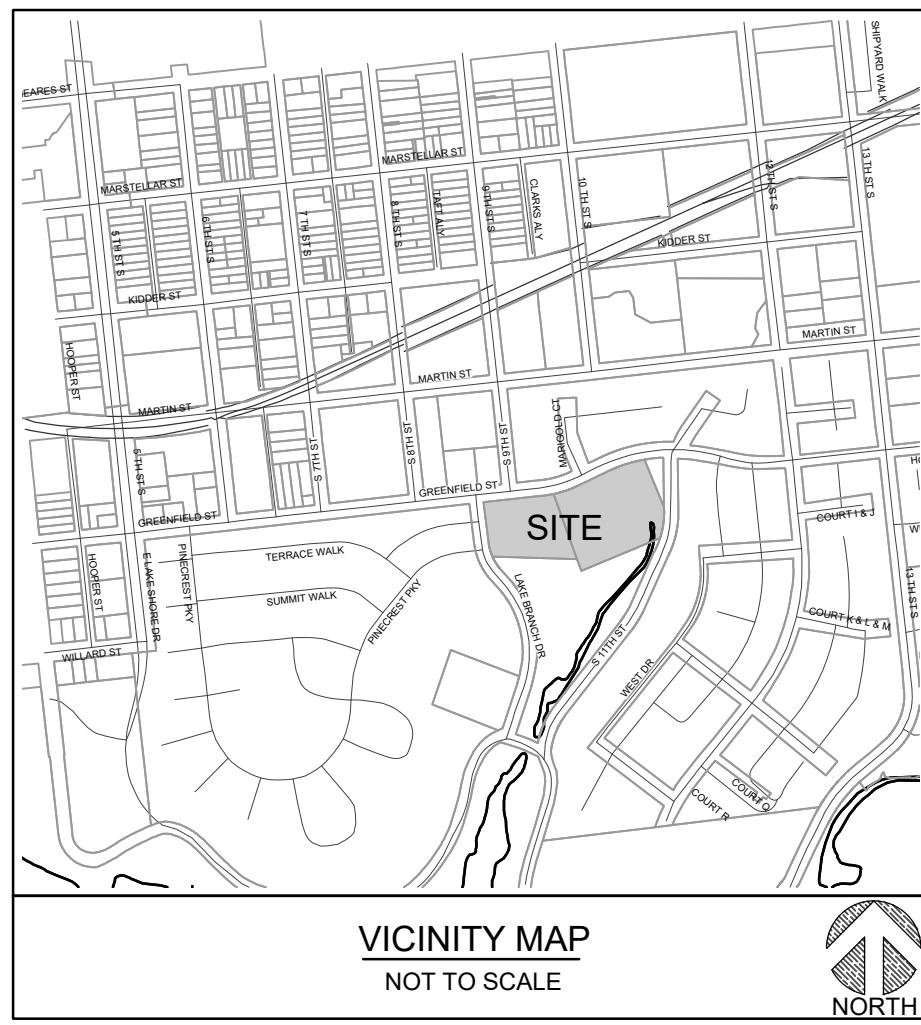

**LEGEND:**

INLET PROTECTION PROVIDED FOR ALL PROPOSED CATCH BASIN AND DROP INLETS (SEE DETAILS)

**SPOT GRADE LEGEND:**

CB = CATCH BASIN  
 DCB = DOUBLE CATCH BASIN  
 DI = DROP INLET  
 DDI = DOUBLE DROP INLET  
 YI = YARD INLET  
 MH = STORM MANHOLE  
 TC = TOP OF CURB ELEVATION  
 GC = GUTTER CURB (FLOW LINE) ELEVATION  
 PG = PROPOSED GRADE (GROUND)  
 EP = EDGE OF PAVEMENT  
 EC = EDGE OF CONCRETE  
 HP = HIGH POINT ELEVATION  
 LP = LOW POINT ELEVATION  
 TW = TOP OF WALK (SIDEWALK) ELEVATION  
 DG = DITCH GRADE ELEVATION  
 CL = CENTERLINE  
 INV = INVERT  
 FES = FLARED END SECTION  
 TWL = TOP OF WALL ELEVATION  
 BWL = BOTTOM OF WALL ELEVATION  
 (EQ) = EXISTING GRADE  
 (XX) = EXISTING ELEVATIONS, TYP.

**STORM DRAINAGE SCHEDULE:**

Upstream Node	Downstream Node	Diameter (in)	Upstream Invert	Downstream Invert	Pipe Length (ft)	Slope (%)	Upstream Rim Elev.	Downstream Rim Elev.	Pipe Material
MH-101	FES-100	36	14.59	14.50	29.74	0.30	18.50	14.50	RCP III
MH-102	MH-101	24	14.81	14.59	74.26	0.30	18.28	18.50	RCP III
CB-103	MH-102	18	14.97	14.81	51.02	0.31	17.82	18.28	RCP IV
CB-104	CB-103	15	15.14	14.97	55.44	0.30	17.78	17.82	RCP IV
CB-105	MH-102	24	15.11	14.81	99.07	0.30	20.22	18.28	RCP III
CB-106	CB-105	18	15.32	15.11	68.65	0.31	20.42	20.22	RCP III
CB-107	CB-106	18	15.39	15.32	22.44	0.31	21.35	20.42	RCP III
CB-108	CB-107	15	15.46	15.39	24.34	0.29	19.82	21.35	RCP III
CB-109	CB-105	15	16.15	15.11	104.27	1.00	20.72	20.22	RCP III
DI-110	CB-109	15	16.26	16.15	38.32	0.30	21.00	20.72	RCP III
DI-111	CB-110	15	16.68	16.26	139.29	0.30	19.50	21.00	RCP III
MH-120	MH-101	24	15.07	14.59	160.25	0.30	18.41	18.50	RCP III
CB-121	MH-120	24	15.12	15.07	17.02	0.29	18.64	18.41	RCP III
CB-122	CB-121	24	15.25	15.12	43.40	0.30	18.86	18.64	RCP III
CB-123	CB-122	15	15.51	15.25	85.36	0.30	20.21	18.86	RCP III
DI-124	CB-123	15	15.54	15.51	10.63	0.30	20.42	20.21	RCP III
CB-125	CB-122	18	15.43	15.25	59.86	0.30	18.89	18.86	RCP III
CB-126	CB-125	18	15.56	15.43	43.96	0.30	18.01	18.89	RCP IV
CB-127	CB-126	18	15.65	15.56	28.74	0.31	18.15	18.01	RCP IV
CB-128	CB-127	18	15.83	15.65	60.41	0.30	18.36	18.15	RCP IV
CB-129	CB-128	18	15.99	15.83	54.18	0.30	18.42	18.36	RCP IV
CB-130	CB-128	15	16.07	15.83	78.69	0.30	19.23	18.36	RCP IV
TRENCH	MH-101	8	14.68	14.59	31.00	0.30	17.00	18.50	HDPE

**STORM STRUCTURE NOTES:**

- 1) ALL STRUCTURES DISCHARGING TO THE UNDERGROUND INFILTRATION SYSTEM SHALL BE CONSTRUCTED WITH A 24" MINIMUM SUMP AND GALVANIZED HARDWARE CLOTH PER DETAIL.

**GRADING NOTES:**

- 1) SITE CONTRACTOR SHALL STRIP TOPSOIL AND ANY UNSUITABLE MATERIAL AND PROVIDE STOCKPILE LOCATIONS ON SITE IF NOT SPECIFIED. SEE GENERAL NOTES SHEET (C-1.0, TYP.) FOR GRADING, DRAINAGE, AND EROSION CONTROL SEQUENCE NOTES AND REQUIREMENTS. IN ADDITION, REFERENCE TECHNICAL SPECIFICATIONS AND DETAIL SHEETS FOR MORE INFORMATION.
- 2) SEE GRADING AND DRAINAGE PLANS FOR FINISH GRADES AND STORM PIPE SCHEDULE.
- 3) A GEOTECHNICAL ENGINEER OR INSPECTORS SHALL BE CONSULTED TO CONFIRM SUITABILITY OF SUBGRADE MATERIAL AND PROPER COMPACTION PER EARTHWORK SPECIFICATIONS IN FILL AREAS.

**ASPHALT AREA NOTE:**

- 1) SITE CONTRACTOR SHALL STRIP TOPSOIL AND ANY UNSUITABLE MATERIAL AND PROVIDE CUT/FILL OPERATIONS TO PROVIDE A COMPACTED CONTROLLED SUBGRADE, IN ACCORDANCE WITH THE SUBSURFACE GEOTECHNICAL EXPLORATION AND/OR TECHNICAL SPECIFICATIONS.

**BUILDING PAD NOTE:**

- 1) SITE CONTRACTOR SHALL STRIP TOPSOIL AND ANY UNSUITABLE MATERIAL AND PROVIDE CUT/FILL OPERATIONS TO PROVIDE A COMPACTED CONTROLLED BUILDING PAD, IN ACCORDANCE WITH THE SUBSURFACE GEOTECHNICAL EXPLORATION AND/OR TECHNICAL SPECIFICATIONS.

**DRAINAGE NOTES:**


- 1) DRAINAGE EASEMENTS AND THE STORM DRAINAGE INSIDE THE EASEMENT IS THE RESPONSIBILITY OF THE CITY OF WILMINGTON AS DESCRIBED UPON THE FINAL PLAT AND THESE DRAWINGS.
- 2) ALL IMPERVIOUS MUST DRAIN TO THE DESIGNED STORMWATER SYSTEM UNLESS THE APPROVED PLANS SHOW OTHERWISE.
- 3) NO OBSTRUCTIONS ARE ALLOWED IN DRAINAGE EASEMENTS, INCLUDING FENCES.
- 4) ALL PUBLIC STORM DRAINAGE STRUCTURES SHALL MEET NCDOT STANDARDS AND SPECIFICATIONS AND SHALL BE TRAFFIC RATED FOR H-20 LOADS AT A MINIMUM. PRIVATE DRAINAGE SYSTEMS SHALL BE PER APPROVED PLANS AND SPECIFICATIONS.
- 5) ALL CURB INLET (CI) RIM ELEVATIONS ARE LISTED AS THE "GUTTER OF FLOWLINE ELEVATION" WITHIN THE CURB SECTION. THE CURB INLET RIM ELEVATION SHALL BE 2 INCHES BELOW EDGE OF PAVEMENT (EOP) PER NCDOT DETAILS. FOR DROP INLETS, THE RIM ELEVATION IS LISTED AS THE CENTER OF GRATE FOR DROP INLETS. THE CONTRACTOR SHALL MAINTAIN A UNIFORM EDGE OF PAVEMENT (EOP) WHEN PLACING THE STORM INLETS WITHIN THE CURB-LINE.
- 6) MANHOLE RIM ELEVATION SHOWN ABOVE IS FLUSH WITH PROPOSED GRADE. CONTRACTOR SHALL PROVIDE 3'-6" CLEARANCE ABOVE PROPOSED GRADE WHEN PLACED IN A GRASS/PERVIOUS AREA; AND A FLUSH CONDITION WITH PROPOSED PAVEMENT OR IMPERVIOUS COVER.
- 7) PROPOSED BUILDINGS SHALL DIVERT ROOF DRAINAGE TO STORMWATER CISTERN SYSTEM OR DIVERTED INTO THE STORMWATER COLLECTION SYSTEM AS SHOWN. SEE CIVIL OR ARCHITECTURAL DETAILS FOR DOWNSPOUT DETAILS AND CONNECTIONS.
- 8) CONTRACTOR SHALL ADJUST ALL FRAMES OF EX. UTILITY INFRASTRUCTURE WITHIN ASPHALT OVERLAY AREAS TO MATCH PROPOSED GRADES.
- 9) THE CONTRACTOR SHALL USE STORM PIPE PER THE SPECIFICATIONS (TYPICALLY CONCRETE OR HDPE PIPE). EITHER WAY THE CONTRACTOR SHALL FOLLOW THE TRENCH DETAILS AND SPECIFICATIONS, AND THE PIPE MANUFACTURER SPECIFICATIONS.

**AS-BUILT STORMWATER NOTE [15A NCAC 02H.1044]:**

- 1) THE CONTRACTOR WILL EMPLOY A LAND SURVEYOR LICENSED IN THE STATE OF NORTH CAROLINA TO PROVIDE ACCURATE REPRODUCIBLE AS-BUILT DRAWINGS OF THE WET DETENTION BASIN, COLLECTION SYSTEM, AND IMPERVIOUS AREA ON THE SITE TO THE ENGINEER & OWNER UPON COMPLETION OF CONSTRUCTION. UPON CERTIFICATION BY THE ENGINEER AND VERIFICATION FROM THE OWNER ANY DISCREPANCIES WILL BE INDICATED, THEN THESE PLANS SHALL BE RETURNED TO THE CONTRACTOR FOR CORRECTION PRIOR TO FINAL PAYMENT AND FINAL INSPECTION.

**GENERAL NOTES:**

- 1) INSTALL REFLECTORS PER CITY AND NCDOT STANDARDS. TRAFFIC ENGINEERING MUST APPROVE OF PAVEMENT MARKING LAYOUT PRIOR TO ACTUAL STRIPING.
- 2) IT SHALL BE THE RESPONSIBILITY OF THE SUBDIVIDER TO ERECT OFFICIAL STREET NAME SIGNS AT ALL INTERSECTIONS ASSOCIATED WITH THE SUBDIVISION IN ACCORDANCE WITH THE TECHNICAL STANDARDS AND SPECIFICATIONS MANUAL. THE SUBDIVIDER MAY ACQUIRE AND ERECT OFFICIAL STREET NAME SIGNS OR MAY CHOOSE TO CONTRACT WITH THE CITY TO INSTALL THE STREET SIGNS AND THE SUBDIVIDER SHALL PAY THE TRAFFIC AND STREET NAME SIGNS. PROPOSED STREET NAMES MUST BE APPROVED PRIOR TO INSTALLATION OF STREET NAME SIGNS.
- 3) ALL SIGNS AND PAVEMENT MARKINGS IN AREAS OPEN TO PUBLIC TRAFFIC ARE TO MEET MUTCD (MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES) STANDARDS.
- 4) CONTACT TRAFFIC ENGINEERING FORTY-EIGHT HOURS PRIOR TO ANY EXCAVATION IN THE RIGHT-OF-WAY. 910-341-3258

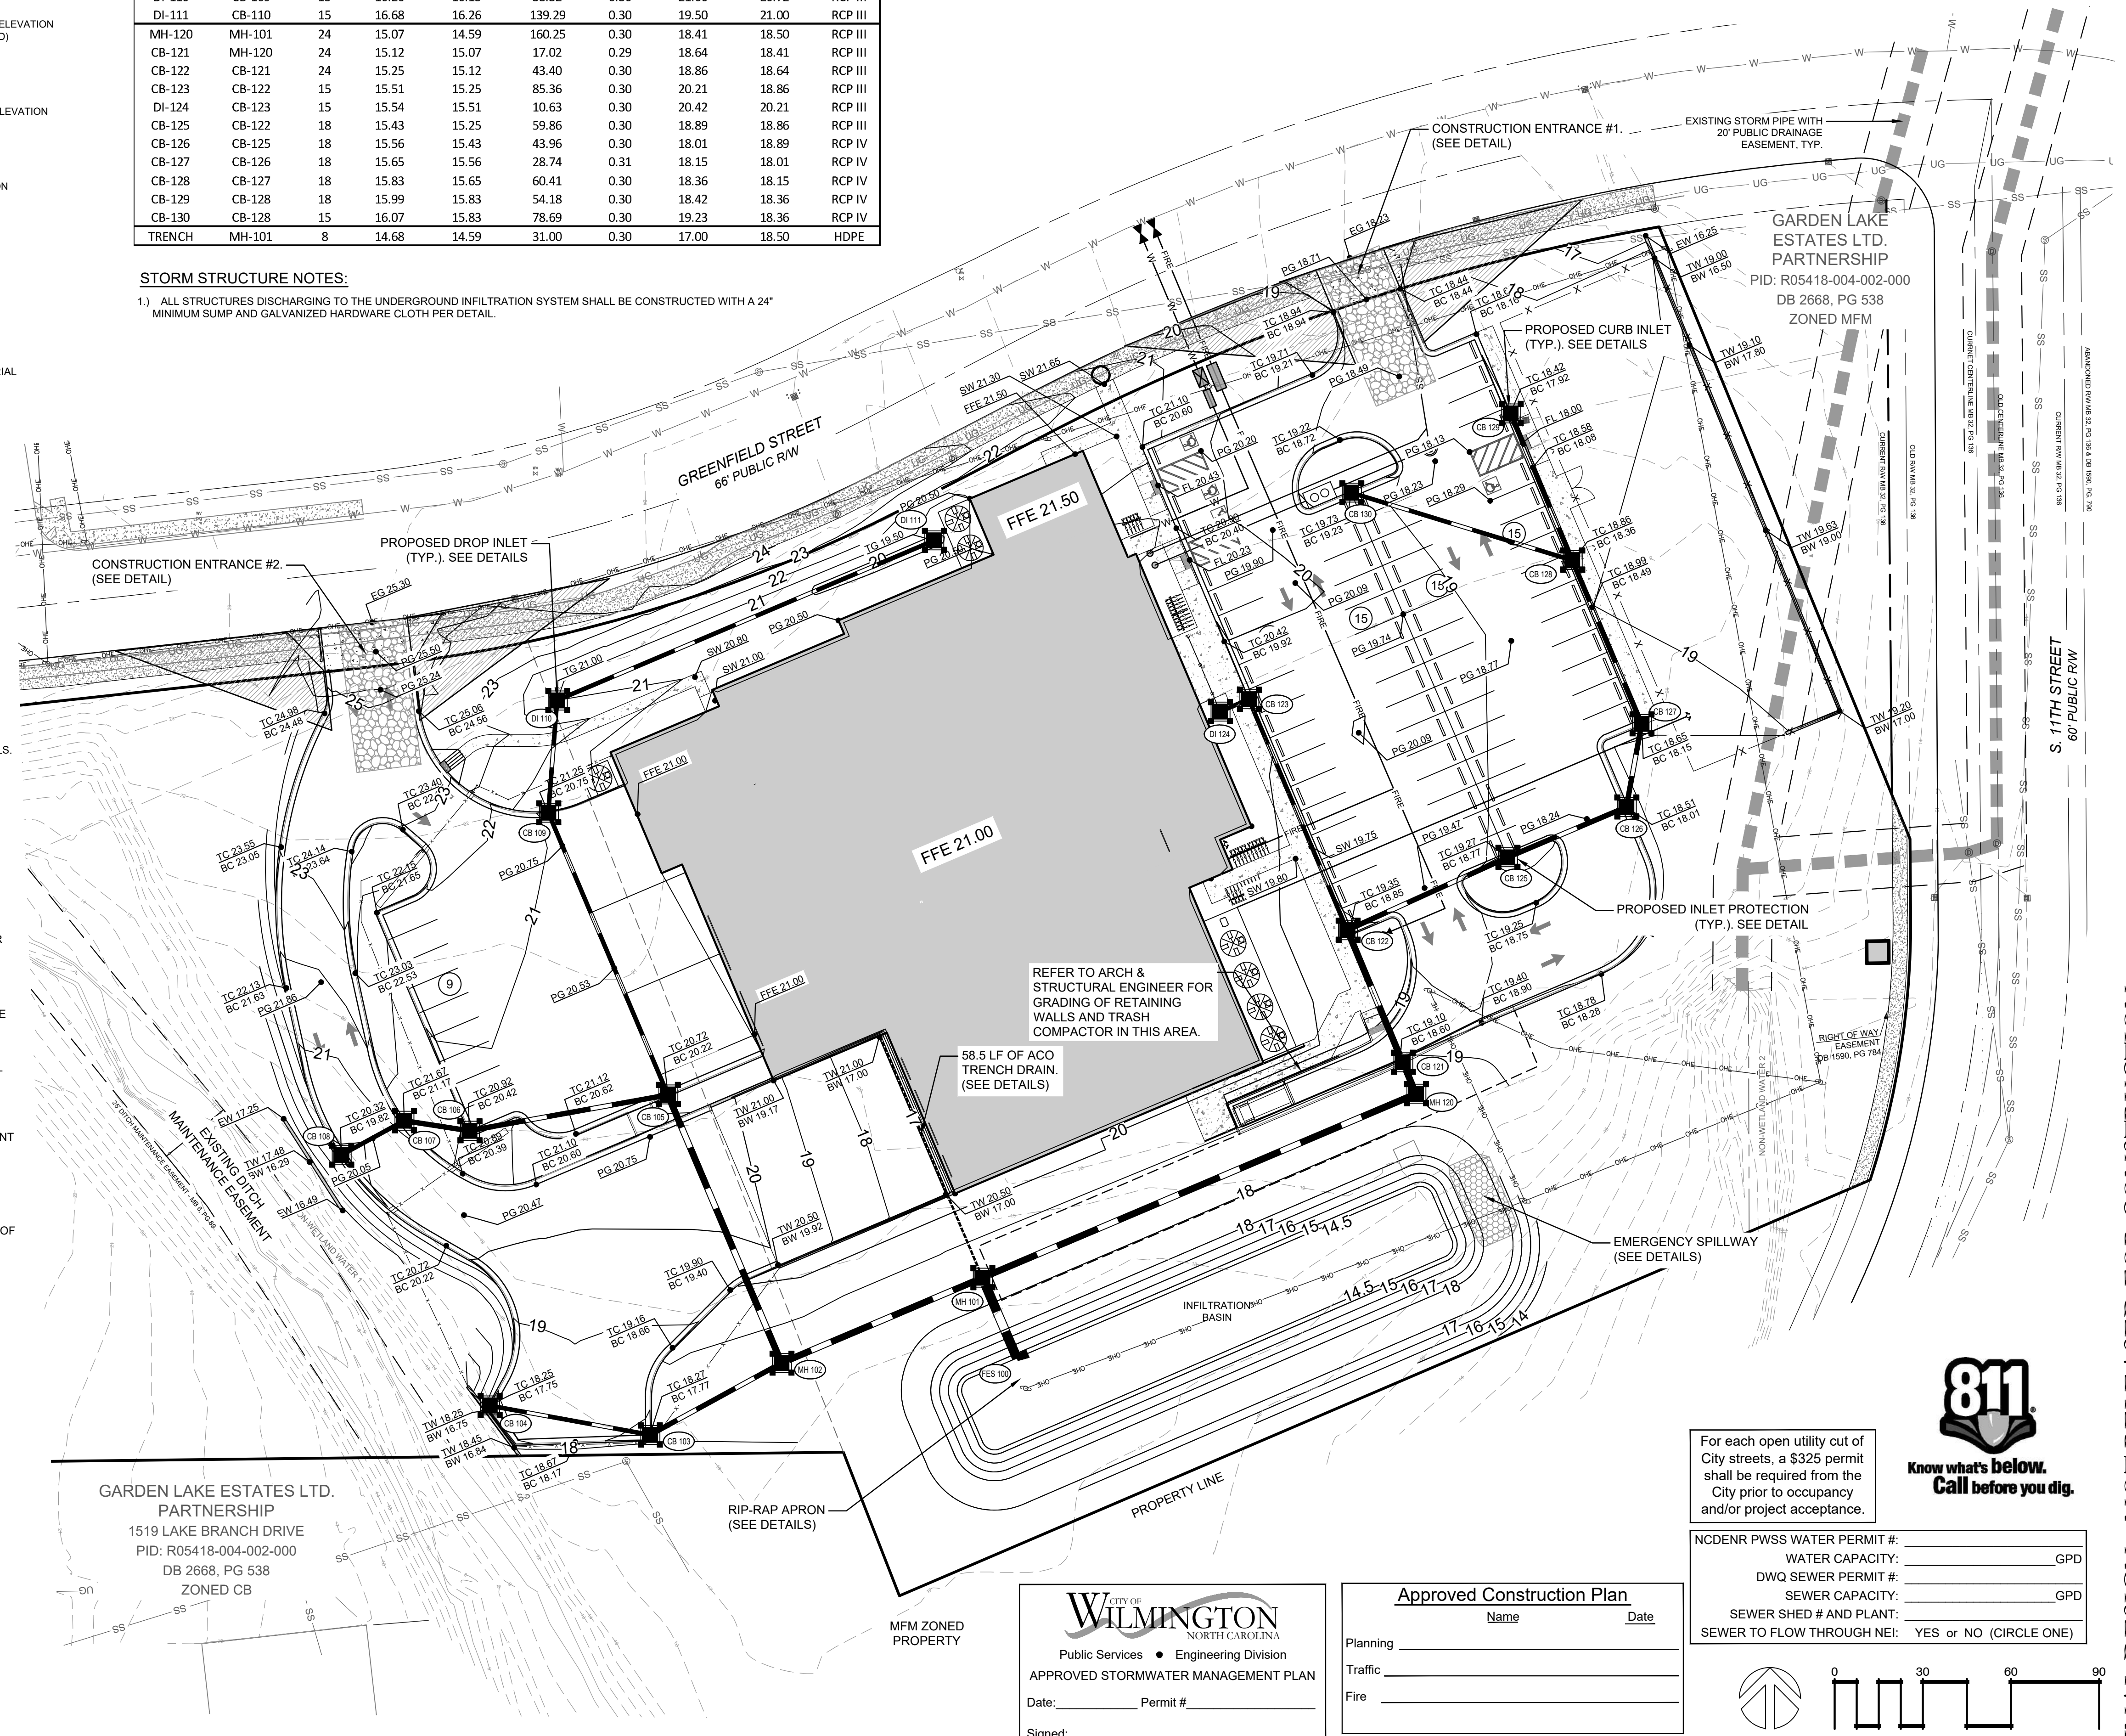

GARDEN LAKE ESTATES LTD. PARTNERSHIP  
 1519 LAKE BRANCH DRIVE  
 PID: R05418-004-002-000  
 DB 2668, PG 538  
 ZONED CB

**CITY OF WILMINGTON**  
 NORTH CAROLINA  
 Public Services • Engineering Division  
 APPROVED STORMWATER MANAGEMENT PLAN  
 Date: \_\_\_\_\_ Permit # \_\_\_\_\_  
 Signed: \_\_\_\_\_


**Approved Construction Plan**

Name	Date
Planning _____	_____
Traffic _____	_____
Fire _____	_____

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.

811 Know what's below. Call before you dig.

NCDNR PWSS WATER PERMIT #: \_\_\_\_\_  
 WATER CAPACITY: \_\_\_\_\_ GPD  
 DWQ SEWER PERMIT #: \_\_\_\_\_  
 SEWER CAPACITY: \_\_\_\_\_ GPD  
 SEWER SHED # AND PLANT: \_\_\_\_\_  
 SEWER TO FLOW THROUGH NEI: YES or NO (CIRCLE ONE)

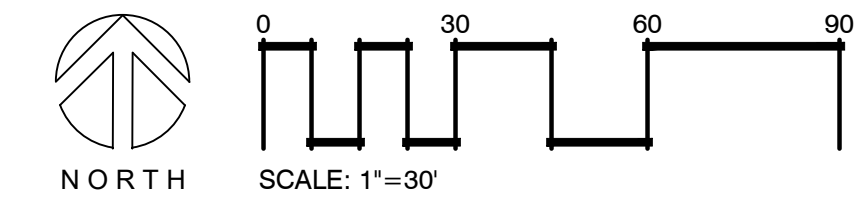

**REVISIONS:**

REV. 1	ADDITIONAL NOTES ADDED	11/18/21
REV. 2	RFI INFORMATION UPDATES	1/22/21
REV. 3	ADDED DI 111	1/26/22

**CLIENT INFORMATION:**  
 FOOD BANK OF CENTRAL & EASTERN NORTH CAROLINA  
 1924 CAPITAL BLVD.  
 RALEIGH, NC 27604

**PARAMOUNT ENGINEERING, INC.**  
 122 Cinema Drive  
 Wilmington, North Carolina 28403  
 (910) 791-6707 (O) (910) 791-6700 (F)  
 NC License #: C-2846

**GRADING & DRAINAGE - EC PHASE 2**  
 THE WILMINGTON FOOD BANK  
 GREENFIELD STREET  
 WILMINGTON, NORTH CAROLINA


**PROJECT STATUS:**  
 ORIGINAL LAYOUT: \_\_\_\_\_  
 FINAL DESIGN LAYOUT: \_\_\_\_\_  
 RELEASED FOR CONSTRUCTION: \_\_\_\_\_

**DRAWING INFORMATION:**  
 DATE: 1/26/22  
 SCALE: 1"=30'  
 DRAWING: GIB  
 CHECKED: \_\_\_\_\_

Professional Seal redacted on electronic copy per City of Wilmington Policy

**C-4.0**  
 PEI JOB#: 20484.PE

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

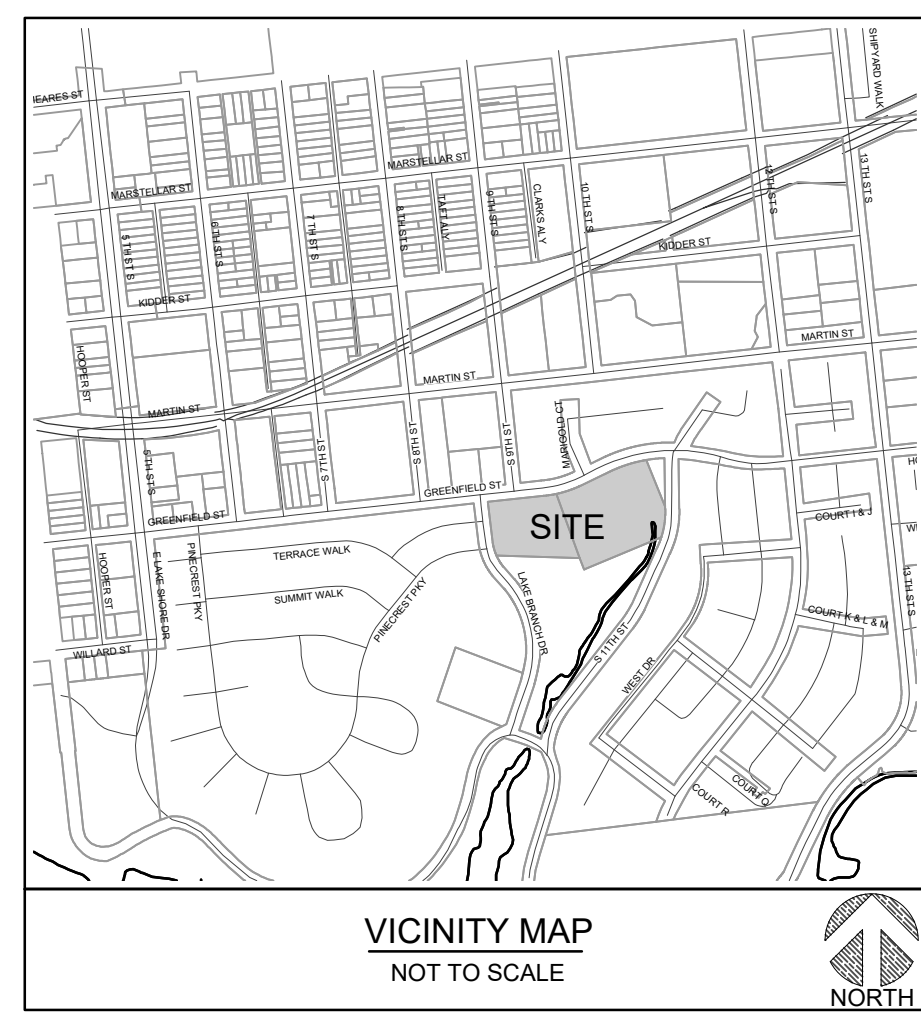

**UTILITY NOTES: (NCAC 15A.02T.0305 / T15A.18C.0906)**

1. WATER MAINS SHALL BE LAID SO AS TO PROVIDE A MINIMUM HORIZONTAL SEPARATION OF 10 FEET FROM SEWERS. IF CONDITIONS EXIST SUCH THAT THIS SEPARATION CANNOT BE ACHIEVED, THE WATER MAIN CAN BE INSTALLED AT LEAST 18 INCHES ABOVE THE TOP OF THE SEWER, EITHER IN A SEPARATE TRENCH, OR IN THE SAME TRENCH ON A BENCH OF UNDISTURBED EARTH.
2. WHEN CROSSING A WATER MAIN OVER A SEWER, THE WATER MAIN SHALL BE LAID AT LEAST 18 INCHES ABOVE THE SEWER. IF CONDITIONS EXIST SUCH THAT THIS SEPARATION CANNOT BE ACHIEVED, BOTH THE WATER MAIN AND SEWER SHALL BE CONSTRUCTED OF DUCTILE IRON PIPE WITH JOINTS THAT MEET WATER MAIN STANDARDS. THE DUCTILE IRON PIPE SHALL EXTEND 10 FEET ON EACH SIDE OF THE CROSSING WITH A SECTION OF WATER MAIN PIPE CENTERED ON THE CROSSING.
3. CROSSING A WATER MAIN UNDER A SEWER, WHENEVER IT IS NECESSARY FOR A WATER MAIN TO CROSS UNDER A SEWER, BOTH THE WATER MAIN AND THE SEWER SHALL BE CONSTRUCTED OF FERROUS MATERIALS AND WITH JOINTS EQUIVALENT TO WATER MAIN STANDARDS FOR A DISTANCE OF 10 FEET ON EACH SIDE OF THE POINT OF CROSSING. A SECTION OF WATER MAIN PIPE SHALL BE CENTERED AT THE POINT OF CROSSING.
4. WHERE VERTICAL CLEARANCE IS LESS THAN 24" BETWEEN SANITARY SEWER AND STORM DRAIN, SANITARY SEWER SHALL BE DUCTILE IRON PIPE FOR A MINIMUM OF 10' EITHER SIDE OF CROSSING AND STORM DRAIN SHALL BE RC PIPE.
5. WHERE VERTICAL CLEARANCE IS LESS THAN 18" BETWEEN WATER MAIN AND STORM DRAIN, WATER MAIN SHALL BE DUCTILE IRON PIPE FOR A MINIMUM OF 10' EITHER SIDE OF CROSSING AND STORM DRAIN SHALL BE RC PIPE.

**WATER & SEWER SERVICE NOTE:**


1. CONTRACTOR SHALL INSTALL WATER AND SEWER SERVICES IN ACCORDANCE WITH CFPUA STANDARD DETAILS AND SPECIFICATIONS.

**FIRE & LIFE SAFETY NOTES:**

1. NEW HYDRANTS MUST BE BROUGHT INTO SERVICE PRIOR TO COMBUSTIBLE MATERIALS DELIVERED TO THE JOB SITE AND PRIOR TO CONSTRUCTION OF THE BUILDINGS WITHIN THE DEVELOPMENT.
2. HYDRANTS MUST BE LOCATED WITHIN 8' OF THE CURB.
3. CONTRACTOR SHALL MAINTAIN AN ALL WEATHER ACCESS FOR EMERGENCY VEHICLES AT ALL TIMES DURING CONSTRUCTION
4. CONSTRUCTION TYPES ARE V-A AND V-B AND ALL MULTI-FAMILY BUILDINGS ARE SPRINKLED. EACH OF THE TOWNHOMES HAS A 13R SPRINKLER SYSTEM. THE CLUBHOUSE, LEASING CENTER, AND MAINTENANCE ARE NOT SPRINKLED.
5. LANDSCAPING OR PARKING CAN NOT BLOCK OR IMPEDE THE FDC OR FIRE HYDRANTS. A 3-FOOT (3') CLEAR SPACE SHALL BE MAINTAINED AROUND THE CIRCUMFERENCE OF HYDRANTS AND FDC.
6. HYDRANTS MUST BE WITHIN 150' OF THE FDC. THE FDC MUST BE WITHIN 40' OF THE FIRE APPARATUS PLACEMENT.
7. ADDITIONAL FIRE PROTECTION AND ACCESSIBILITY REQUIREMENTS MAY BE REQUIRED DUE TO ANY SPECIAL CIRCUMSTANCES CONCERNING THE PROJECT.
8. PRIVATE UNDERGROUND FIRE LINES REQUIRE A SEPARATE UNDERGROUND FIRE LINE PERMIT FROM THE WILMINGTON FIRE AND LIFE SAFETY DIVISION (910-343-0696).
9. ALL ISOLATION VALVES WITHIN THE "HOT BOX" SHALL BE ELECTRICALLY SUPERVISED. FIRE SPRINKLER AND ALARM CONTRACTORS/INSTALLERS SHALL COORDINATE TO RUN WIRING FOR TAMPER SWITCH.
10. ALL HYDRANTS TO BE INSTALLED PER CITY OF WILMINGTON ORDINANCES AND CFPUA STANDARDS.
11. CONTRACTOR SHALL SUBMIT A RADIO SIGNAL STRENGTH STUDY FOR ALL COMMERCIAL BUILDINGS THAT DEMONSTRATES THAT EXISTING EMERGENCY RESPONDER RADIO SIGNAL LEVELS MEET THE REQUIREMENTS OF SECTION 510 OF THE 2018 NC FIRE CODE.

**CAPE FEAR PUBLIC UTILITY AUTHORITY STANDARD SEWER NOTES:**

1. SEWER GUARDS REQUIRED AT ALL MANHOLES. STAINLESS STEEL SEWER GUARDS REQUIRED AT MANHOLES LOCATED IN TRAFFIC AREAS.
2. WATER AND SEWER SERVICES SHALL BE PERPENDICULAR TO MAIN AND TERMINATE AT R/W LINE. SEWER SERVICES IN CUL-DE-SACS ARE REQUIRED TO BE PERPENDICULAR, OR MUST ORIGINATE IN END OF LINE MANHOLE AND TERMINATE AT RIGHT-OF-WAY LINE.
3. ALL SERVICES TYING INTO DUCTILE IRON MAINS SHALL BE CONSTRUCTED OF CLASS 50, DIP, WITH PROTECTO 401 CERAMIC EPOXY LINING.
4. MINIMUM 10' UTILITIES EASEMENT PROVIDED ALONG THE FRONTAGE OF ALL LOTS AND AS SHOWN FOR NEW DEVELOPMENTS.
5. NO FLEXIBLE COUPLINGS SHALL BE USED.
6. ALL STAINLESS STEEL FASTENERS SHALL BE 316.
7. CLEANOUTS SHALL BE LOCATED A MINIMUM OF 12 FEET FROM ALL PROPERTY CORNERS. WATER METER BOXES ARE TO BE A MINIMUM OF 5 FEET FROM THE PROPERTY CORNER.

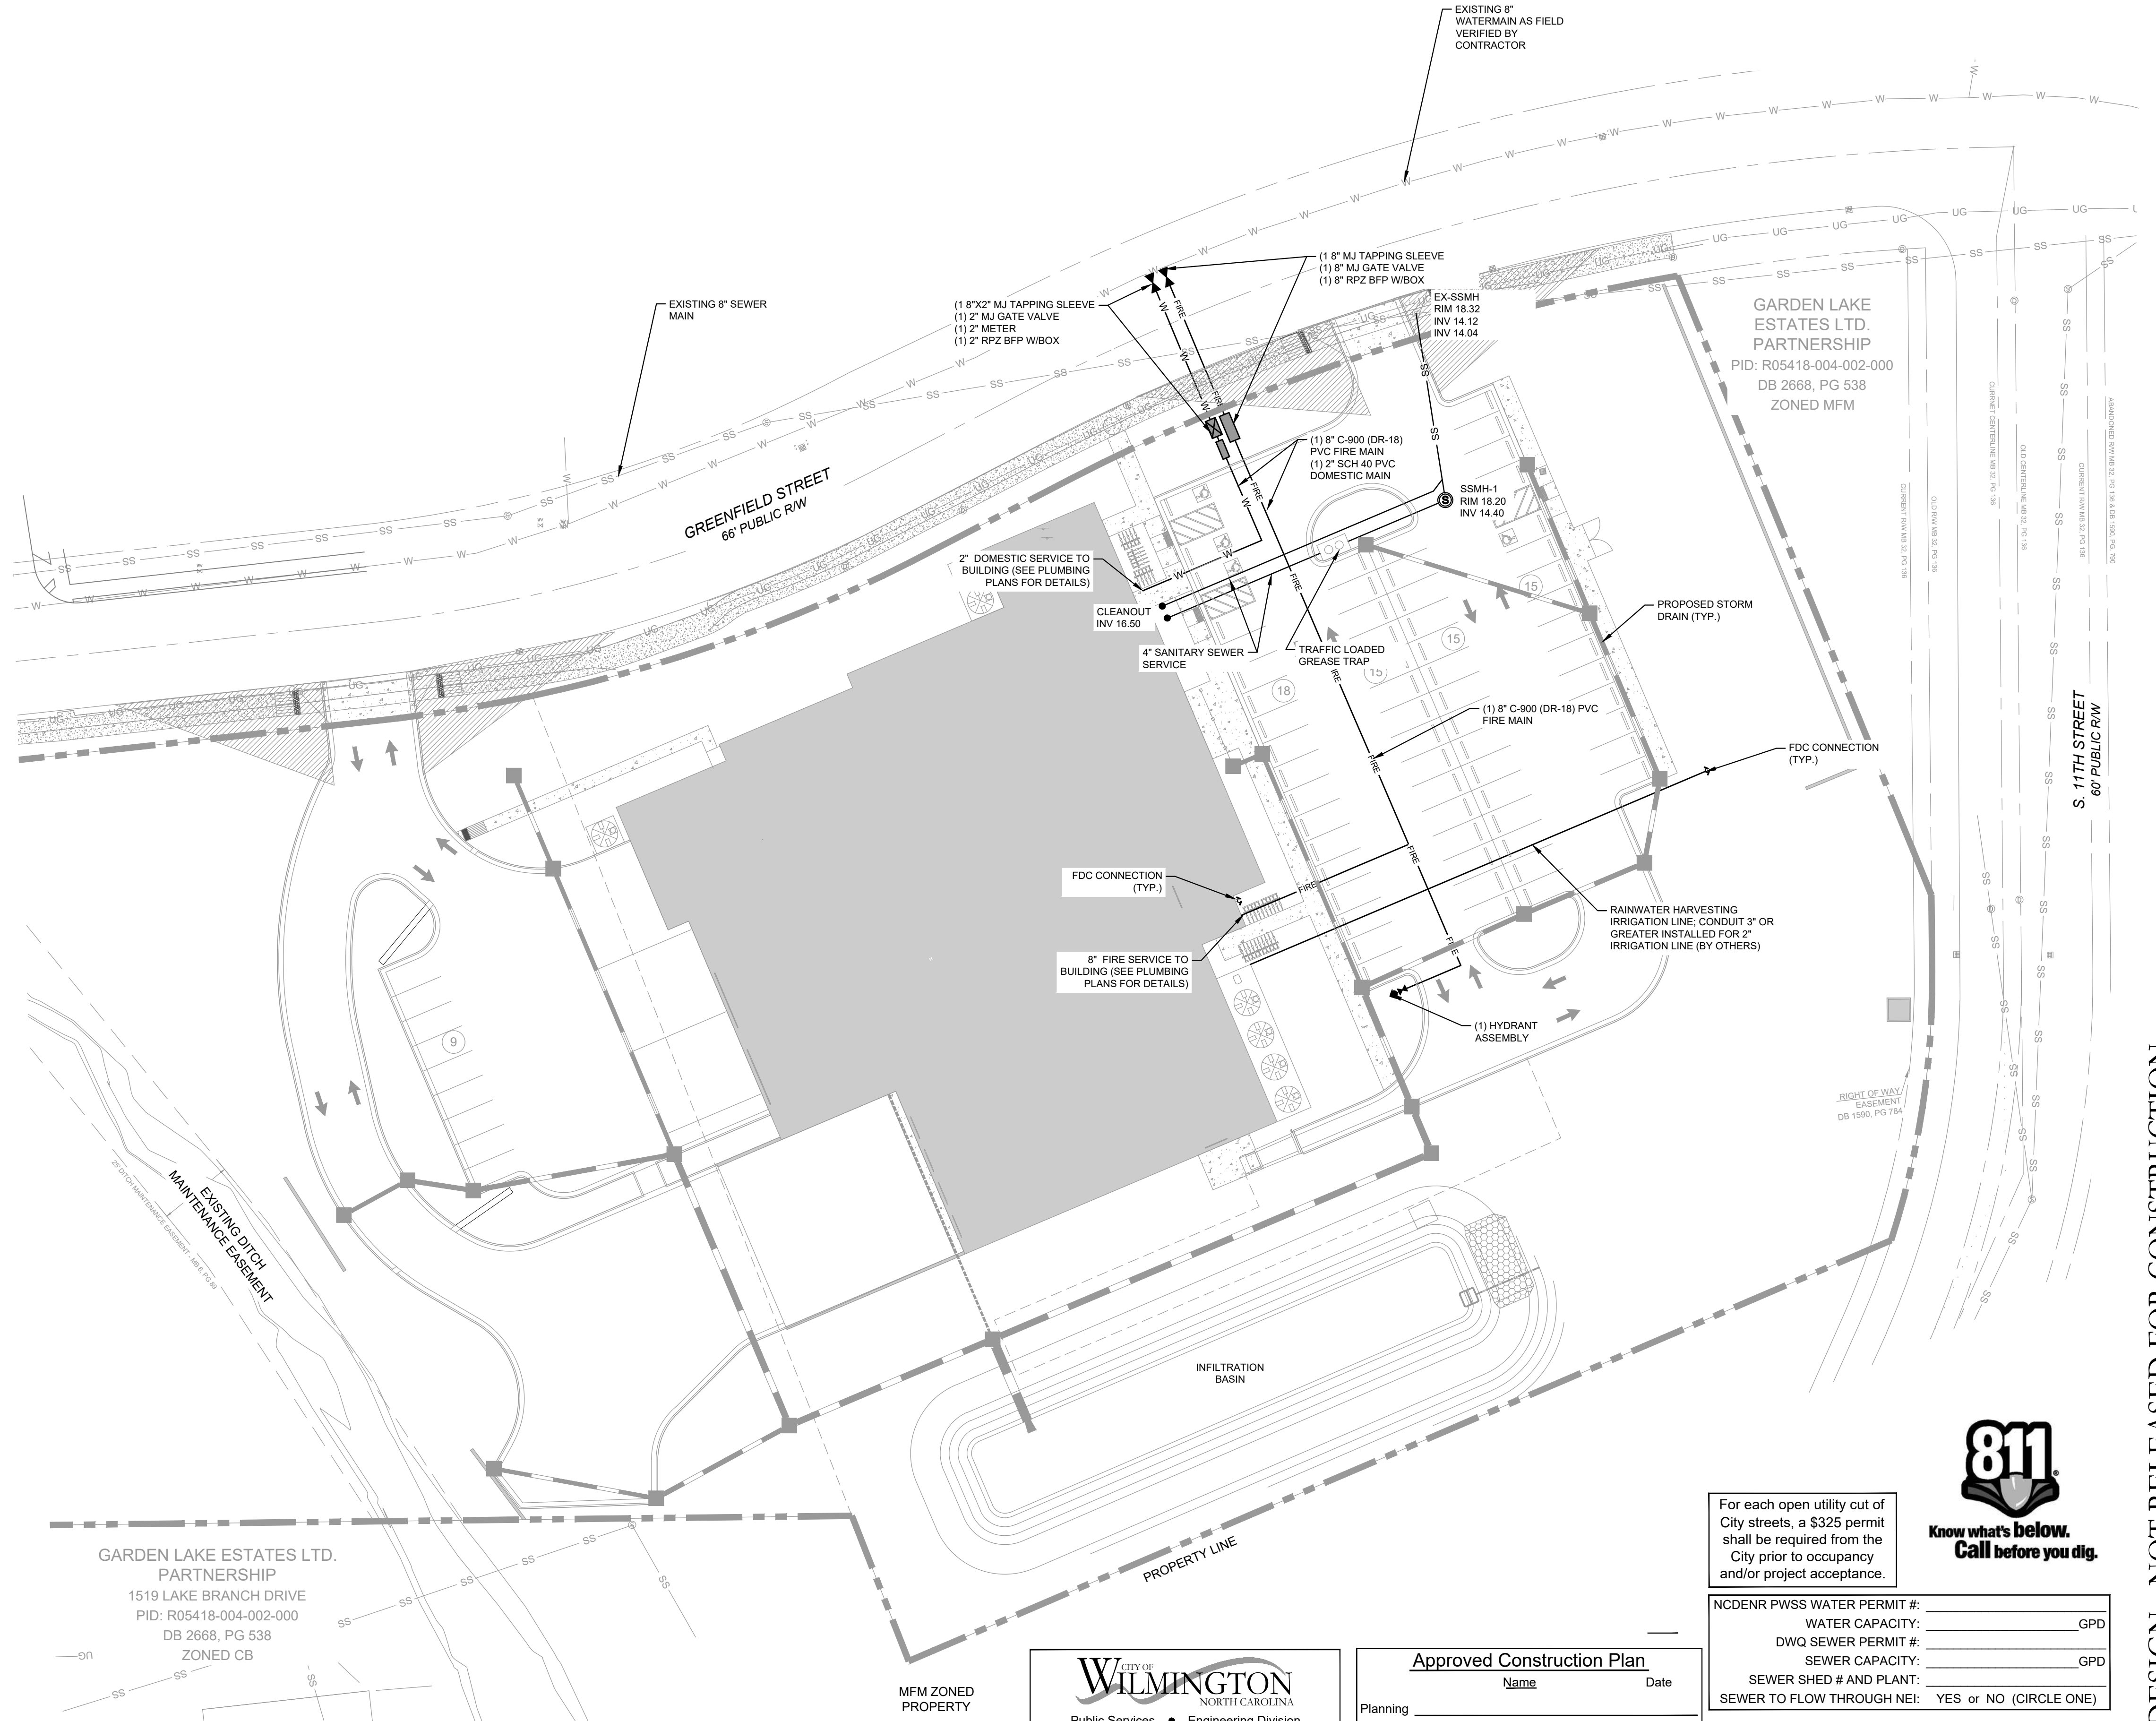

GARDEN LAKE ESTATES LTD.  
PARTNERSHIP  
1519 LAKE BRANCH DRIVE  
PID: R05418-004-002-000  
DB 2668, PG 538  
ZONED CB


**WILMINGTON**  
NORTH CAROLINA  
Public Services • Engineering Division  
APPROVED STORMWATER MANAGEMENT PLAN  
Date: \_\_\_\_\_ Permit # \_\_\_\_\_  
Signed: \_\_\_\_\_

**Approved Construction Plan**  
Name \_\_\_\_\_ Date \_\_\_\_\_  
Planning \_\_\_\_\_  
Traffic \_\_\_\_\_  
Fire \_\_\_\_\_

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.













NCDENR PWSS WATER PERMIT #: \_\_\_\_\_ GPD  
WATER CAPACITY: \_\_\_\_\_ GPD  
DWQ SEWER PERMIT #: \_\_\_\_\_  
SEWER CAPACITY: \_\_\_\_\_ GPD  
SEWER SHED # AND PLANT: \_\_\_\_\_  
SEWER TO FLOW THROUGH NEI: YES or NO (CIRCLE ONE)

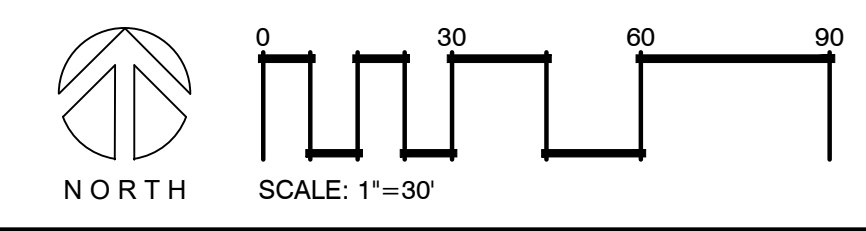

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

<p>REVISIONS: REV. 1 ADDITIONAL NOTES ADDED 11/18/21</p>	<p>CLIENT INFORMATION: FOOD BANK OF CENTRAL &amp; EASTERN NORTH CAROLINA 1924 CAPITAL BLVD. RALEIGH, NC 27604</p>	<p>UTILITY PLAN THE WILMINGTON FOOD BANK GREENFIELD STREET WILMINGTON, NORTH CAROLINA</p>	<p>PROJECT STATUS: CONCEPTUAL LAYOUT PRELIMINARY LAYOUT RELEASED FOR CONST.</p>	<p>DRAWING INFORMATION: DATE: 10/19/21 DRAWN: GJB CHECKED: GJB</p>	<p>Professional Seal redacted on electronic copy per City of Wilmington Policy</p>
<p>PARAMOUNT ENGINEERING 122 Cinema Drive Wilmington, North Carolina 28403 (910) 791-6707 (O) (910) 791-6760 (F) NC License #: C-2846</p>		<p>C-5.0</p>	<p>PEI JOB#: 20484.PE</p>		



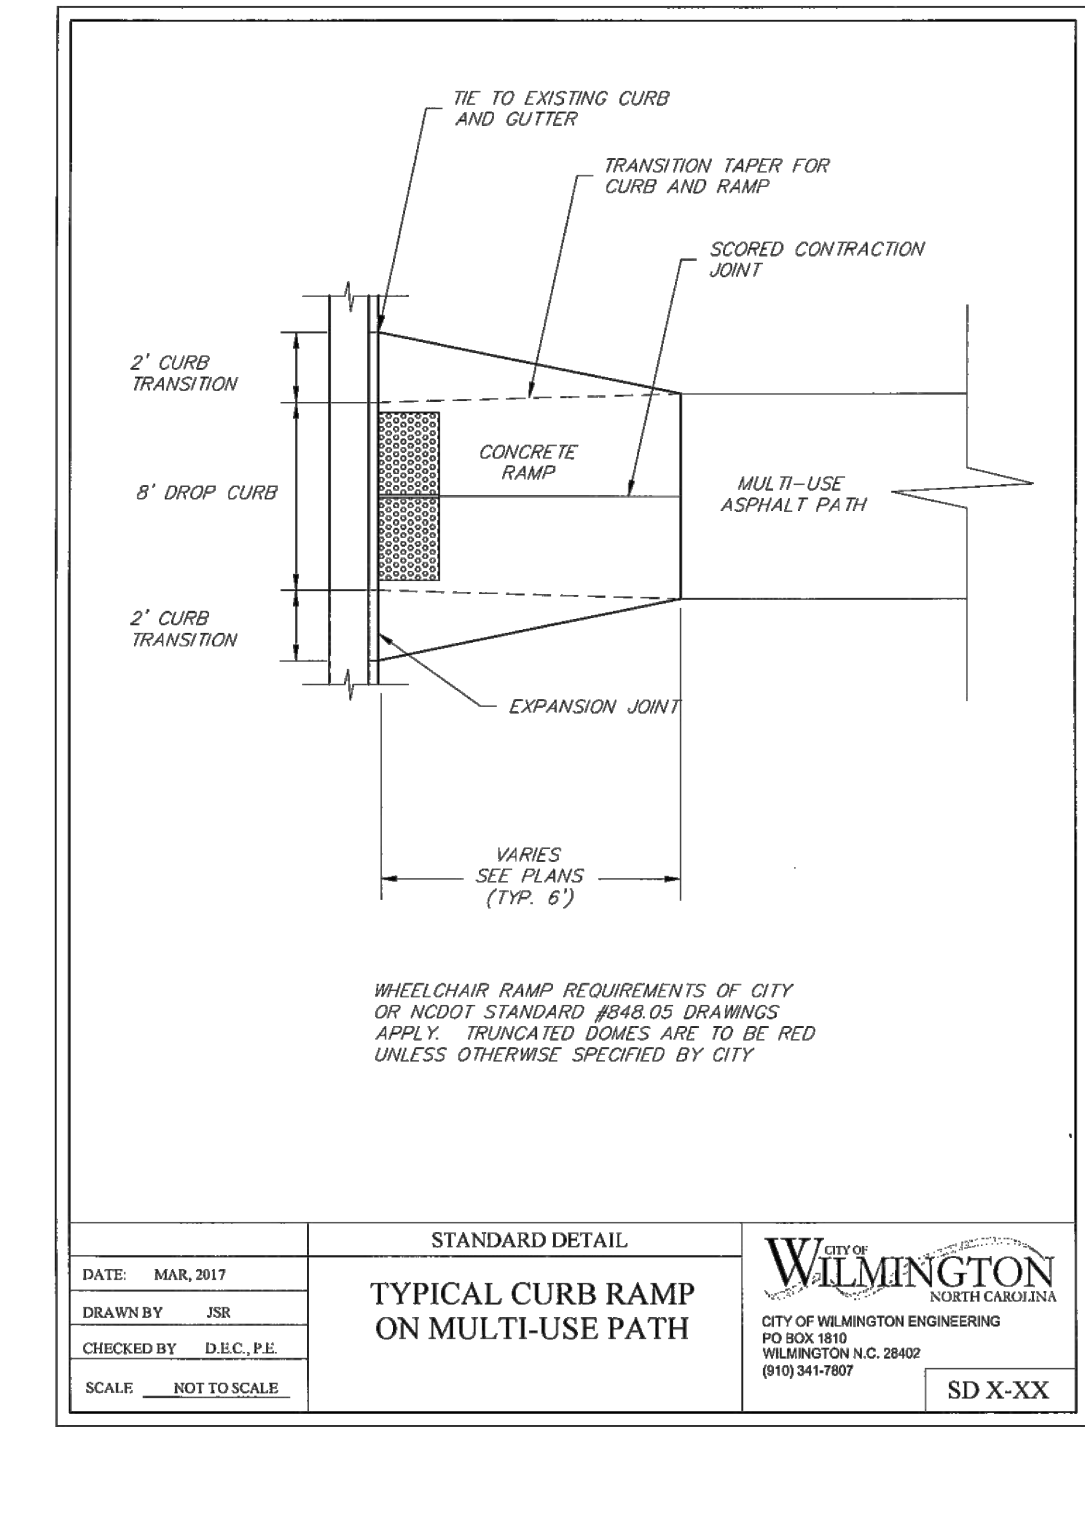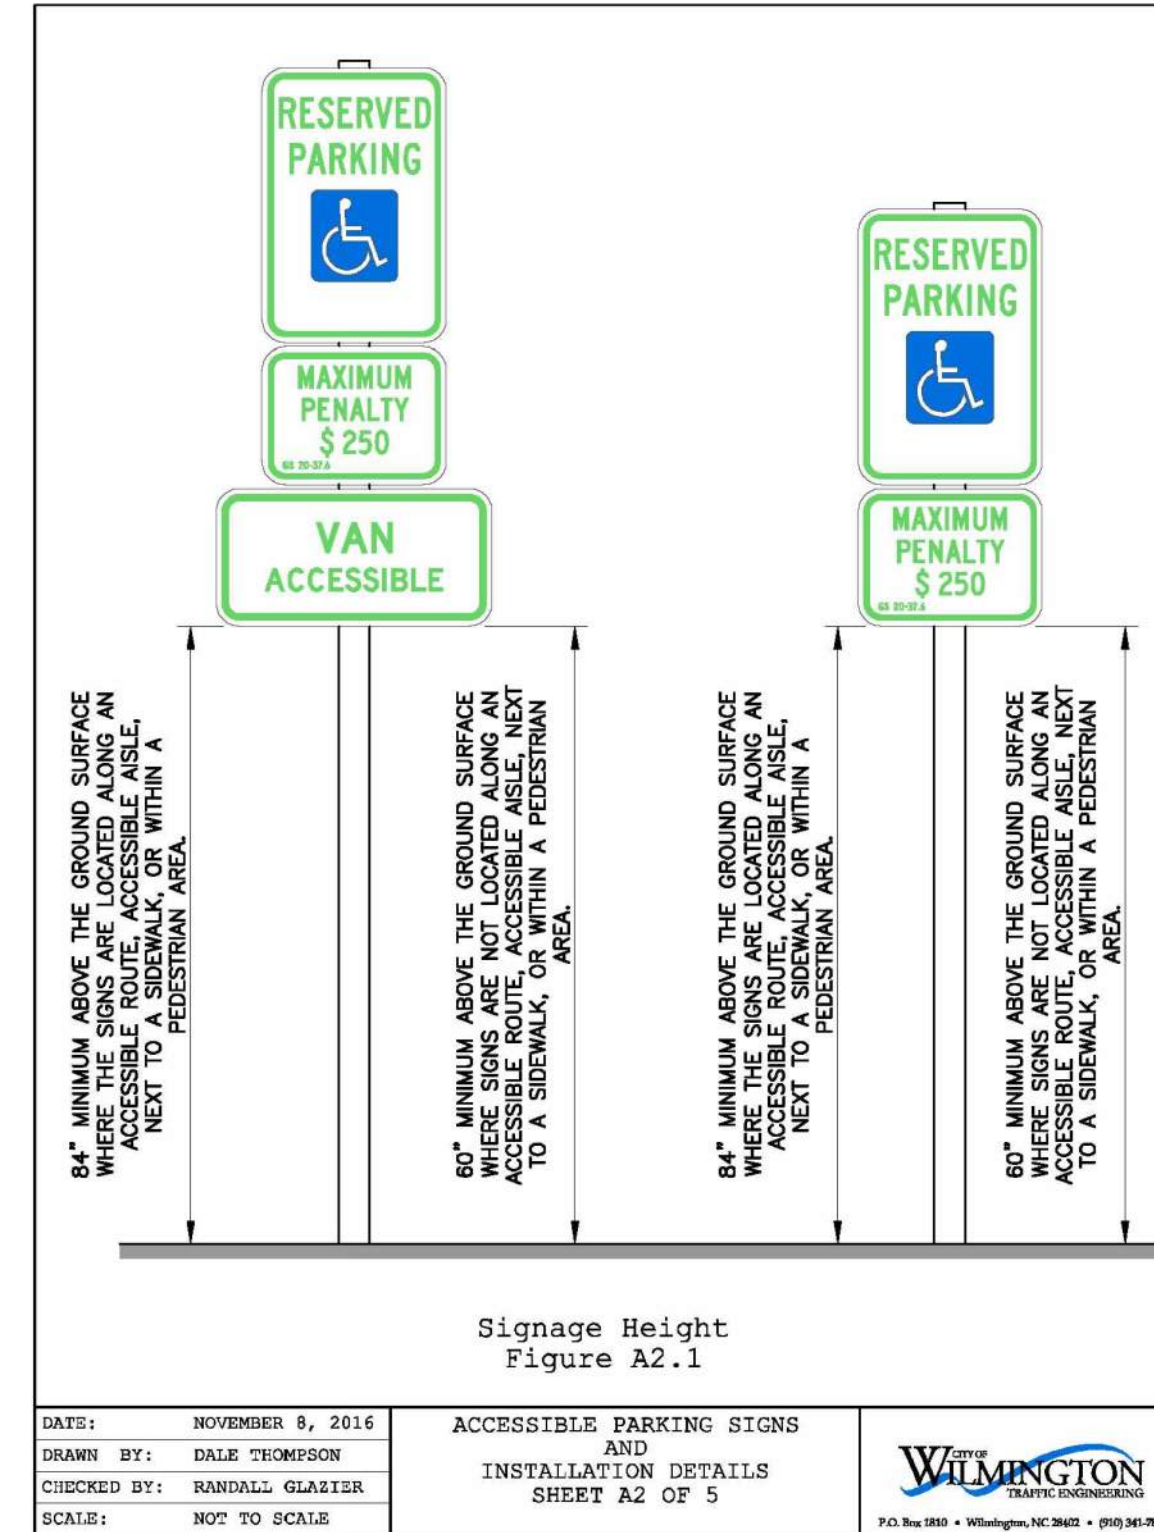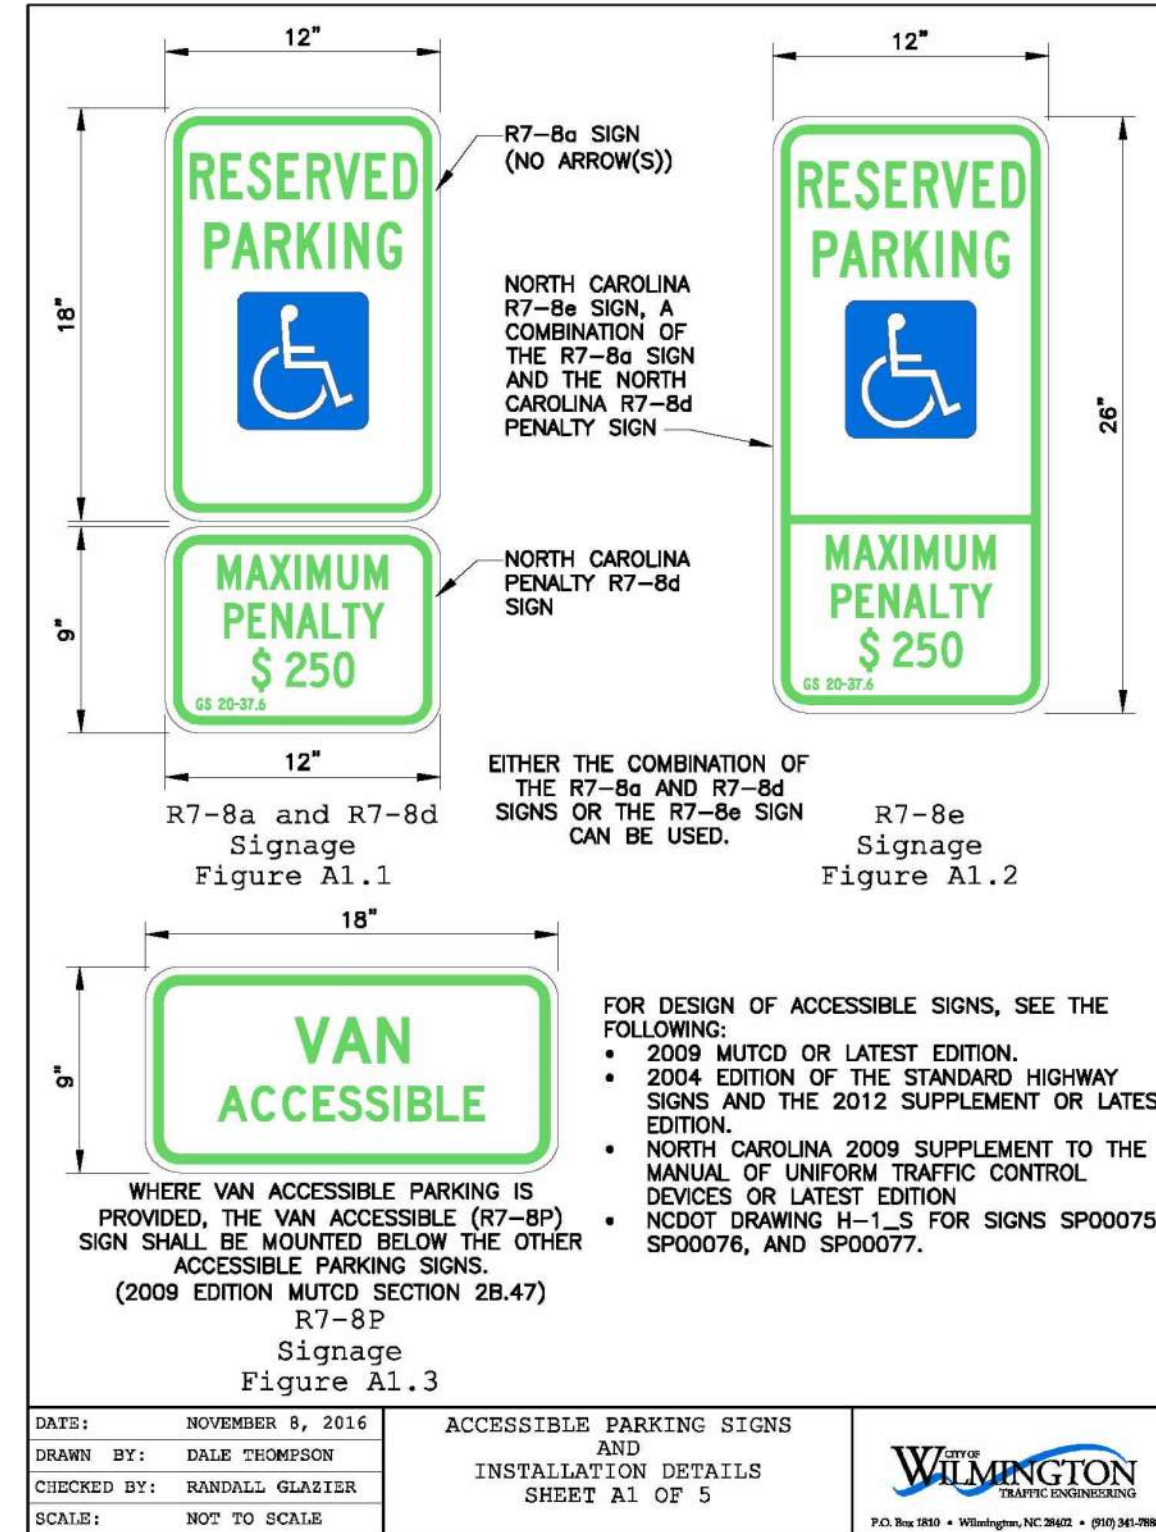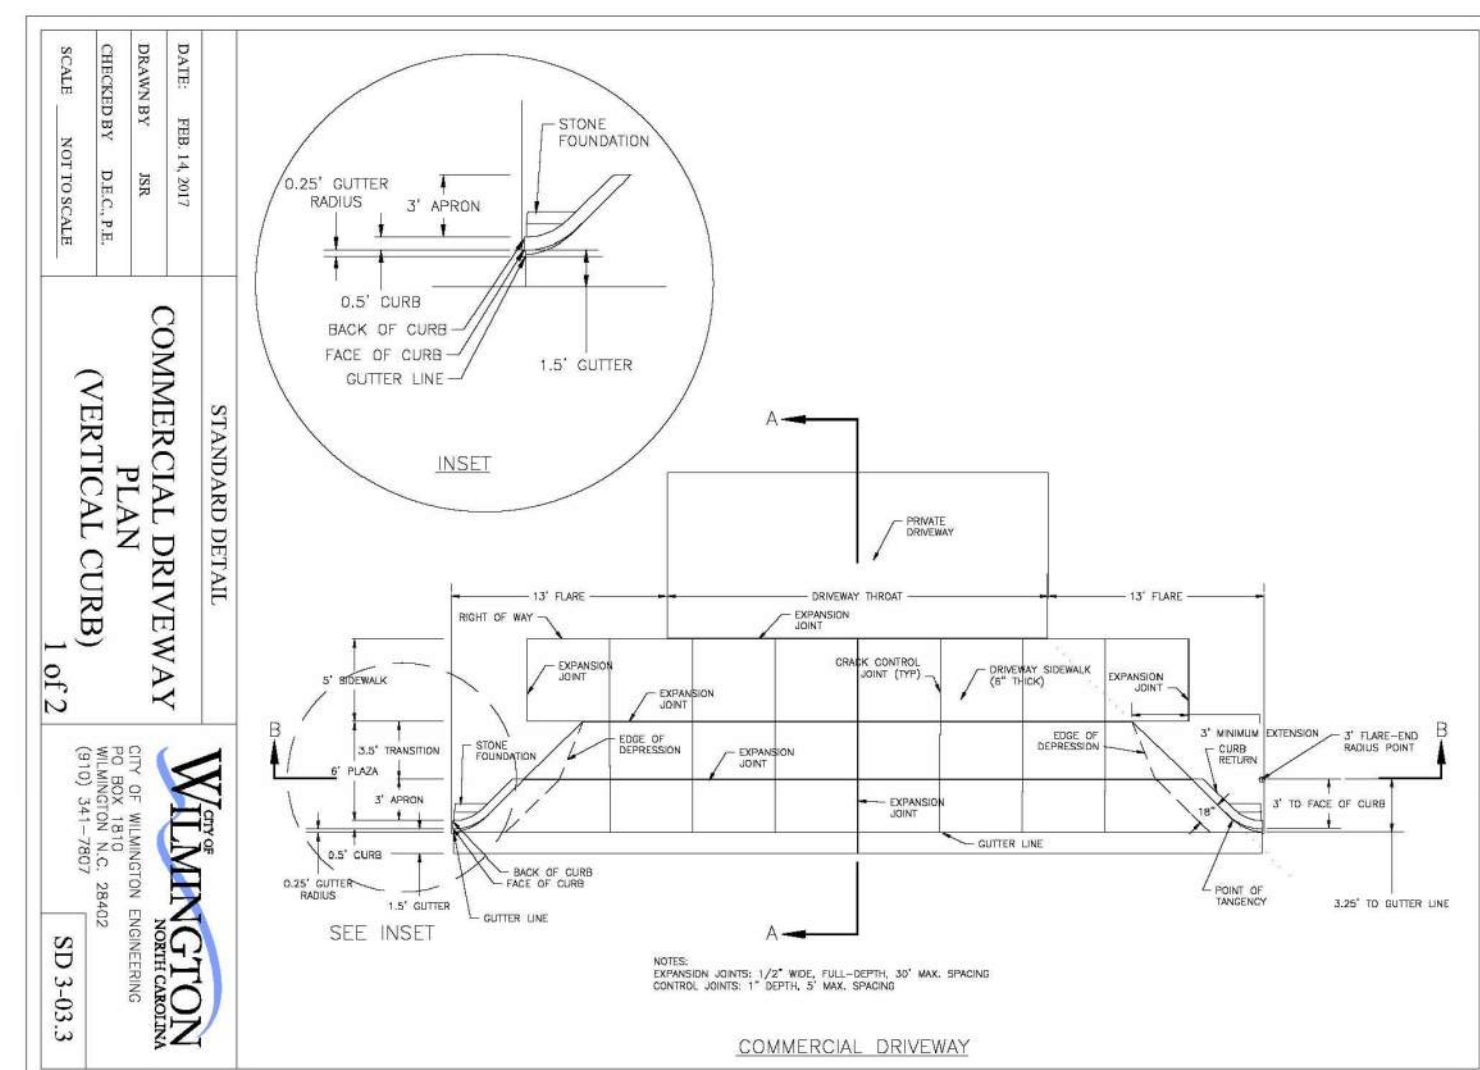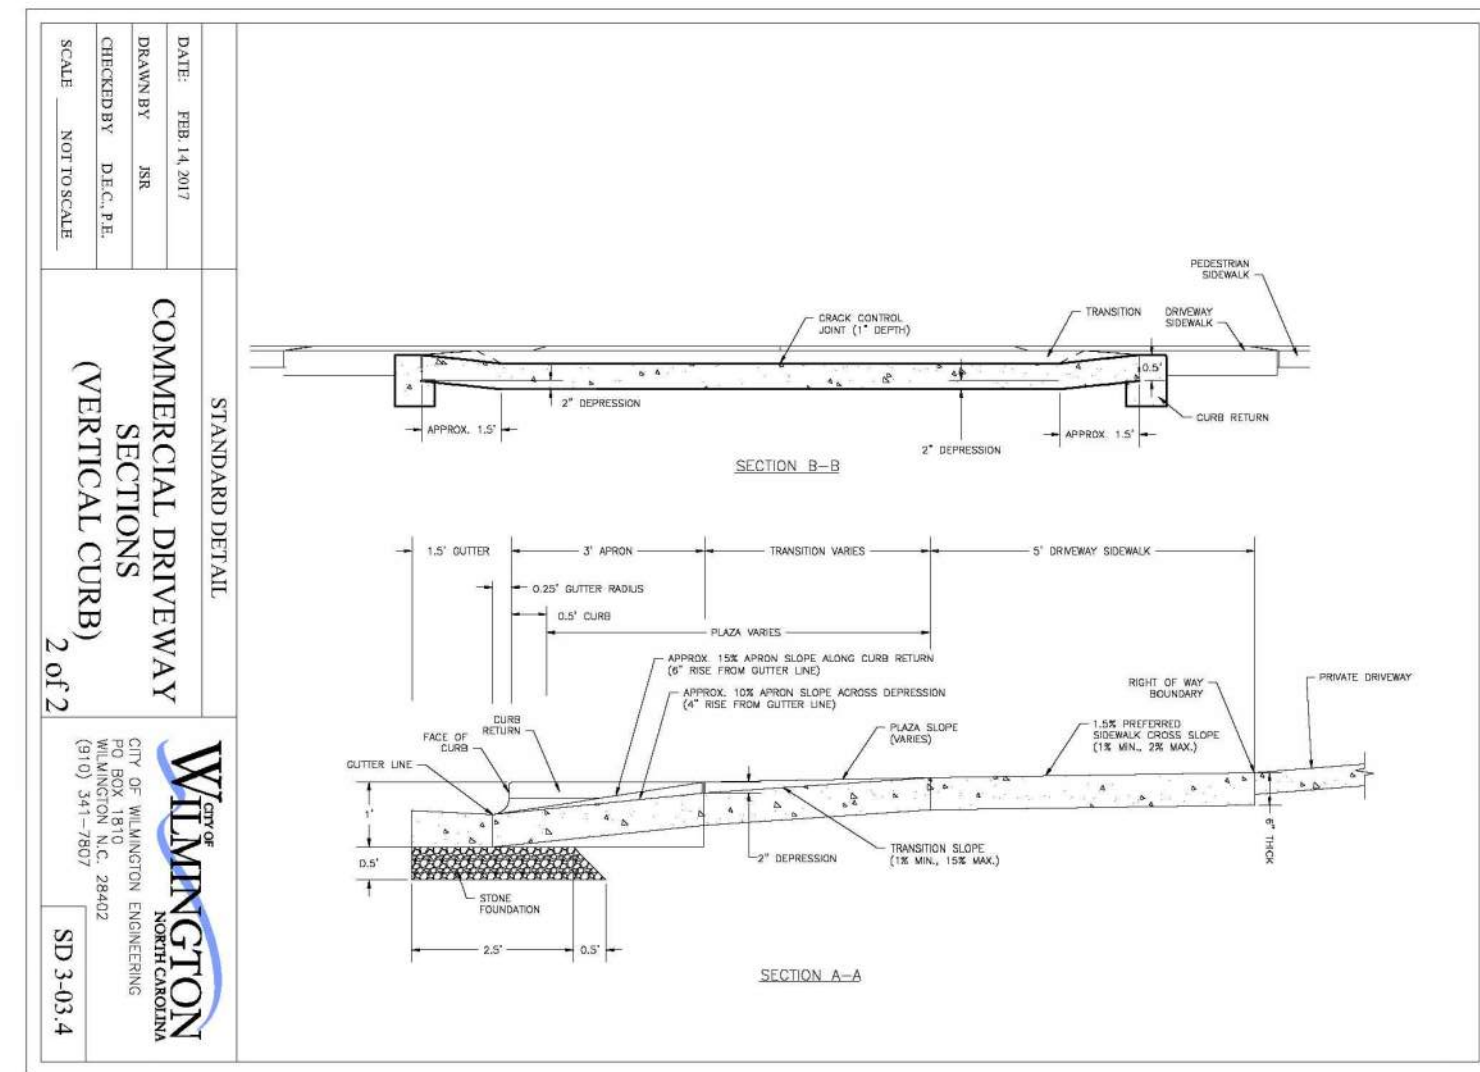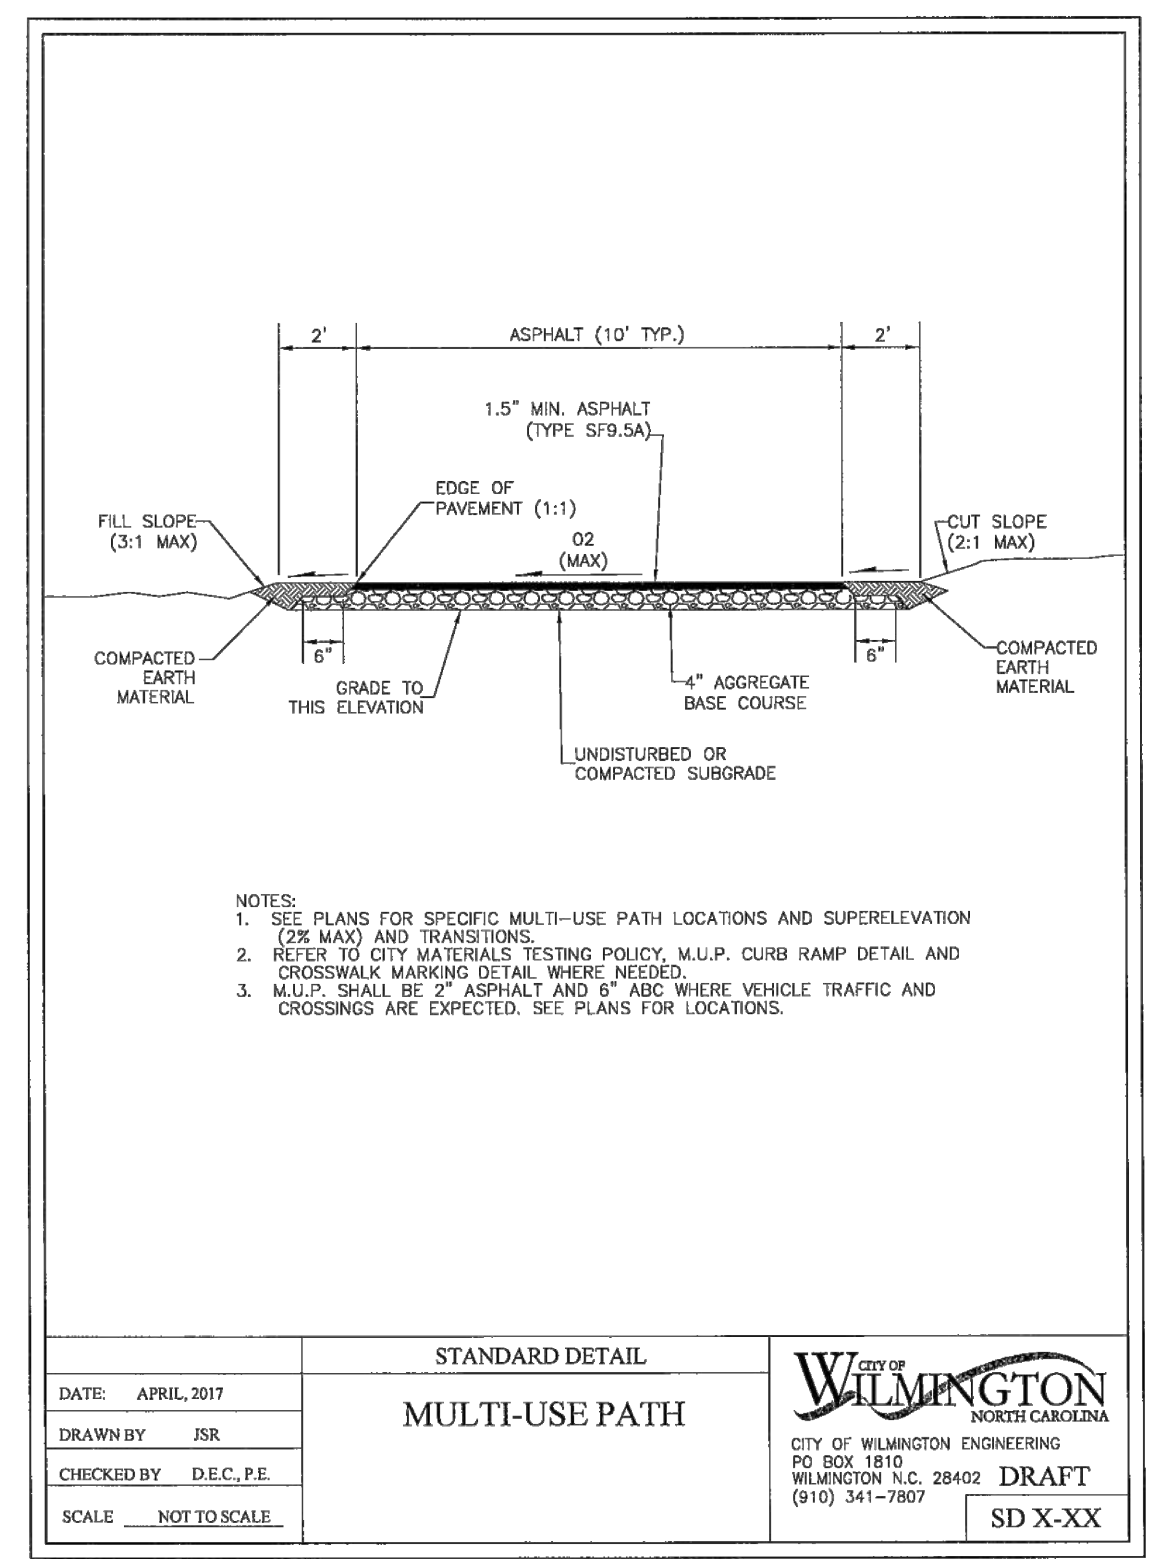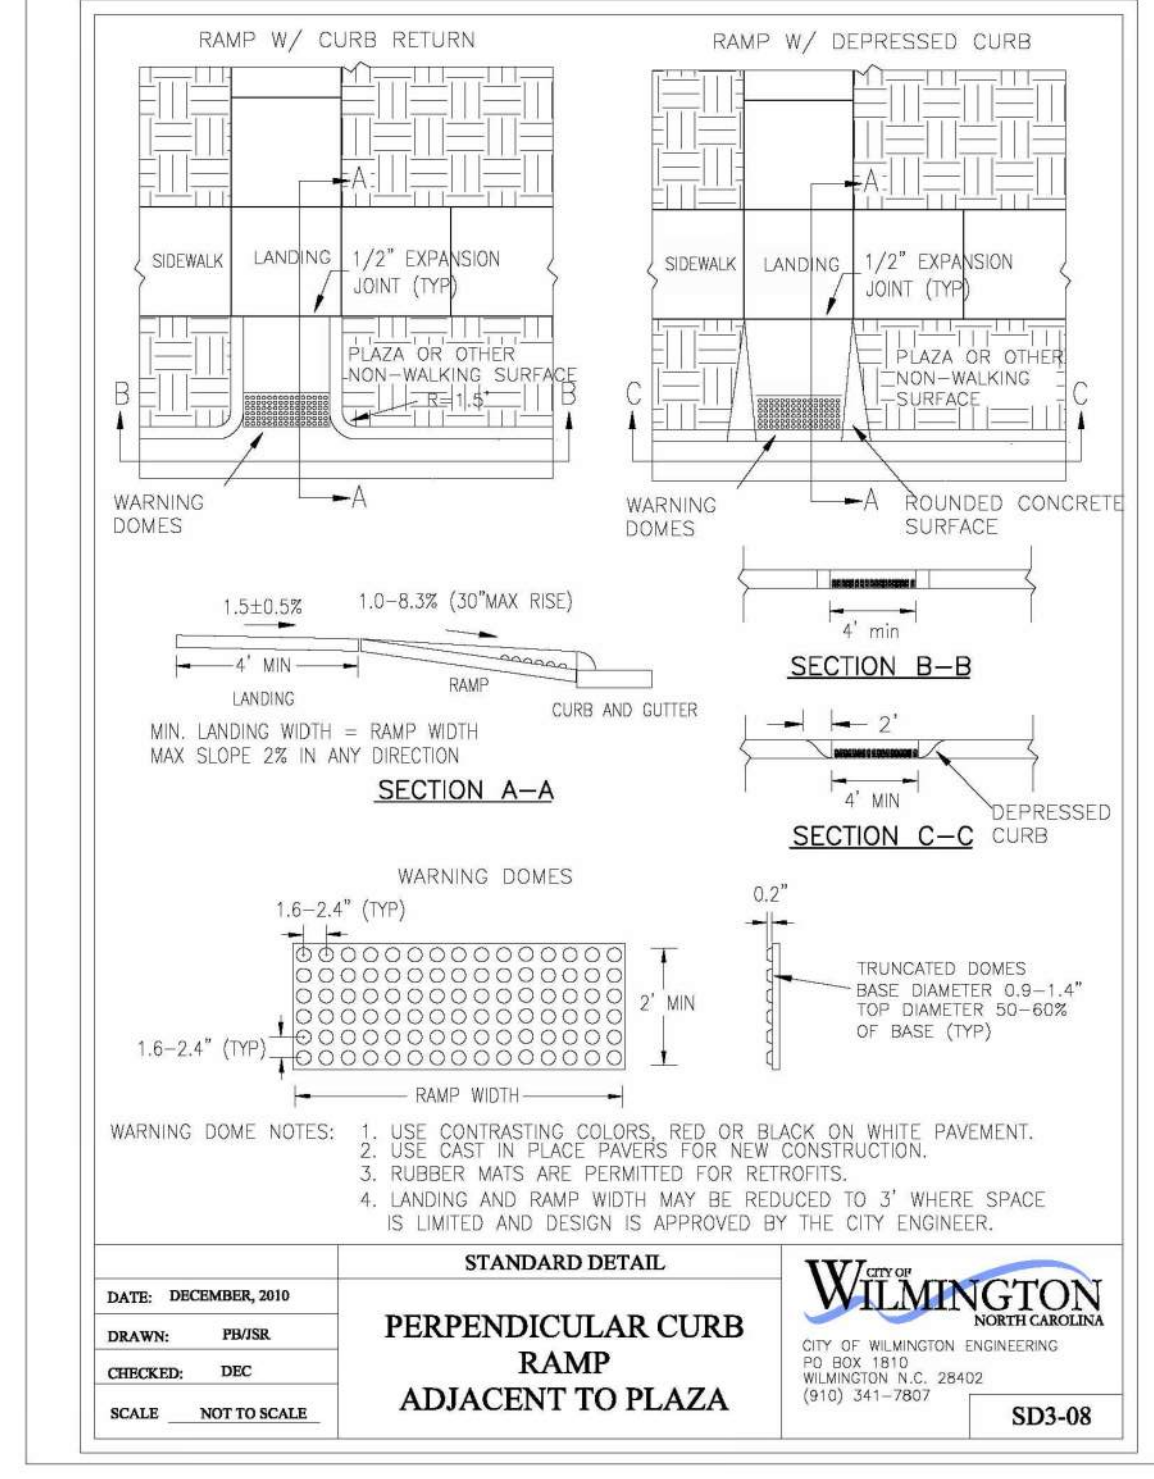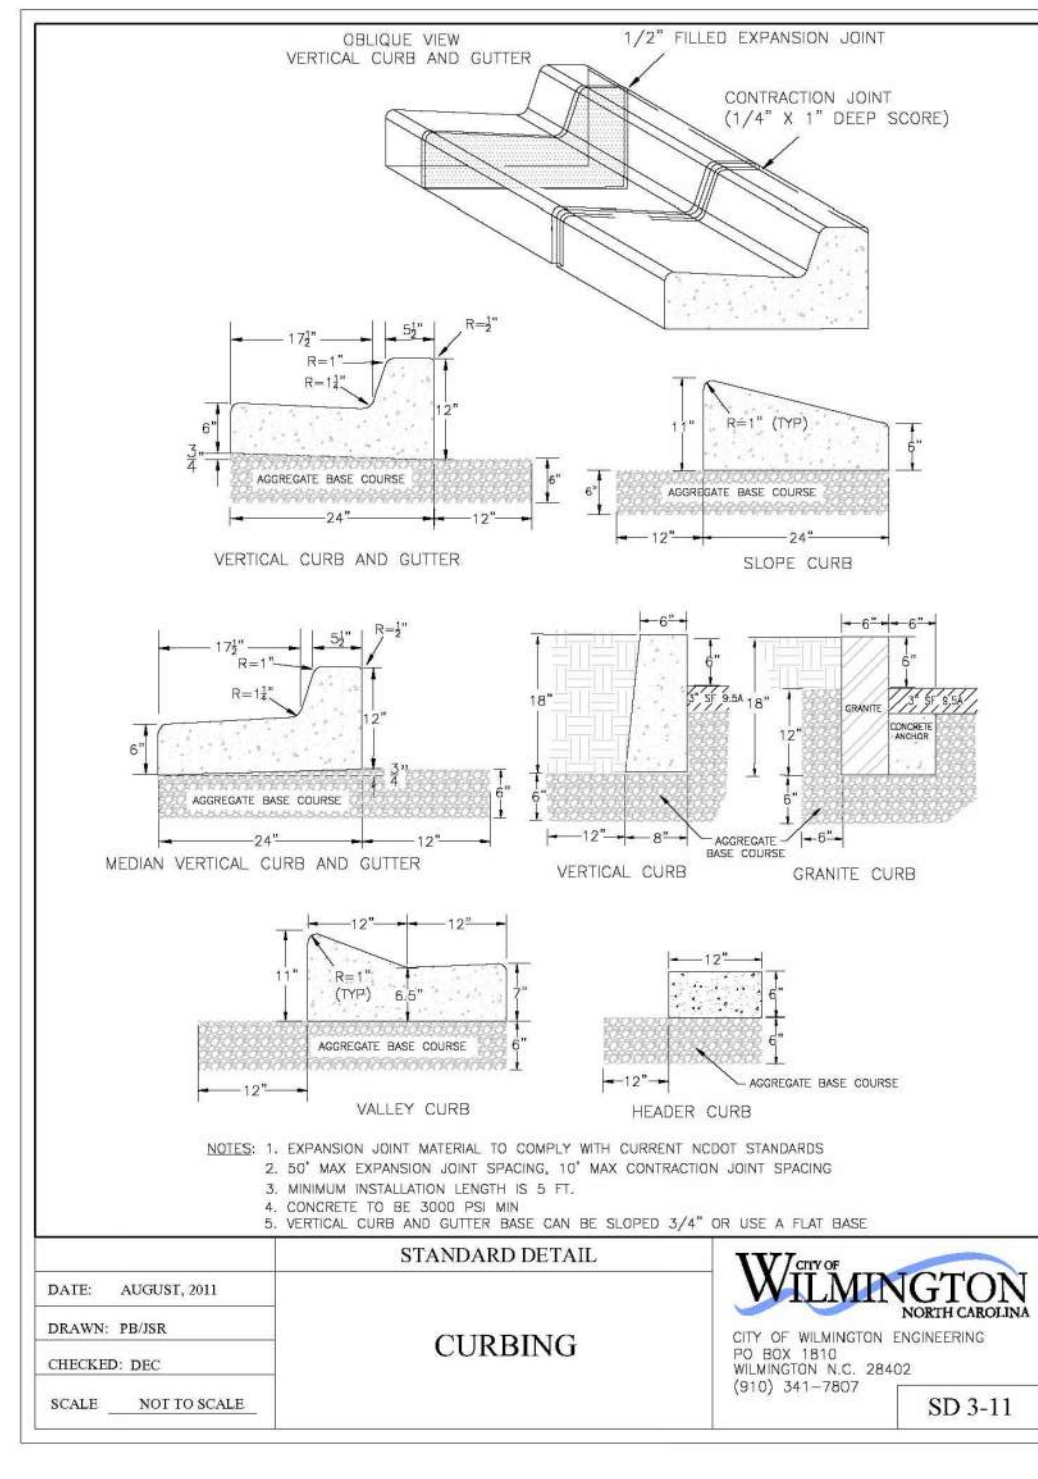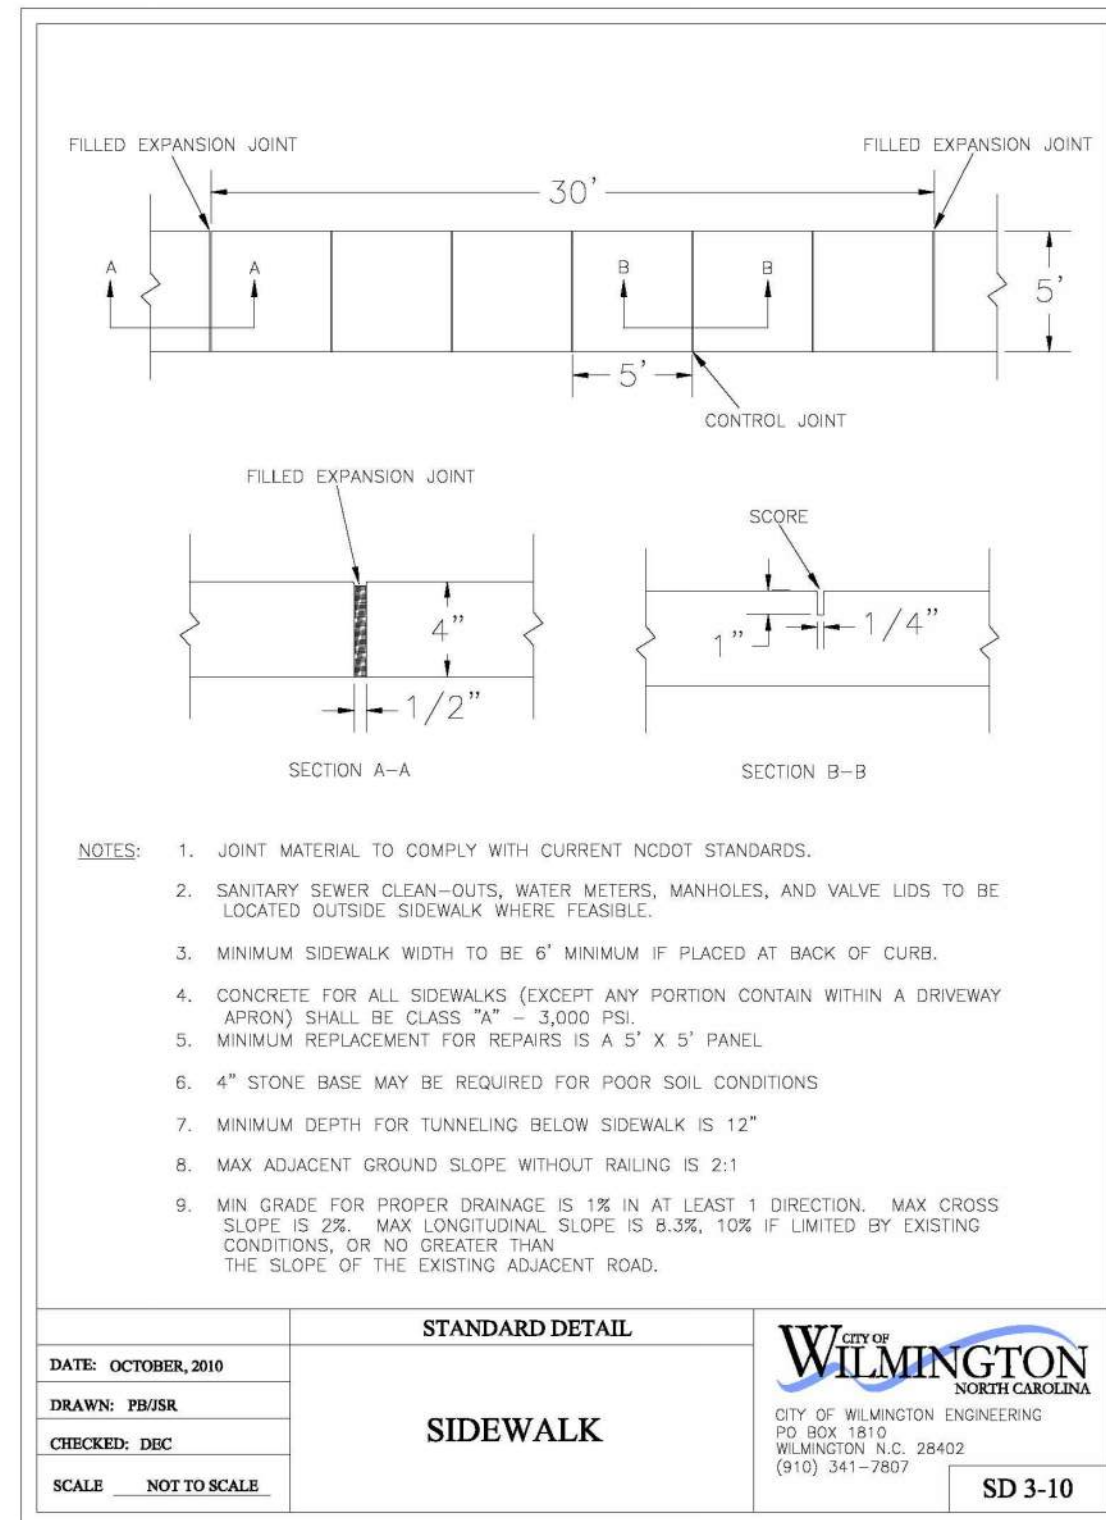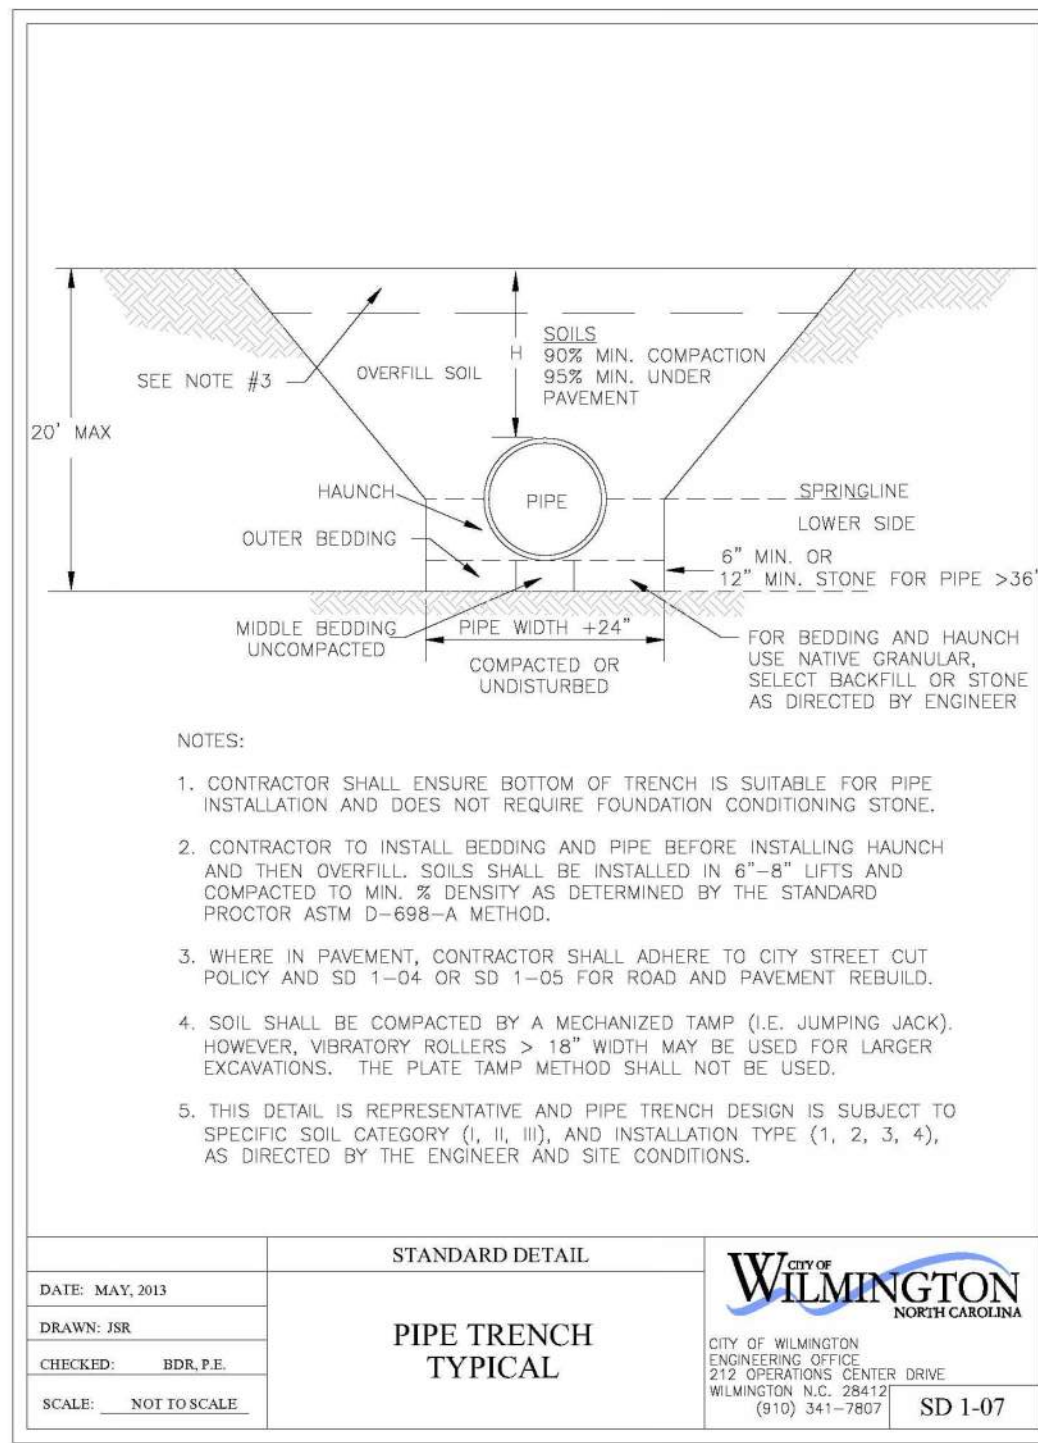

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

REVISIONS:

CLIENT INFORMATION:  
 EASTERN NORTH CAROLINA  
 1924 CAPITAL BLVD.  
 RALEIGH, NC 27604

PARAMOUNT ENGINEERING  
 122 Cinema Drive  
 Wilmington, North Carolina 28403  
 (910) 791-6707 (O) (910) 791-6766 (F)  
 NC License #: C-2846

DETAILS  
 THE WILMINGTON FOOD BANK  
 GREENFIELD STREET  
 WILMINGTON, NORTH CAROLINA

PROJECT STATUS  
 CONCEPTUAL LAYOUT:  
 FINAL DESIGN LAYOUT:  
 RELEASED FOR CONSTRUCTION:  
 DRAWING INFORMATION  
 DATE: 10.13.21  
 SCALE: P.E.  
 DRAWING: P.E.  
 CHECKED: P.E.

Professional Seal  
 retracted on  
 electronic copy  
 per City of  
 Wilmington Policy

C-6.0









PEI JOB#: 20484.PE

NC DENR PWSS WATER PERMIT #: \_\_\_\_\_ GPD  
 WATER CAPACITY: \_\_\_\_\_ GPD  
 DWQ SEWER PERMIT #: \_\_\_\_\_ GPD  
 SEWER CAPACITY: \_\_\_\_\_ GPD  
 SEWER SHED # AND PLANT: \_\_\_\_\_  
 SEWER TO FLOW THROUGH NEI: YES OR NO (CIRCLE ONE)

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.









**CITY OF WILMINGTON**  
 NORTH CAROLINA  
 Public Services • Engineering Division  
 APPROVED STORMWATER MANAGEMENT PLAN  
 Date: \_\_\_\_\_ Permit # \_\_\_\_\_  
 Signed: \_\_\_\_\_

**Approved Construction Plan**  
 Name \_\_\_\_\_ Date \_\_\_\_\_  
 Planning \_\_\_\_\_  
 Traffic \_\_\_\_\_  
 Fire \_\_\_\_\_

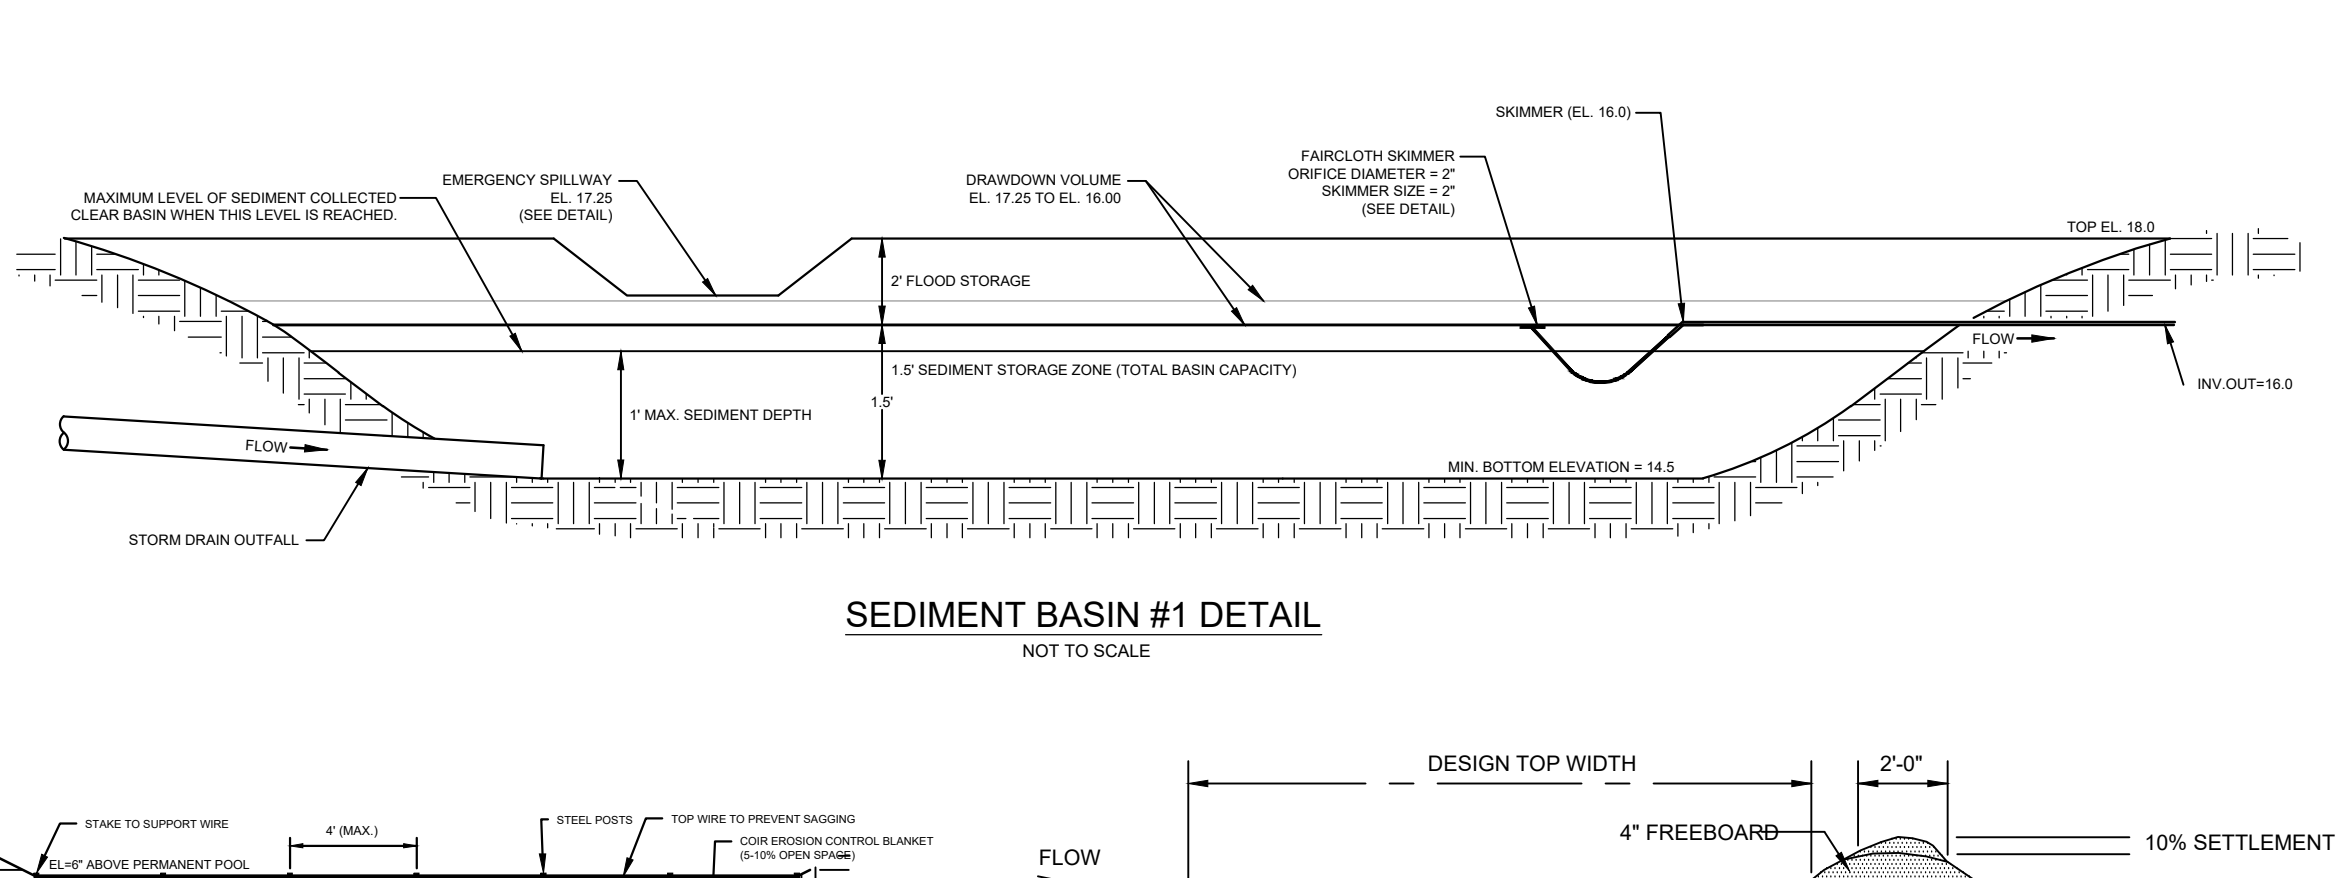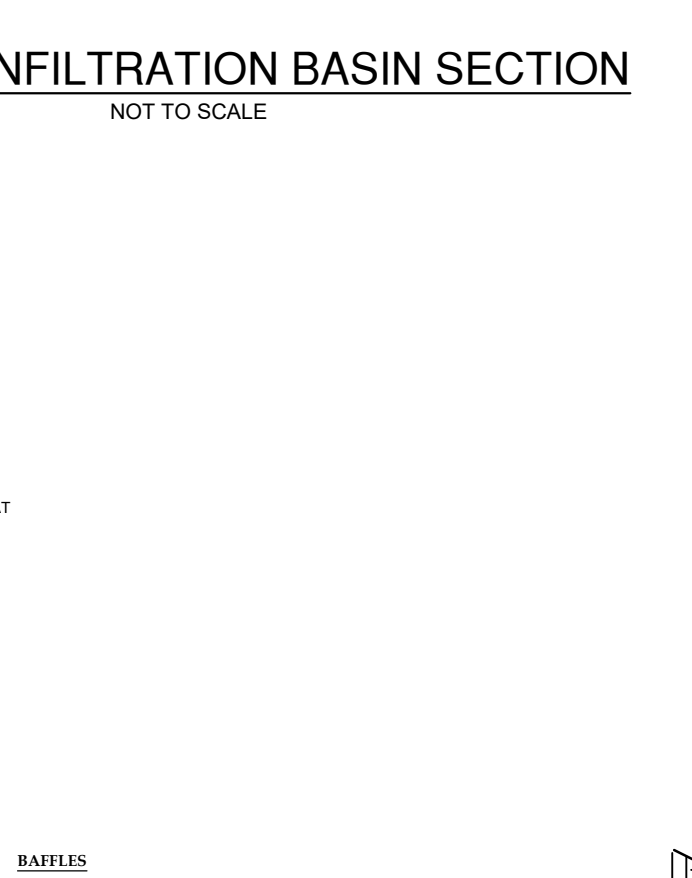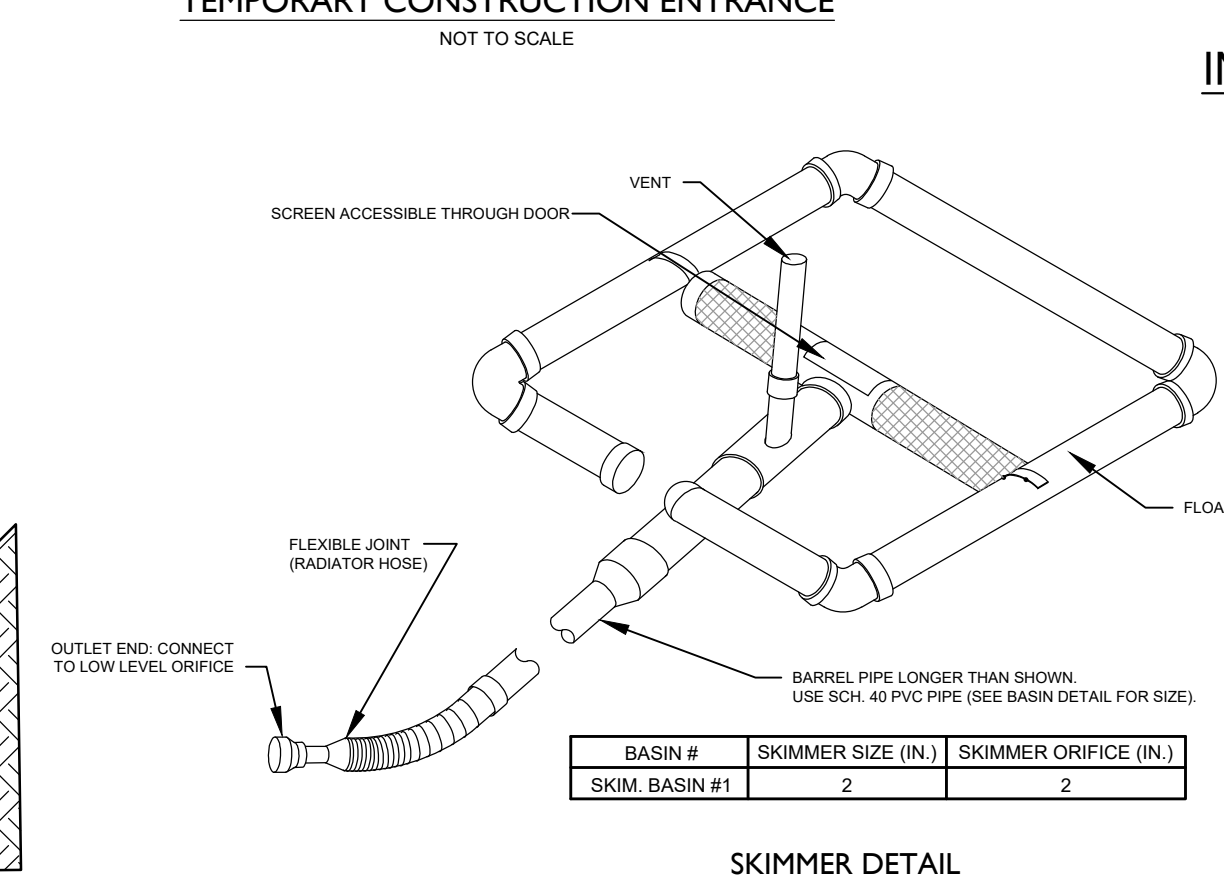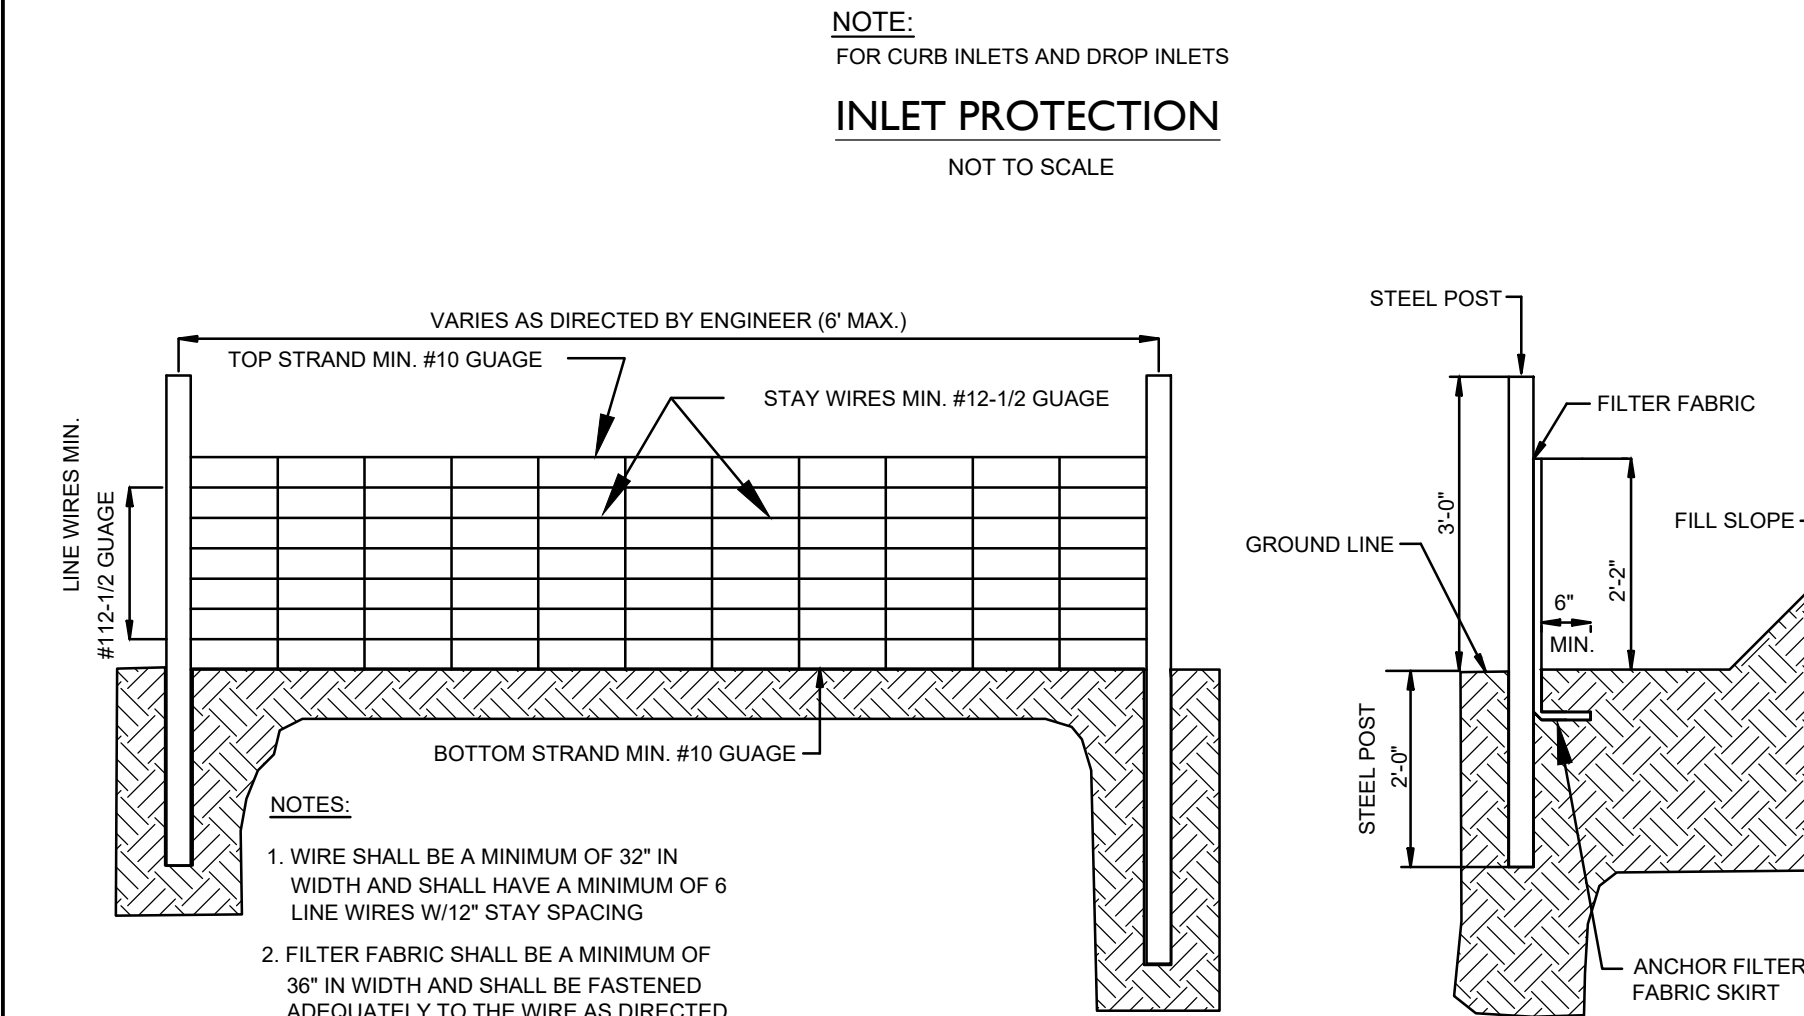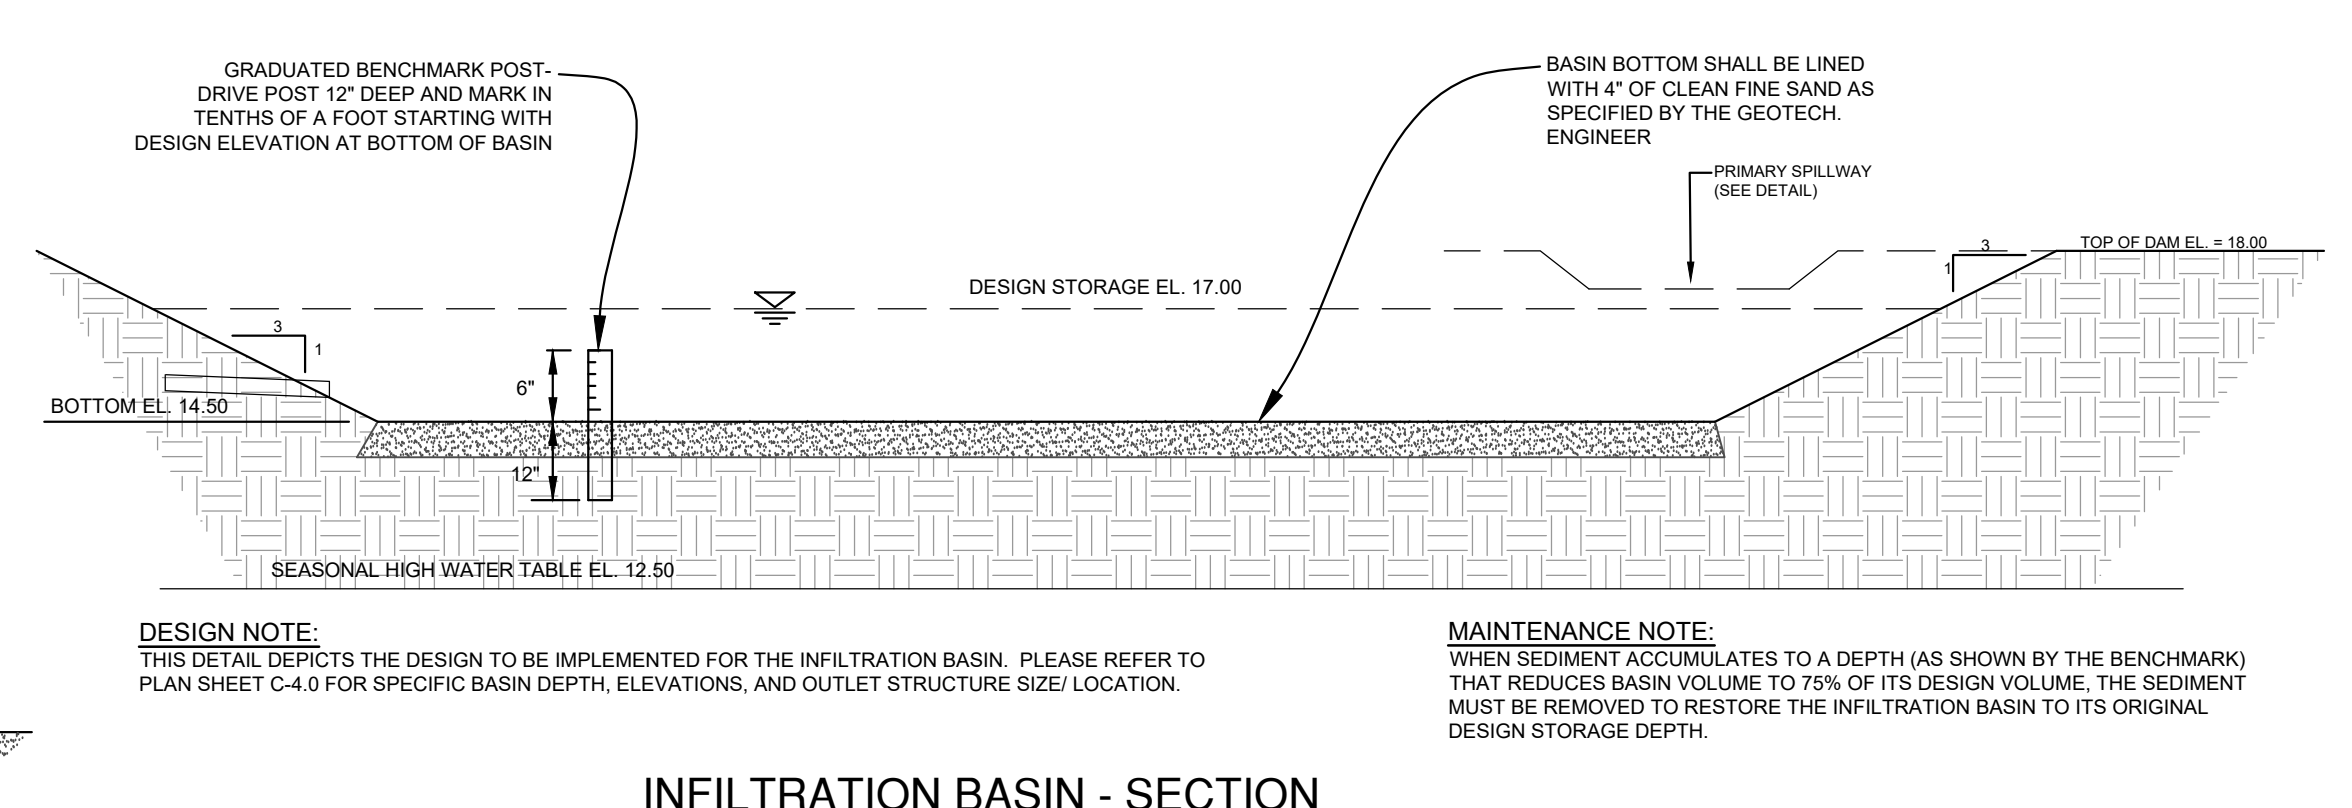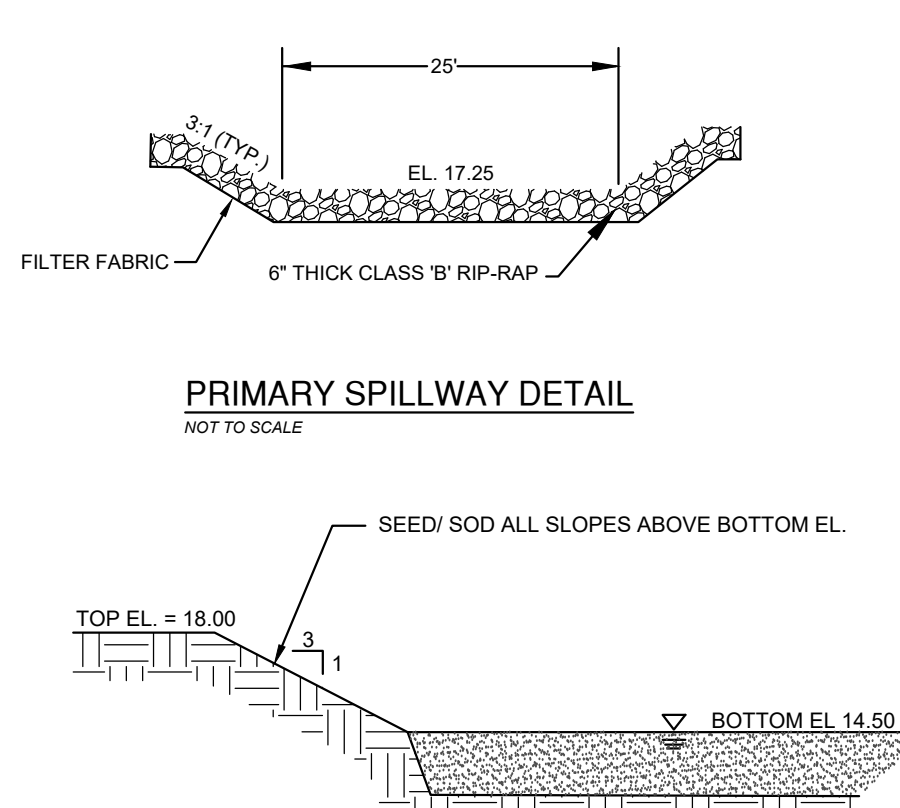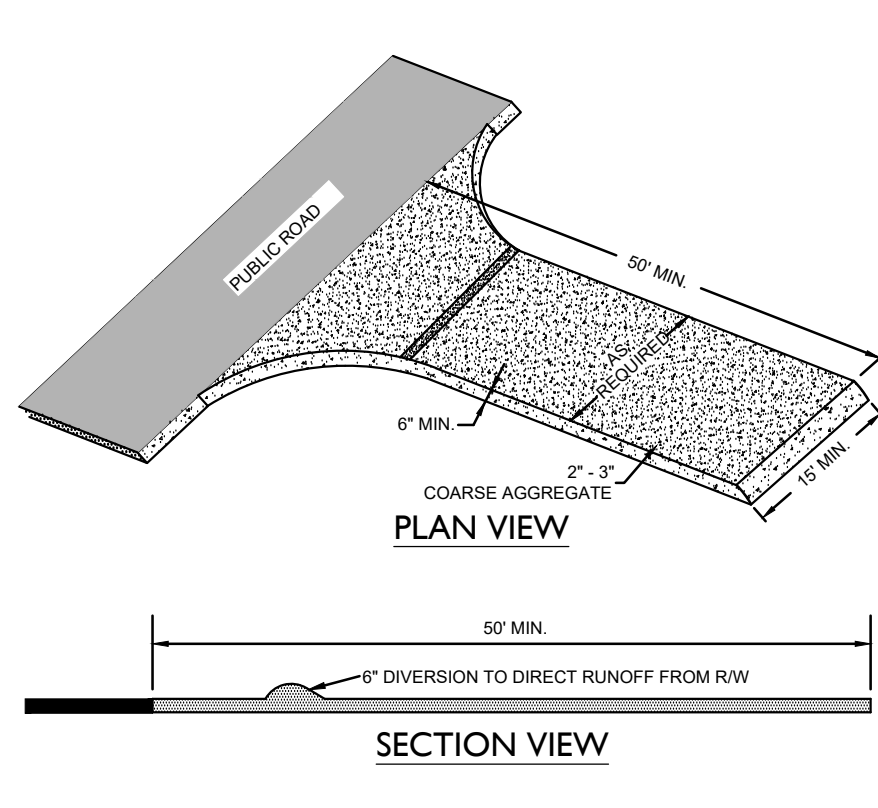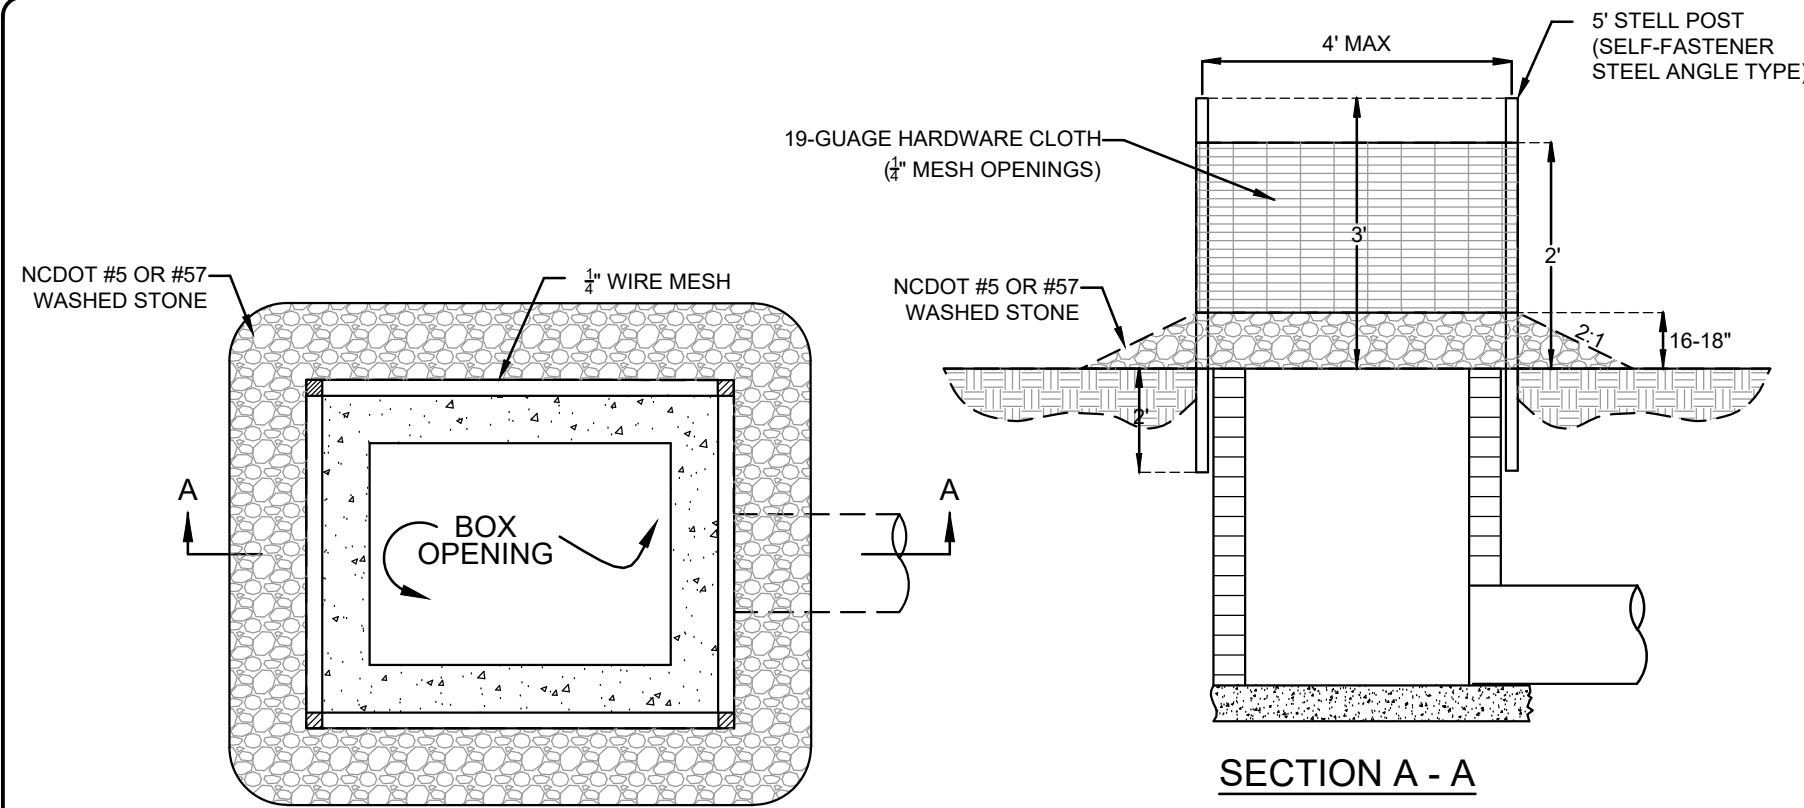

**The Wilmington Food Bank  
Temporary Sediment Fence**  
Requirement = 100 ft per 0.25 acres disturbed

DA #	Disturbed area (ac)	Total drainage area (ac)	Silt Fence Required (ft)	Silt Fence Provided (ft)
2	0.40 ac	0.40 ac	161	191
3	0.99 ac	0.99 ac	397	488
4	0.77 ac	0.77 ac	306	414

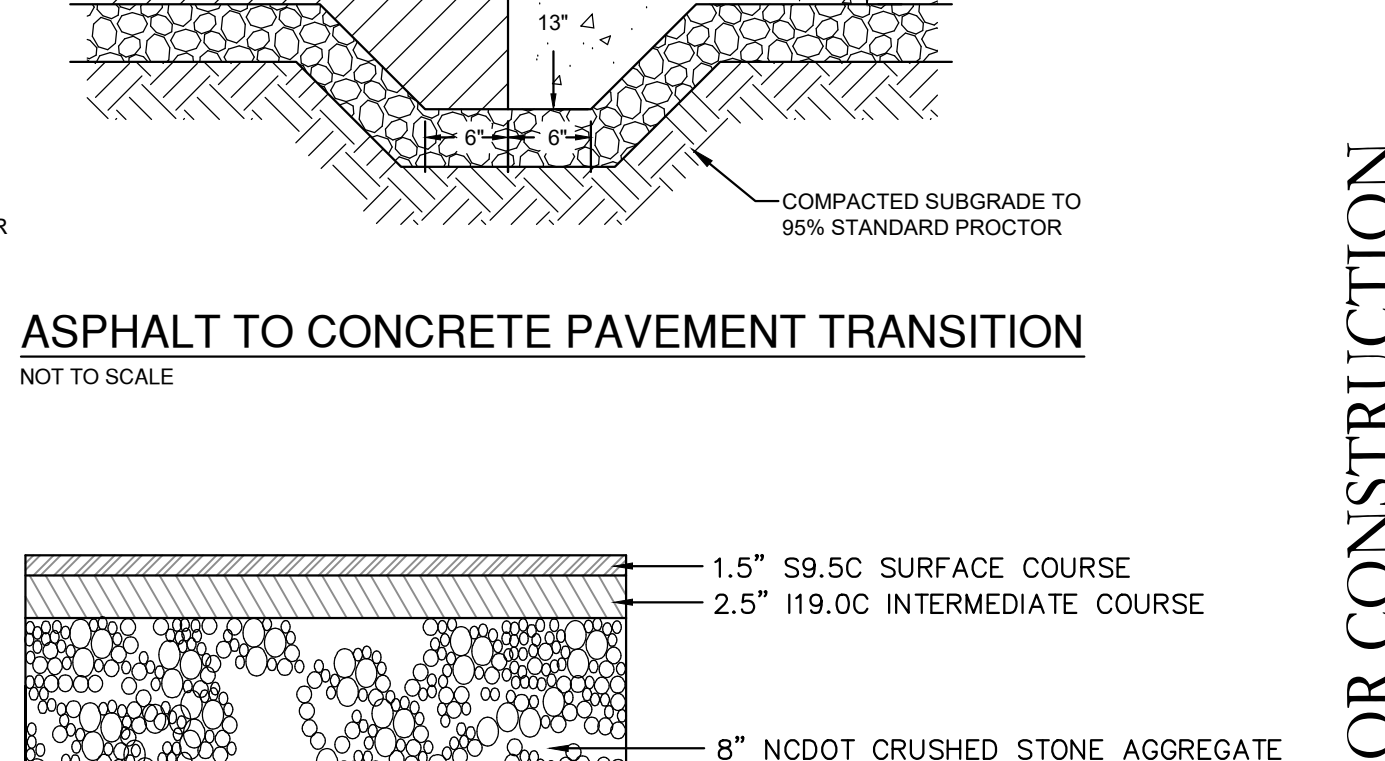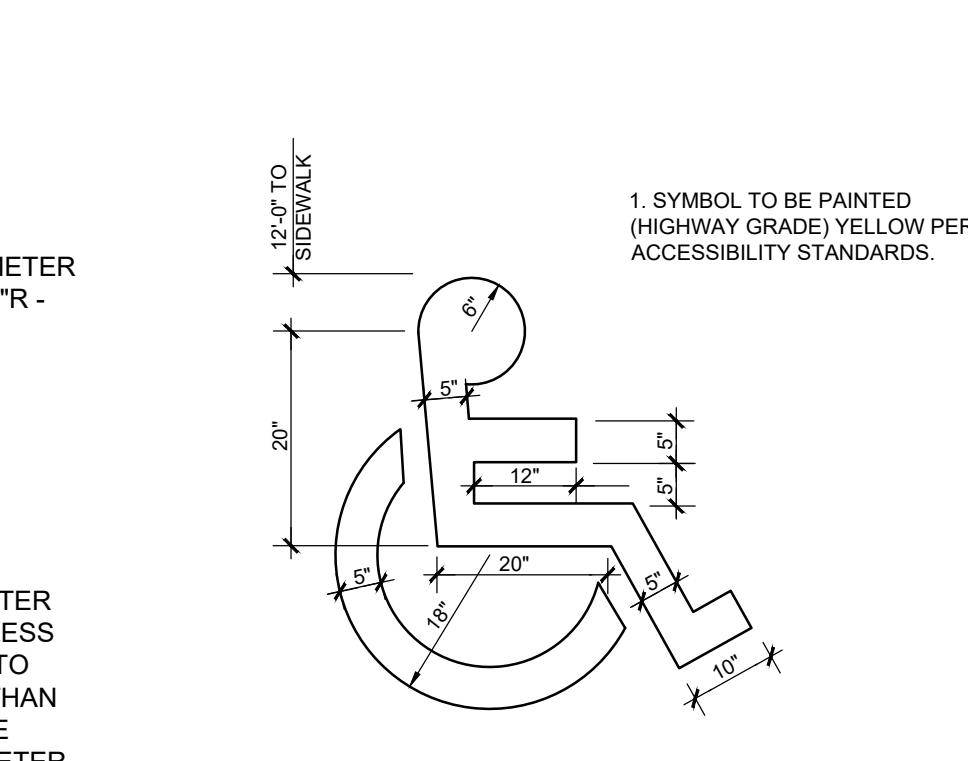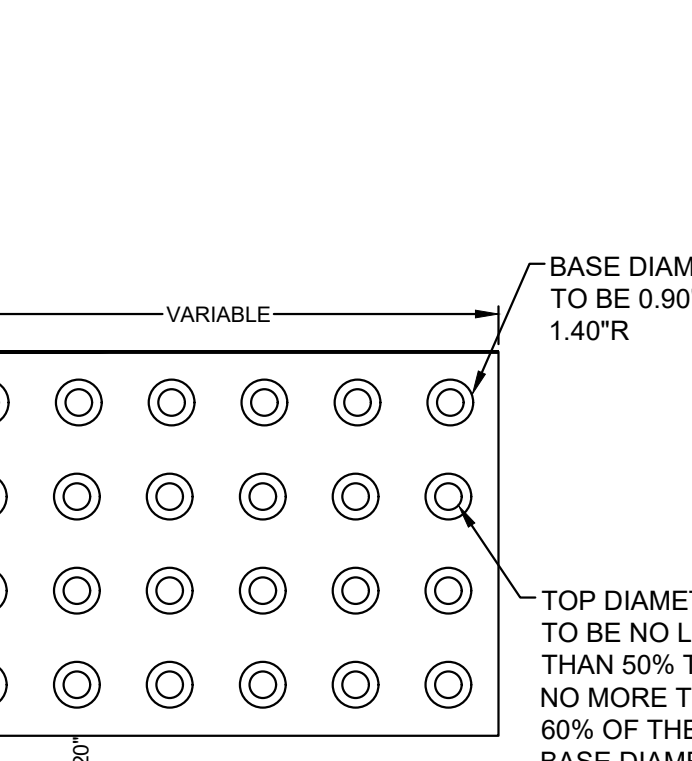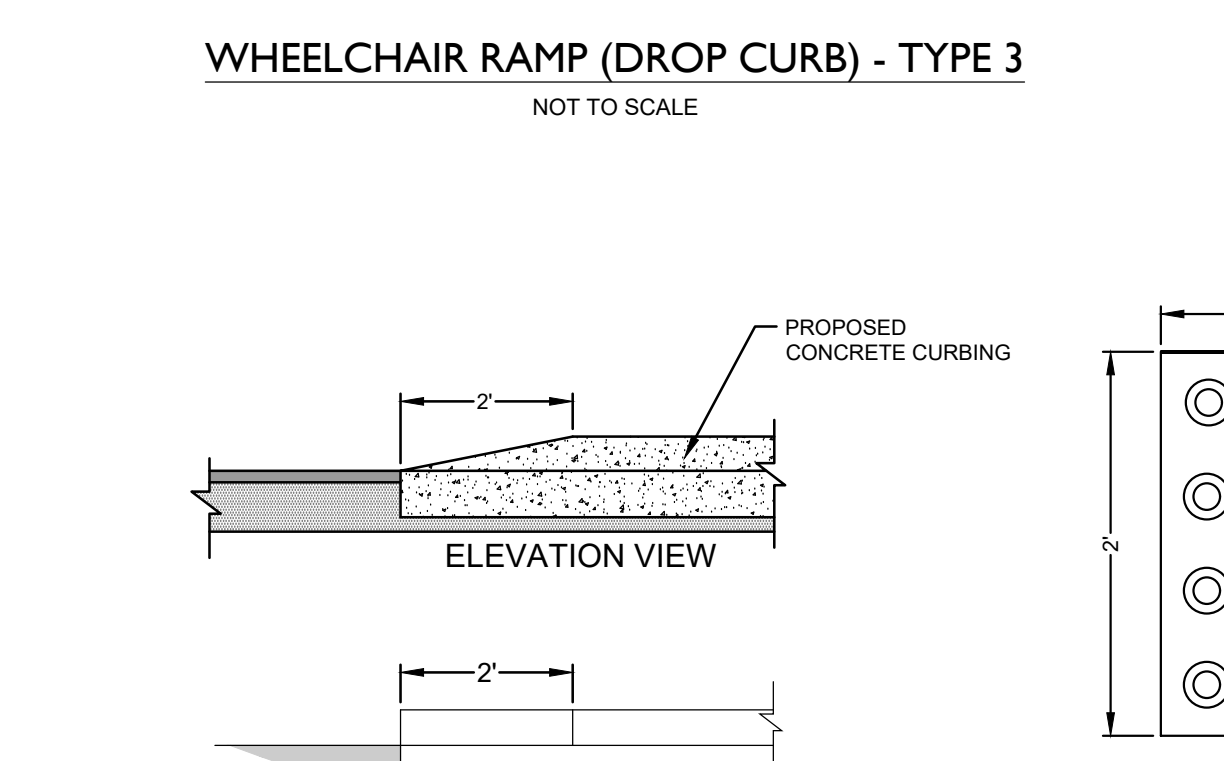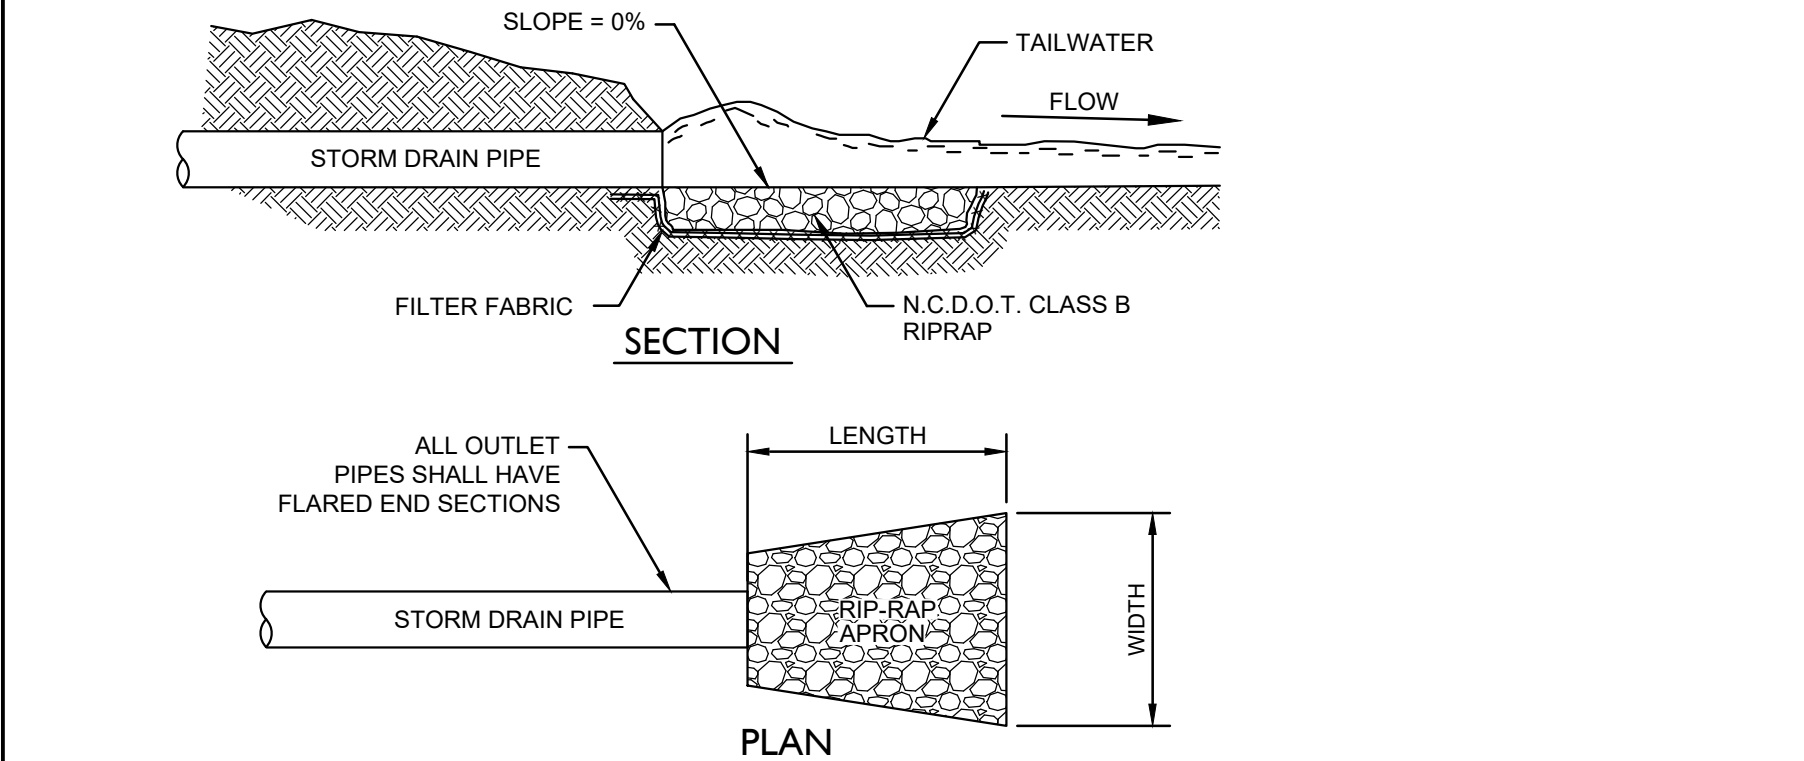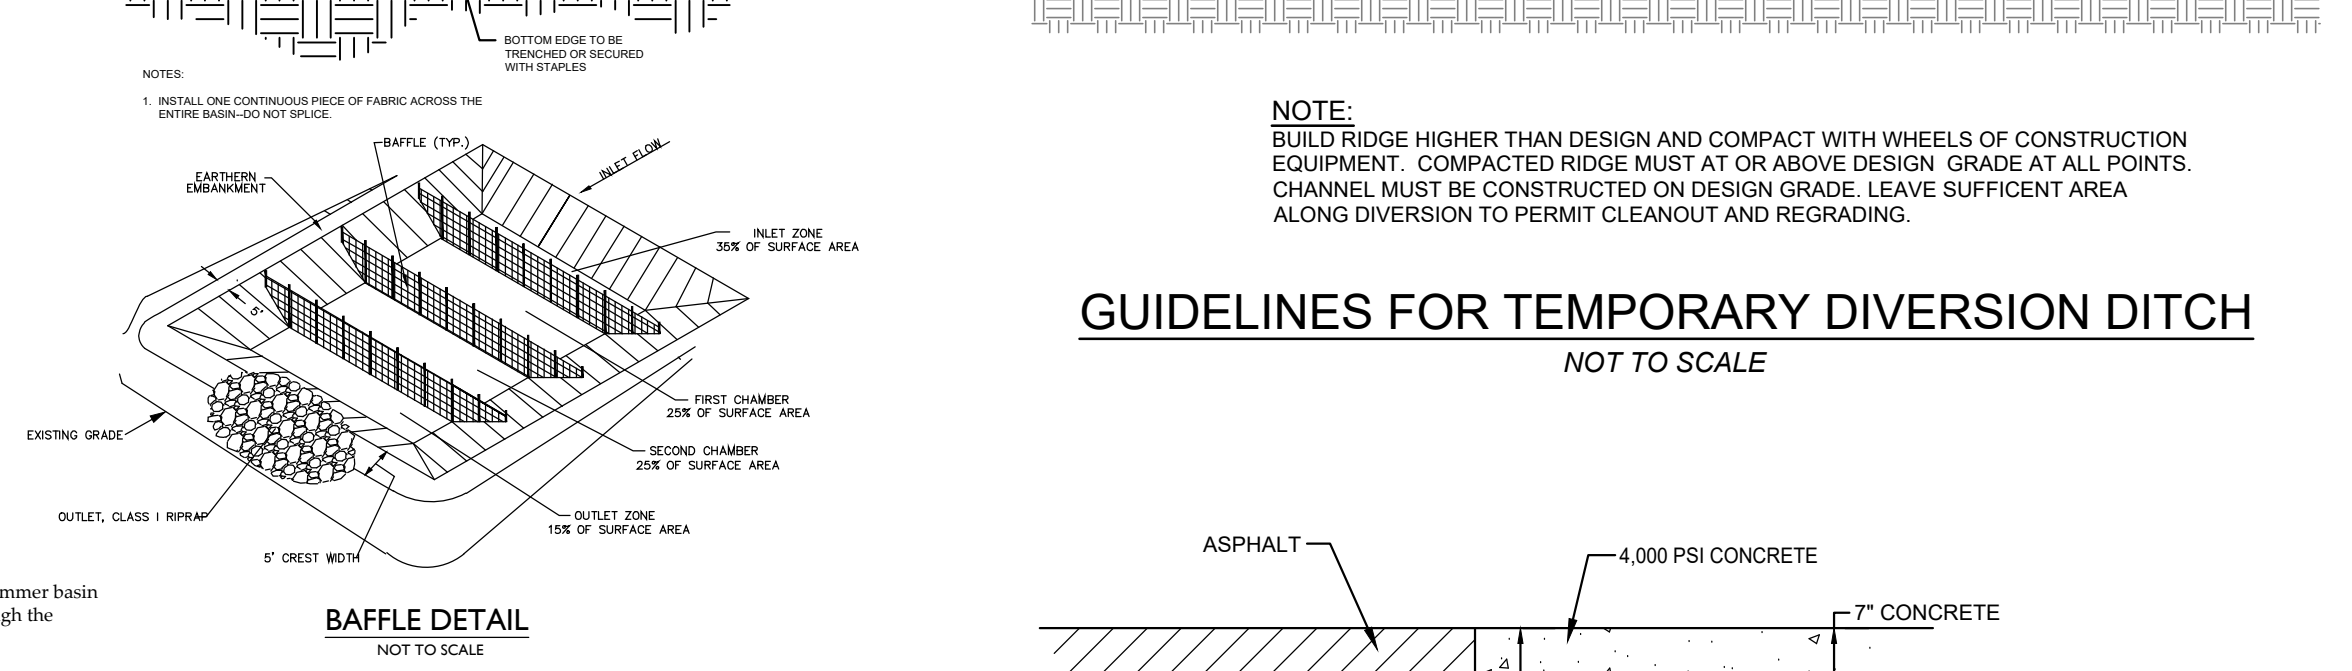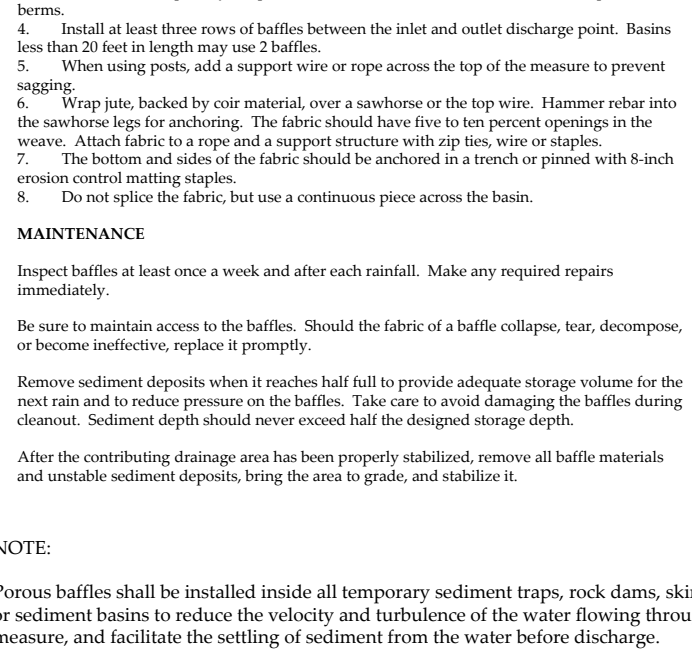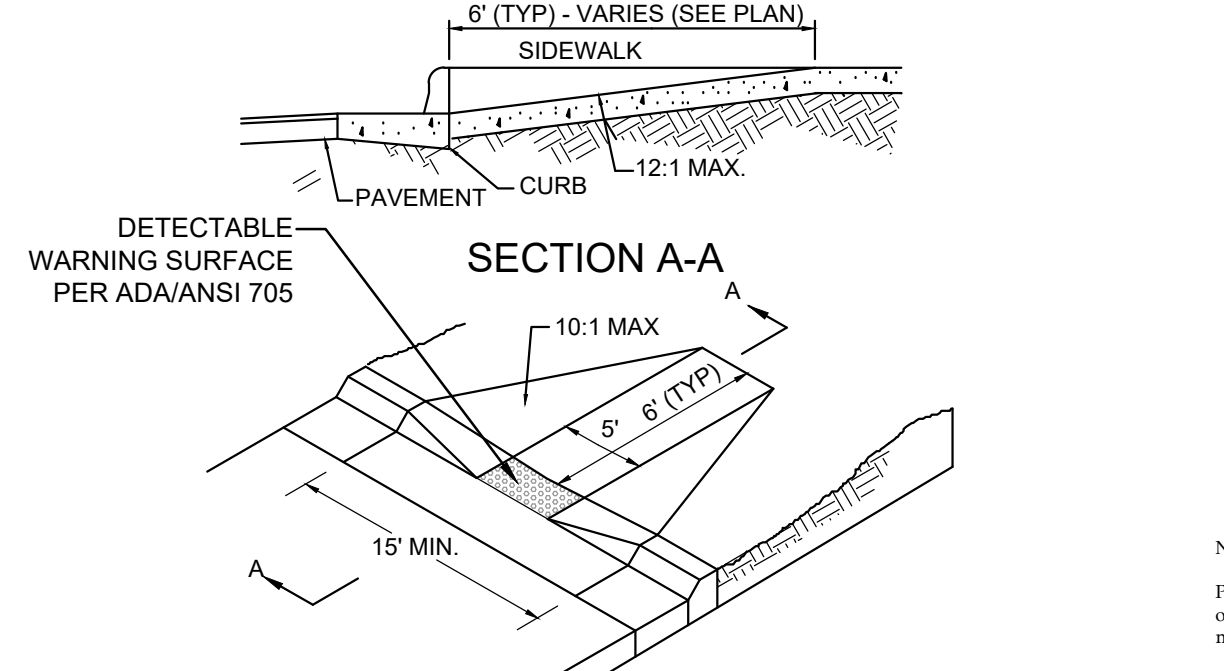

**RIP-RAP SCHEDULE**

APRON #	PIPE DIA. (IN.)	LENGTH (FT.)	UP.WIDTH (FT.)	DWN.WIDTH (FT.)	THICKNESS (IN.)
FES-100	36	13	9	9	18

**APPROVED STORMWATER MANAGEMENT PLAN**

NCDENR PWSS WATER PERMIT #: \_\_\_\_\_  
WATER CAPACITY: \_\_\_\_\_ GPD

DWQ SEWER PERMIT #: \_\_\_\_\_  
SEWER CAPACITY: \_\_\_\_\_ GPD

SEWER SHED # AND PLANT: \_\_\_\_\_  
SEWER TO FLOW THROUGH NEI: YES or NO (CIRCLE ONE)





For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.

**Approved Construction Plan**  
Name: \_\_\_\_\_ Date: \_\_\_\_\_









Planning \_\_\_\_\_  
Traffic \_\_\_\_\_  
Fire \_\_\_\_\_

City of Wilmington  
Public Services • Engineering Division

Signed: \_\_\_\_\_

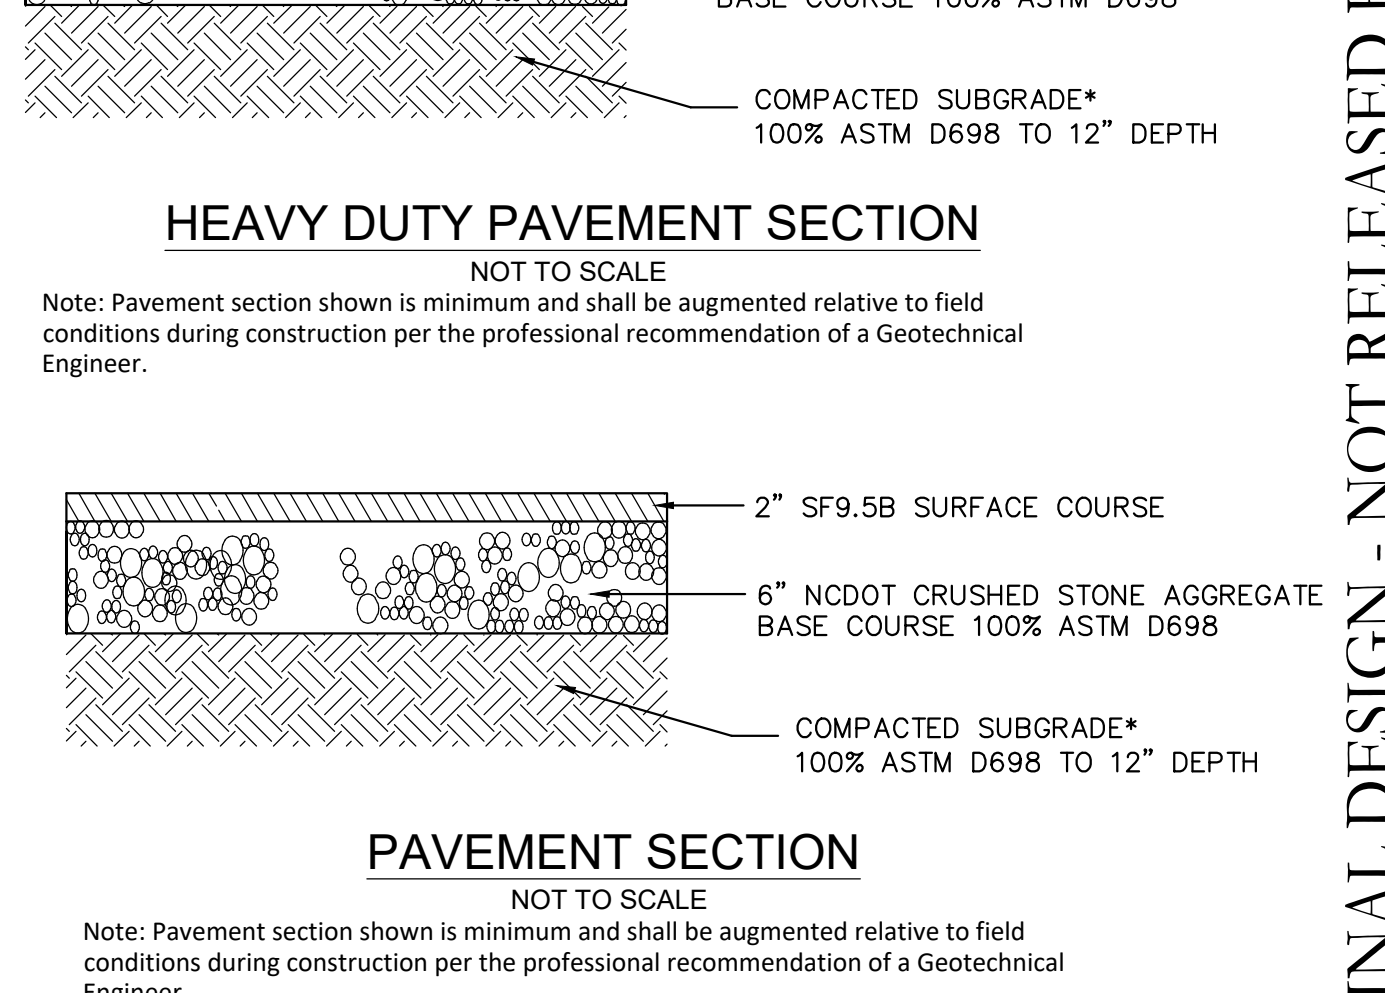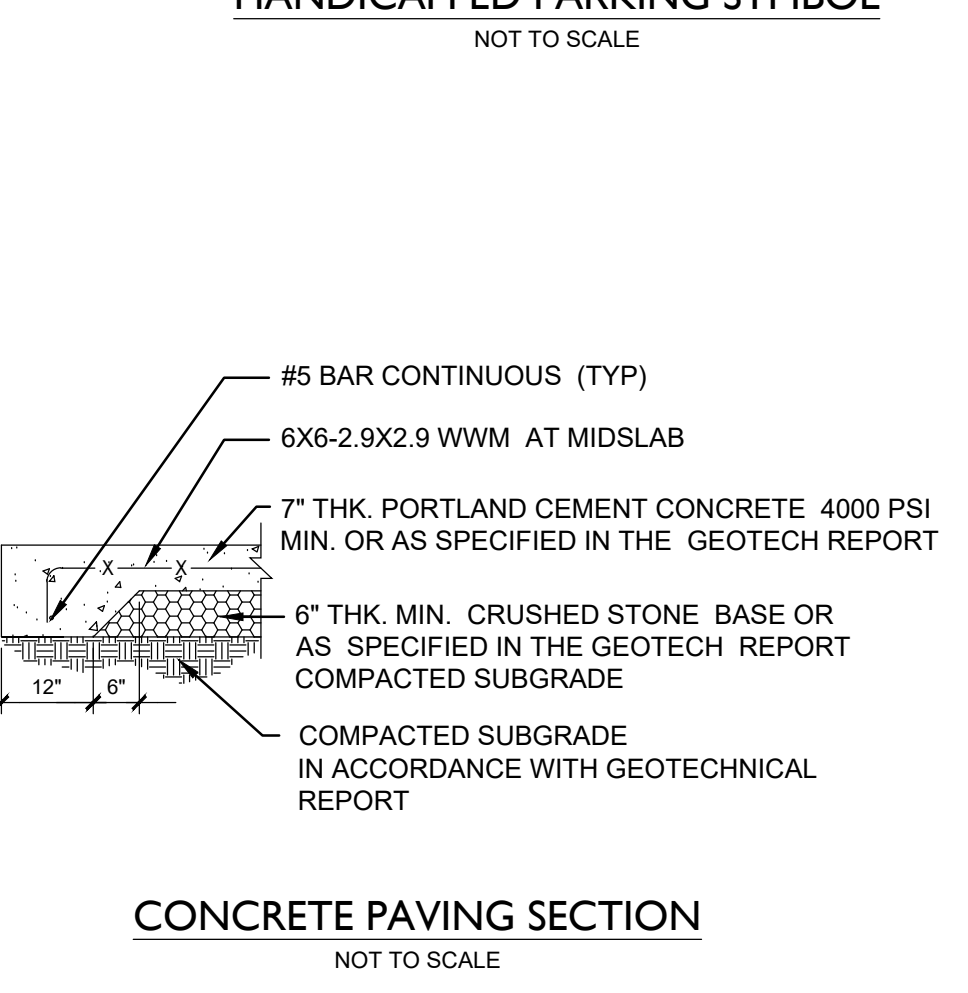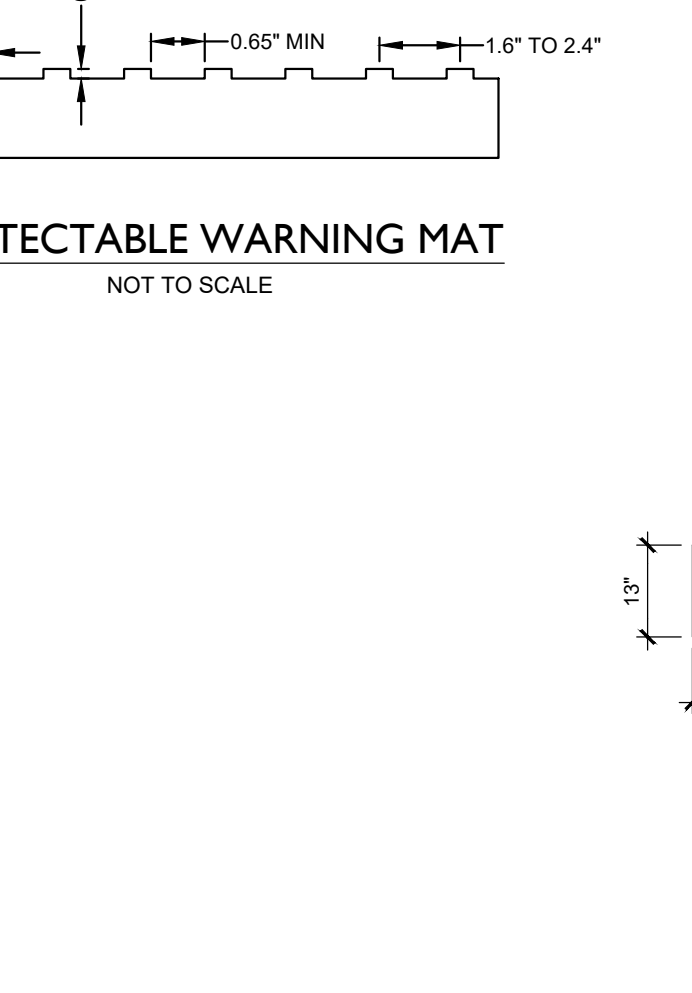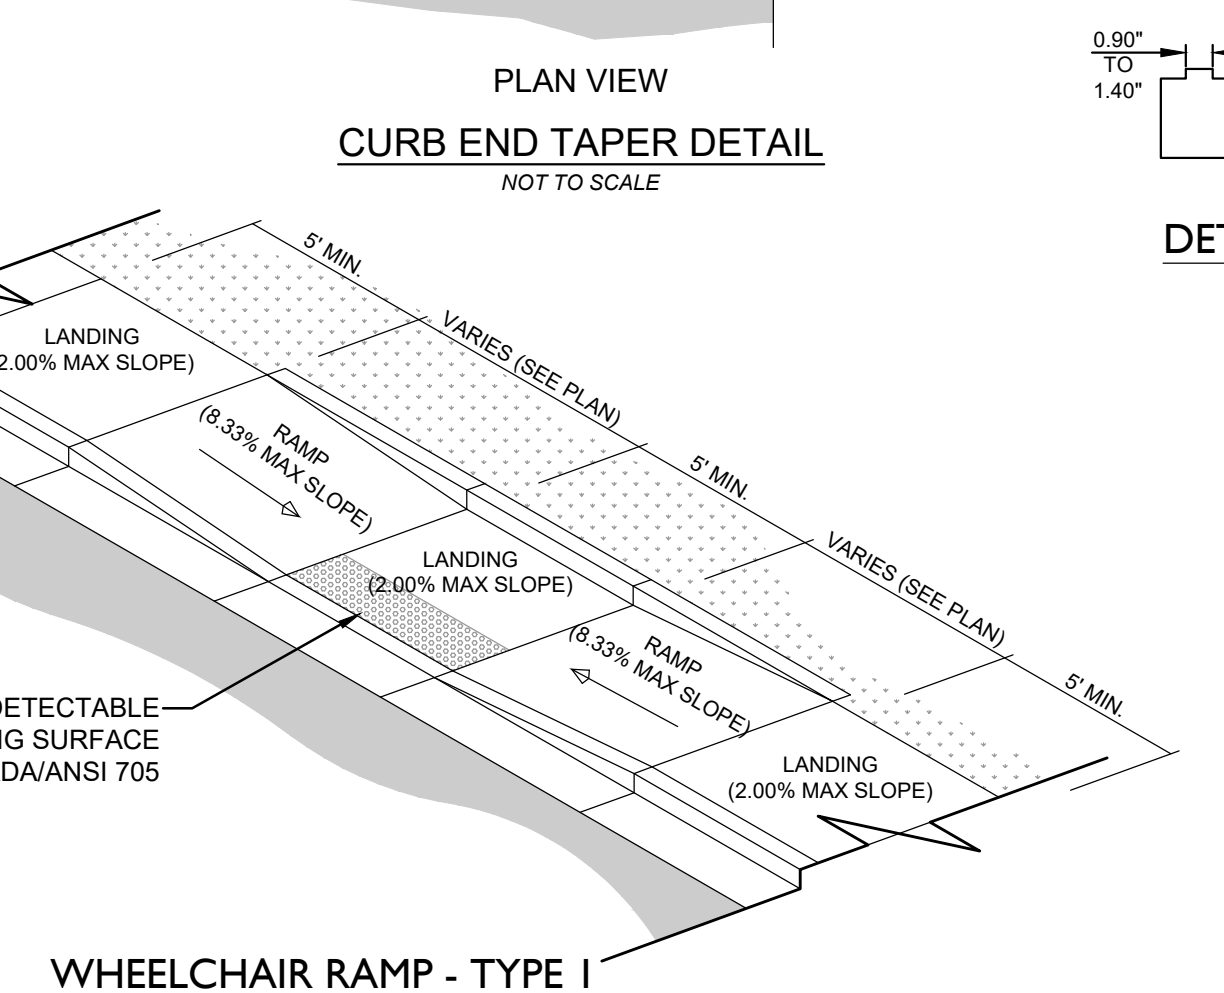




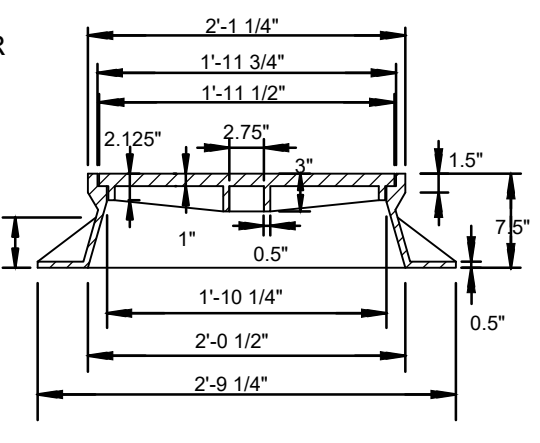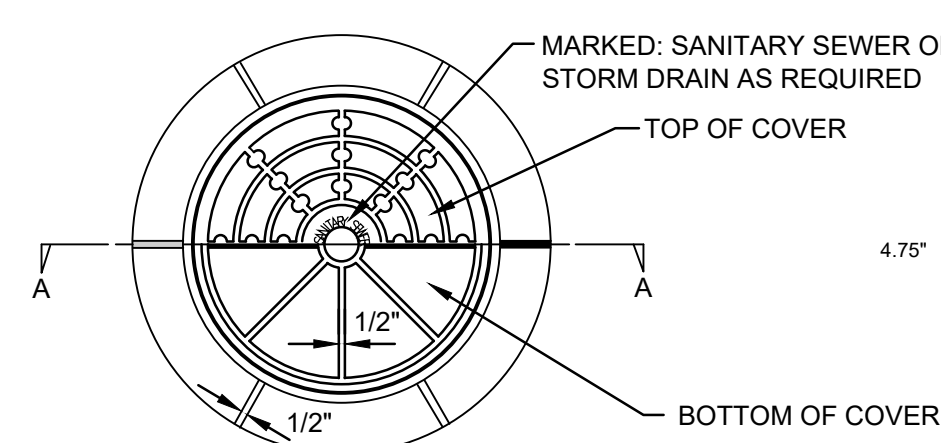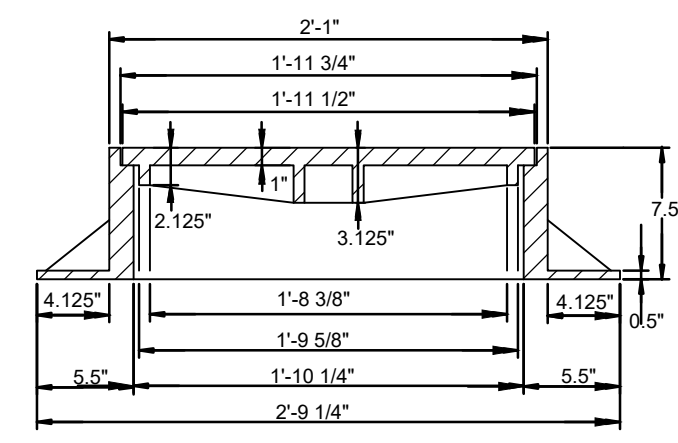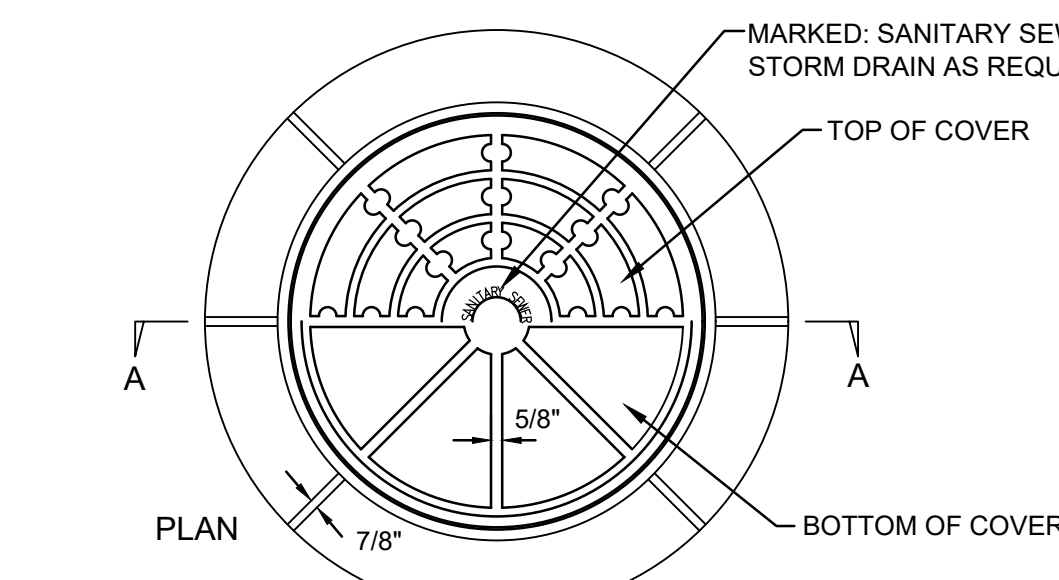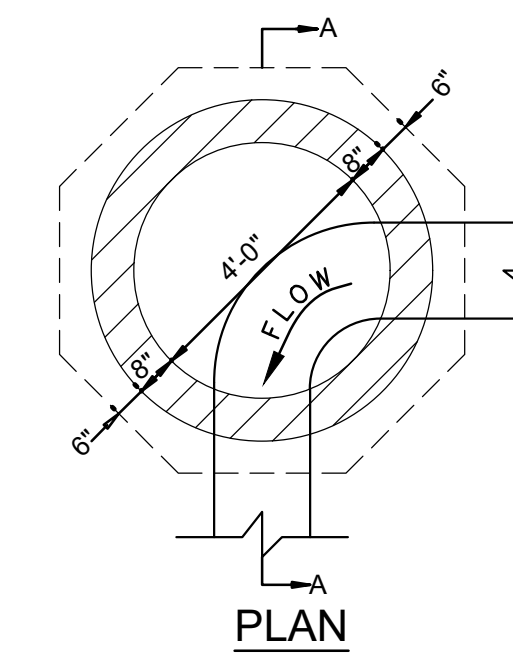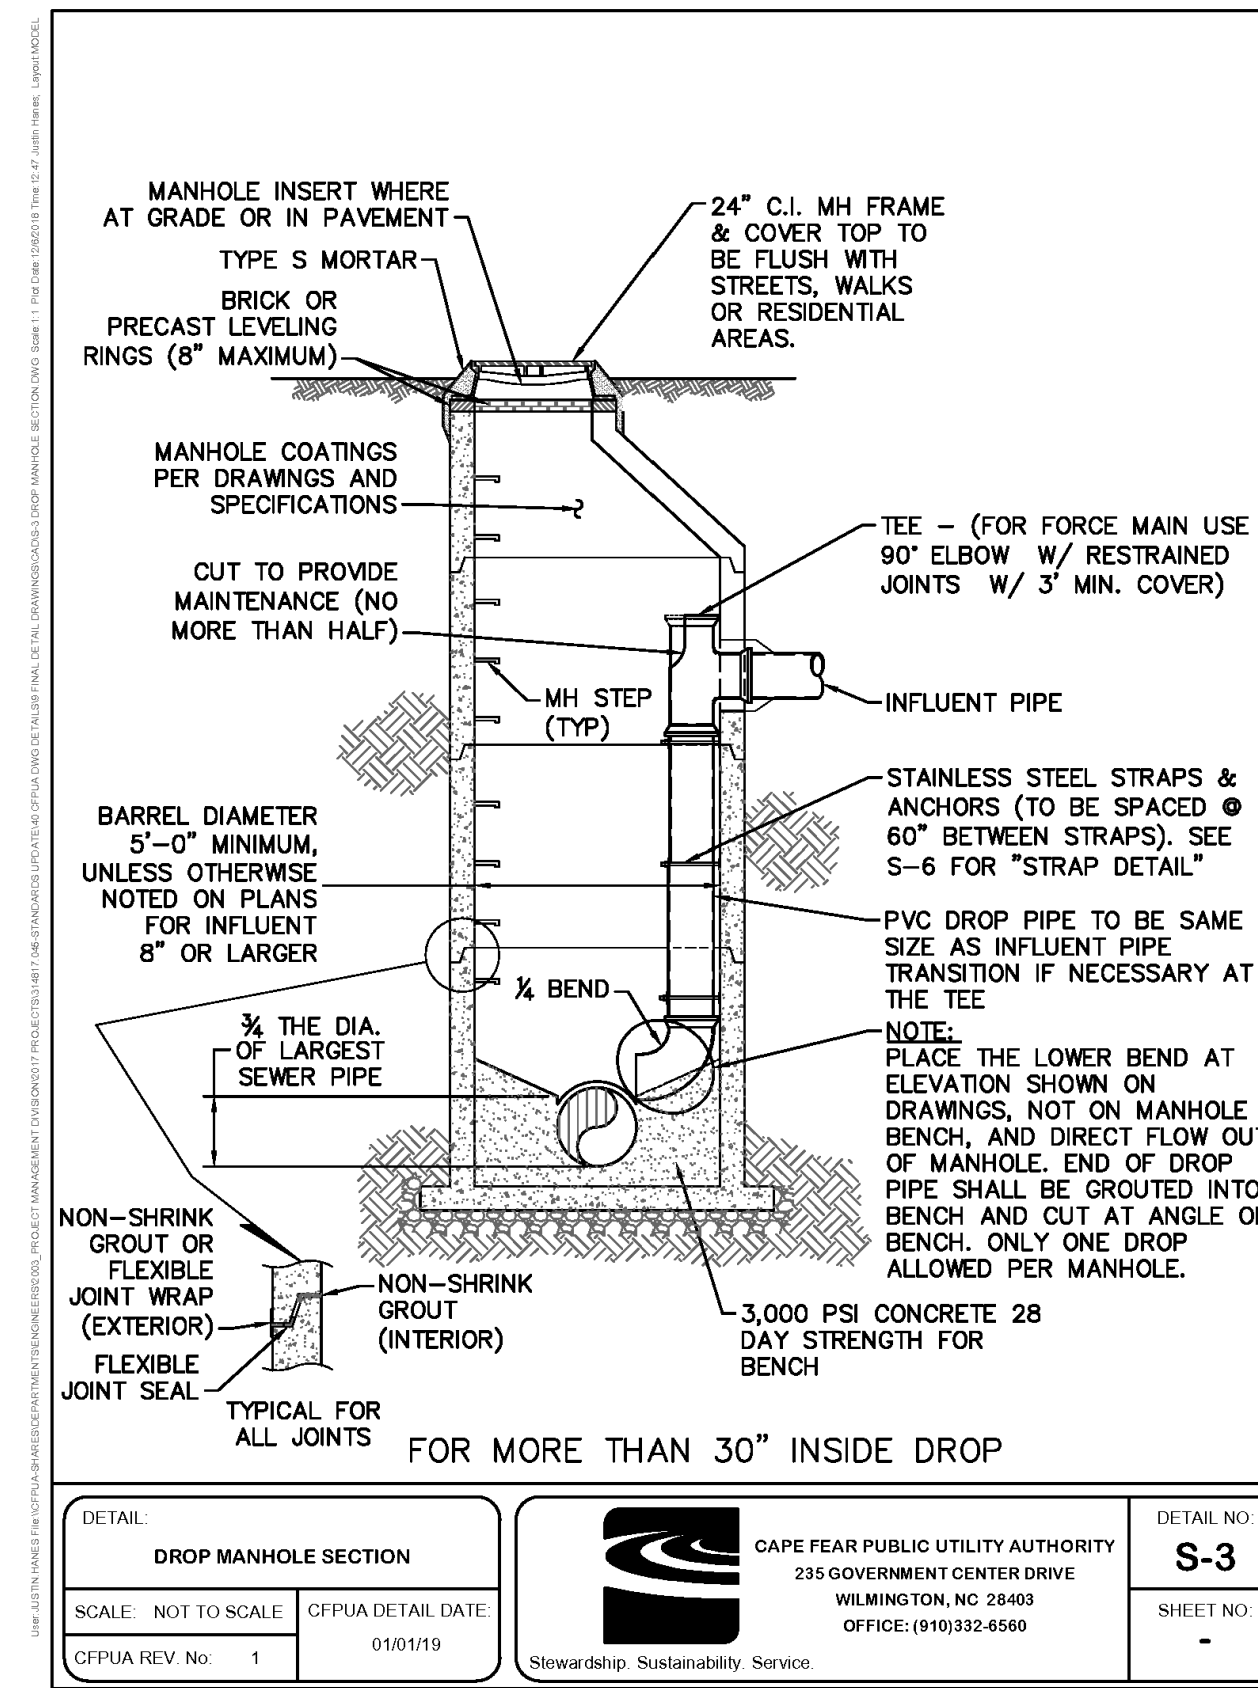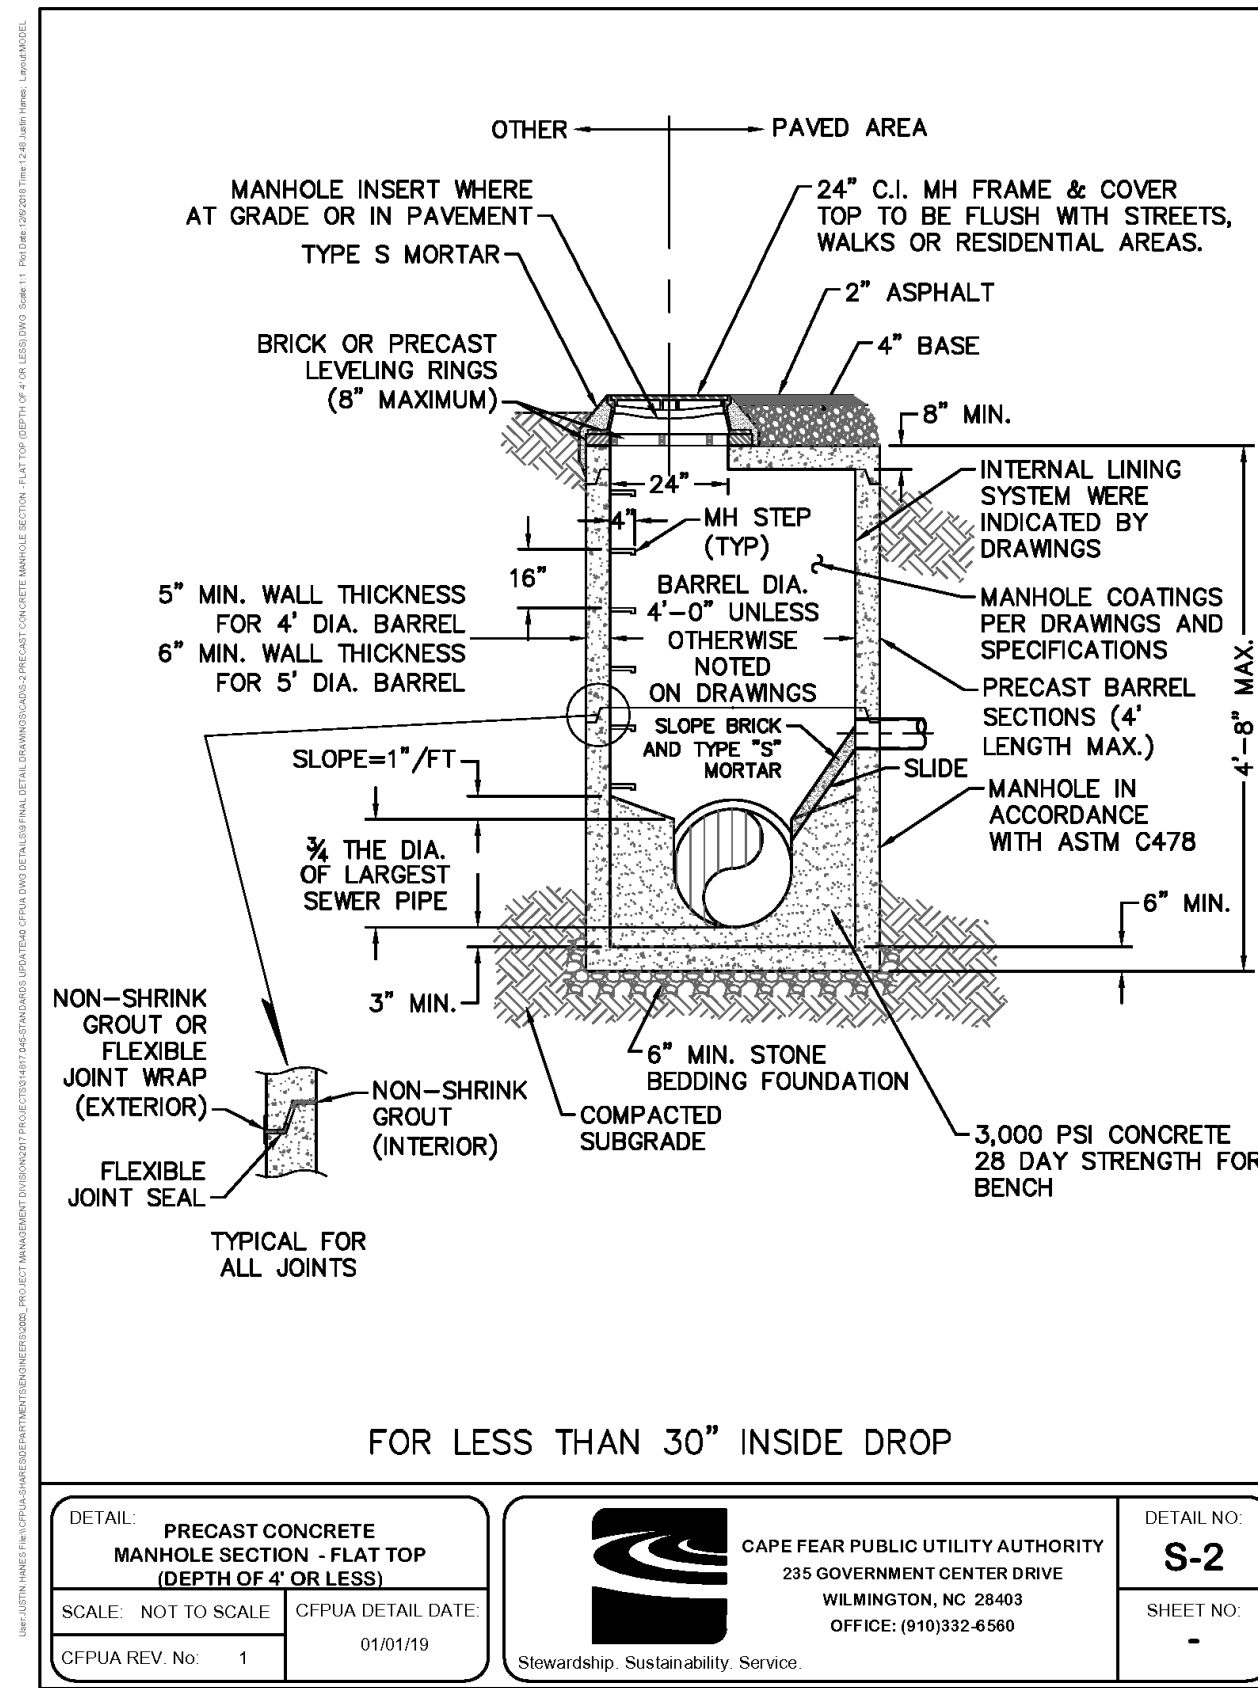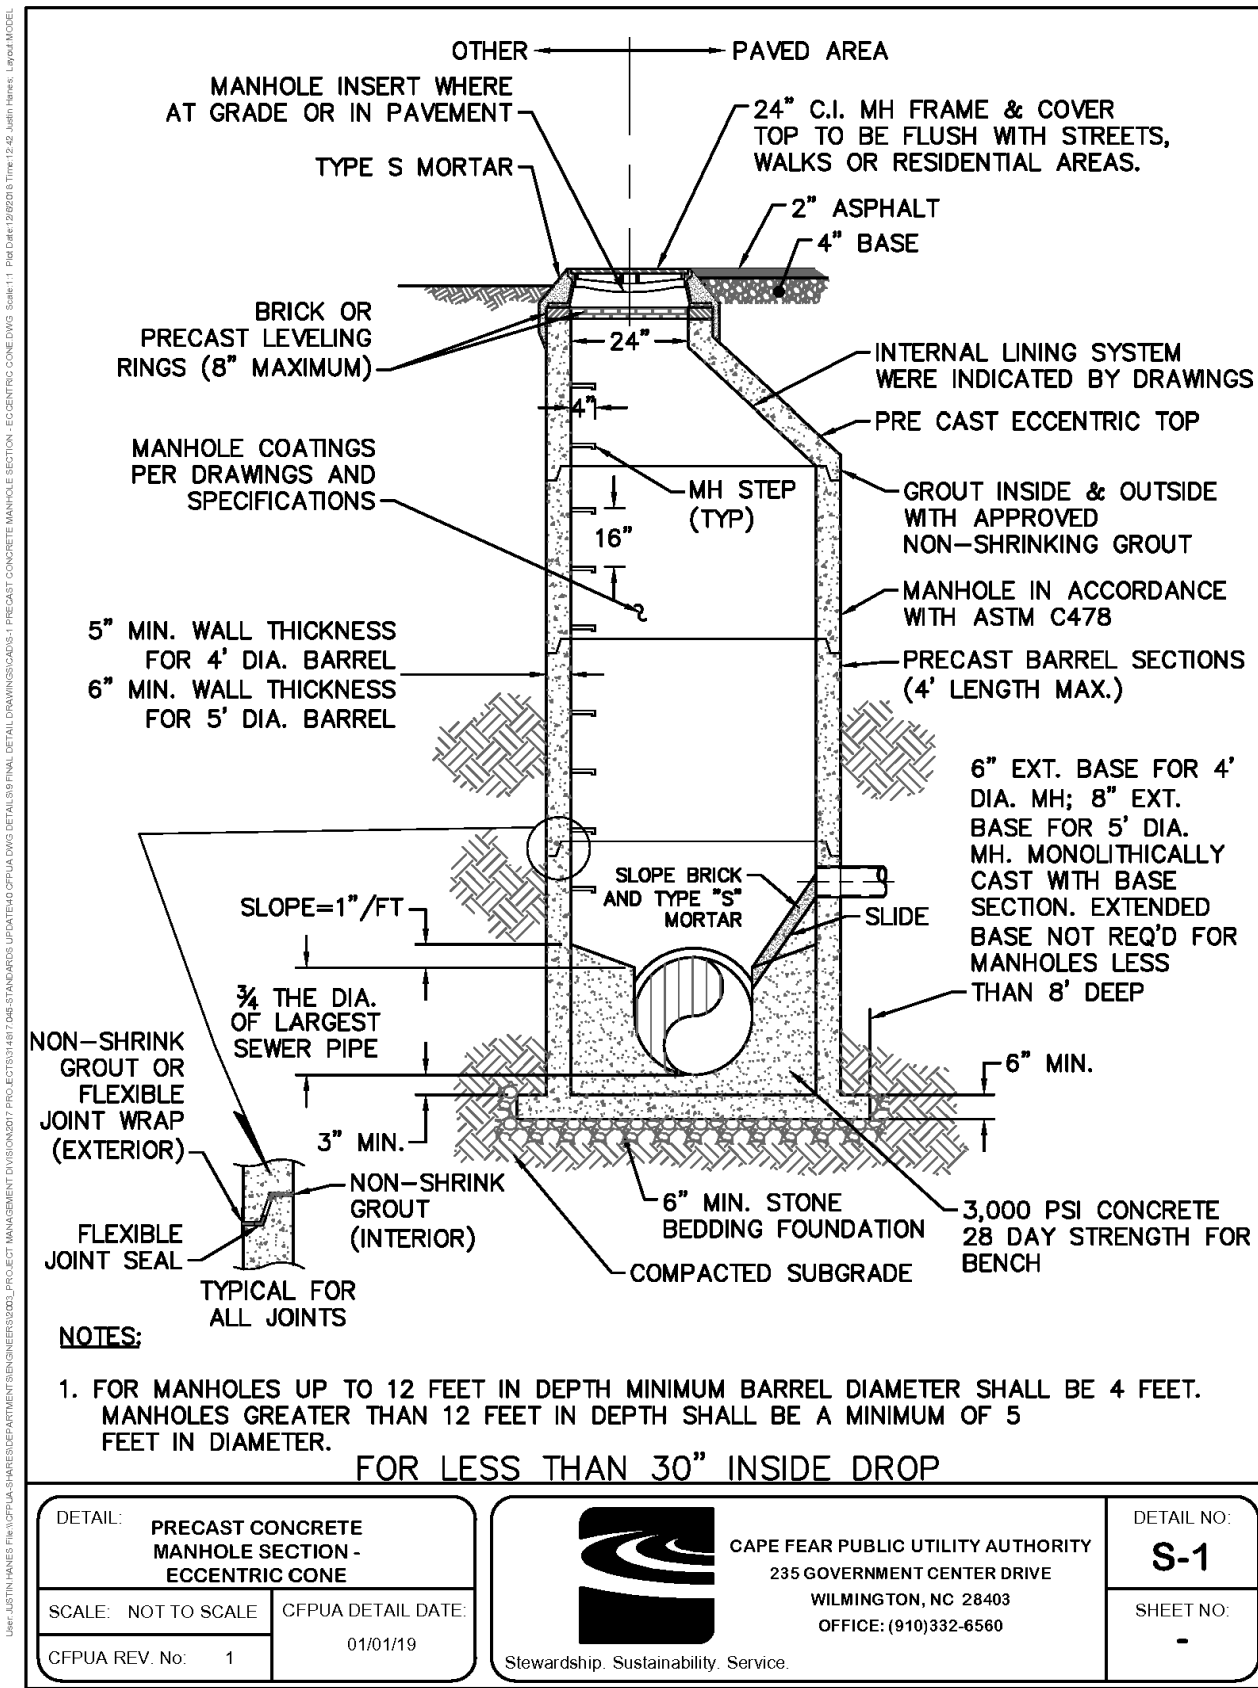

RING & COVER CONTACT SURFACES SHALL BE MACHINED TO INSURE EVEN BEARING OF COVER AND RING

MINIMUM WEIGHTS:  
RING 190 LBS.  
COVER 120 LBS.

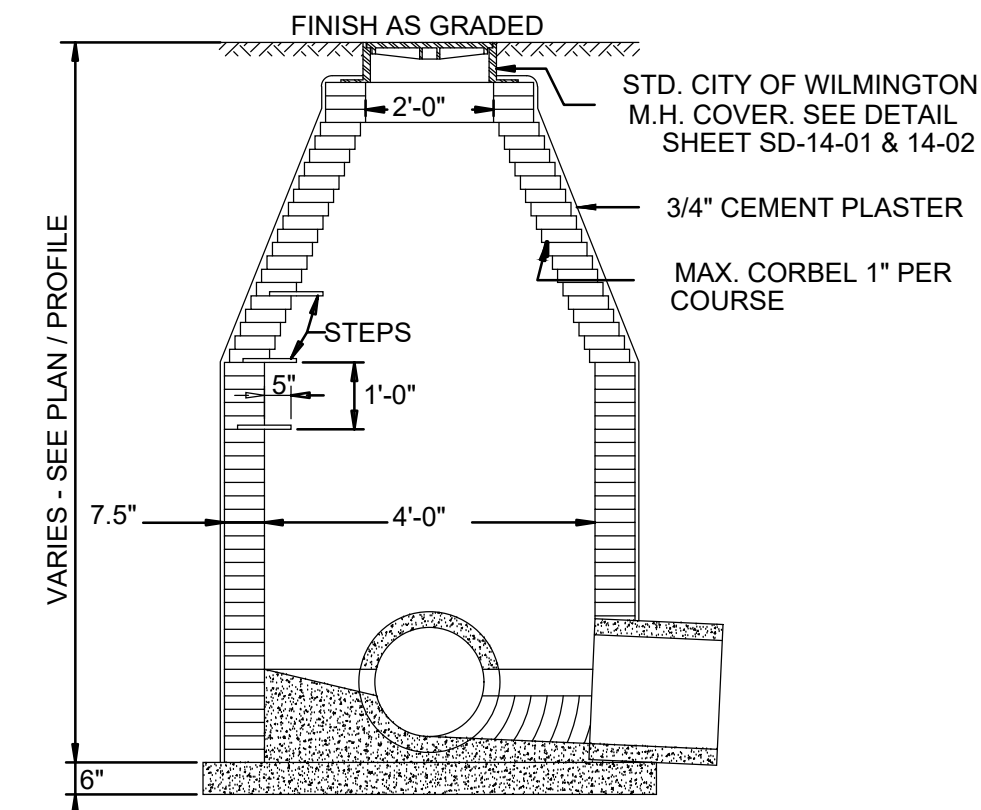

GUIDELINES FOR STORM DRAIN MANHOLE SD 2-03

NOTE:  
RING & COVER CONTACT SURFACES SHALL BE MACHINED TO INSURE EVEN BEARING OF COVER AND RING

MINIMUM WEIGHTS:  
RING 261 LBS.  
COVER 120 LBS.

STANDARD MANHOLE RING & COVER SD 14-02 NOT TO SCALE

STANDARD MANHOLE RING AND COVER SD 14-01 NOT TO SCALE

NCDENR PWSS WATER PERMIT #: \_\_\_\_\_  
 WATER CAPACITY: \_\_\_\_\_ GPD  
 DWQ SEWER PERMIT #: \_\_\_\_\_  
 SEWER CAPACITY: \_\_\_\_\_ GPD  
 SEWER SHED # AND PLANT: \_\_\_\_\_  
 SEWER TO FLOW THROUGH NEI: YES OR NO (CIRCLE ONE)

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.

Public Services • Engineering Division  
 APPROVED STORMWATER MANAGEMENT PLAN  
 Date: \_\_\_\_\_ Permit # \_\_\_\_\_  
 Signed: \_\_\_\_\_

Approved Construction Plan  
 Name \_\_\_\_\_ Date \_\_\_\_\_  
 Planning \_\_\_\_\_  
 Traffic \_\_\_\_\_  
 Fire \_\_\_\_\_

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

REVISIONS:

CLIENT INFORMATION:  
 FOOD BANK OF CENTRAL & EASTERN NORTH CAROLINA  
 1924 CAPITAL BLVD.  
 RALEIGH, NC 27604

PARAMOUNT ENGINEERING INC.  
 122 Cinema Drive  
 Wilmington, North Carolina 28403  
 (910) 791-6707 (O) (910) 791-6766 (F)  
 NC License #: C-2846





DETAILS  
 THE WILMINGTON FOOD BANK  
 GREENFIELD STREET  
 WILMINGTON, NORTH CAROLINA

PROJECT STATUS:  
 CONCEPT LAYOUT: \_\_\_\_\_  
 FINAL DESIGN LAYOUT: \_\_\_\_\_  
 RELEASED FOR CONSTRUCTION: \_\_\_\_\_

DRAWING INFORMATION:  
 DATE: 10/13/21  
 SCALE: \_\_\_\_\_  
 DRAWING: \_\_\_\_\_  
 CHECKED: \_\_\_\_\_





Professional Seal redacted on electronic copy per City of Wilmington Policy

C-6.3  
 PEI JOB#: 20484.PE

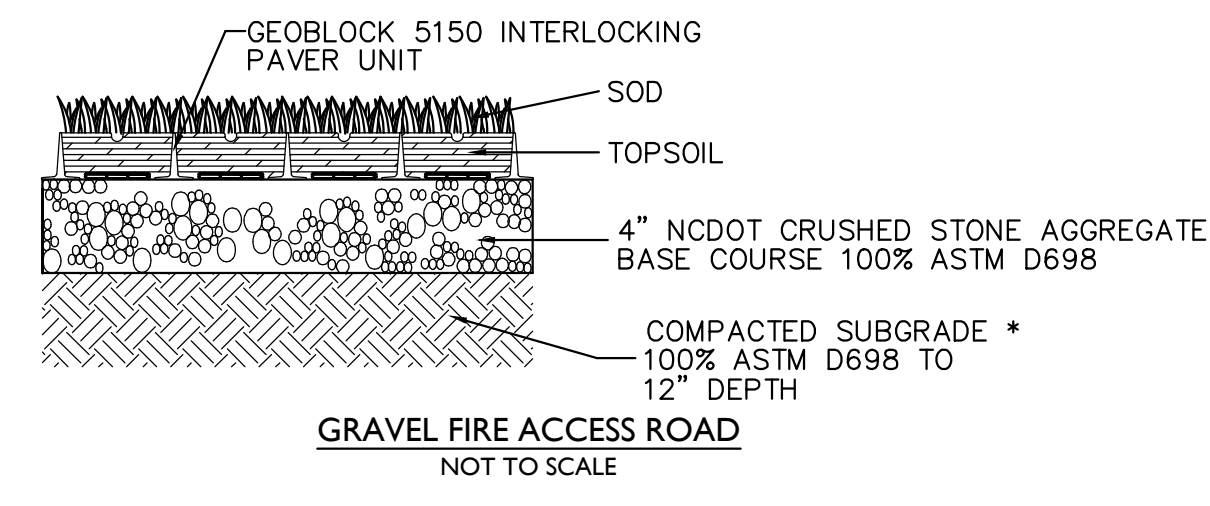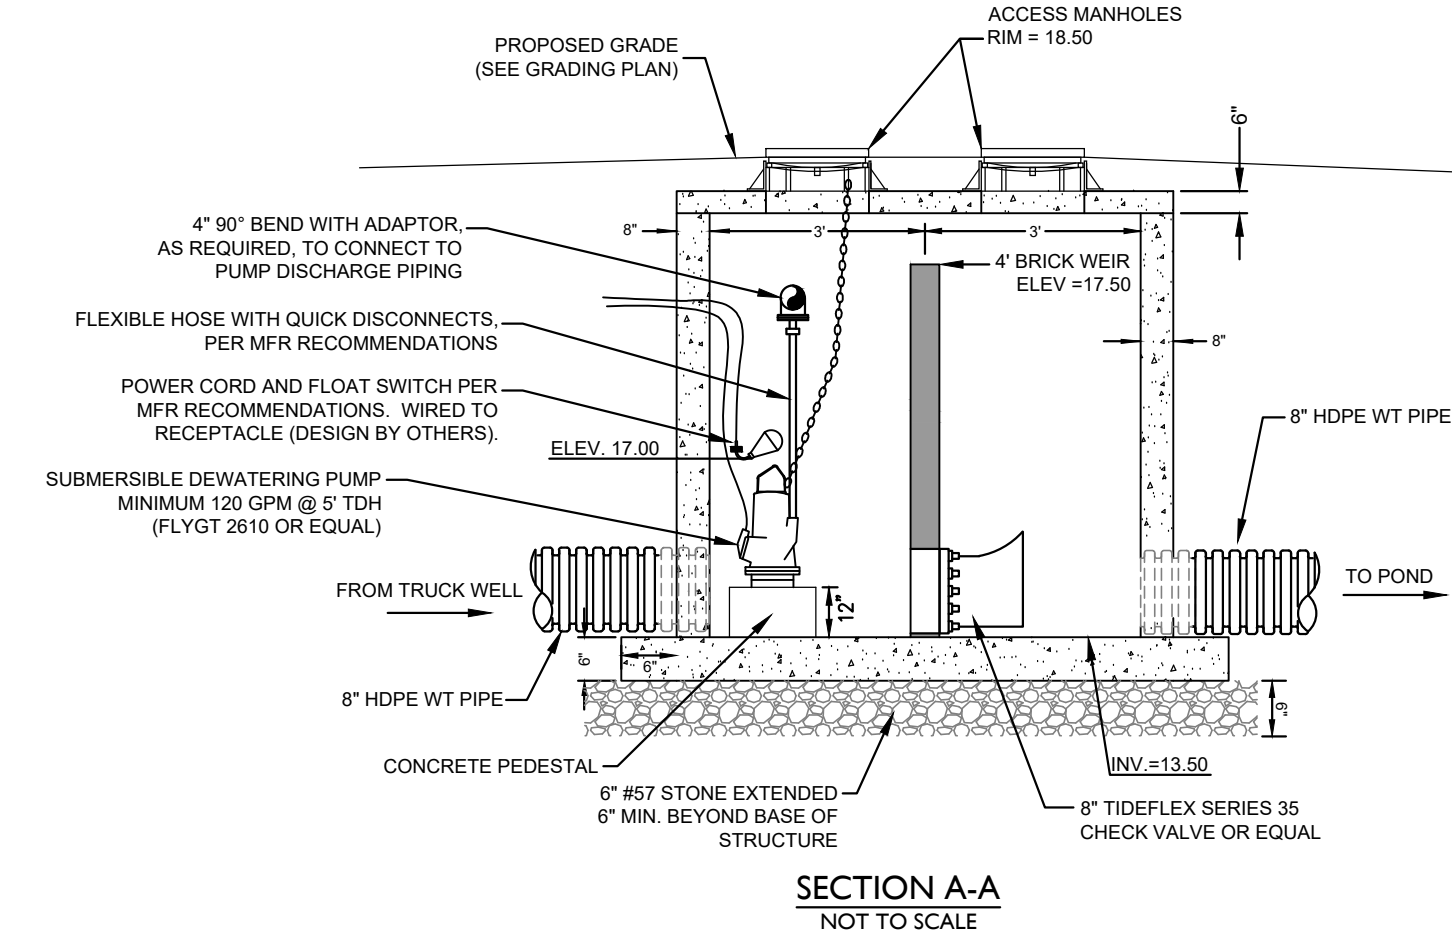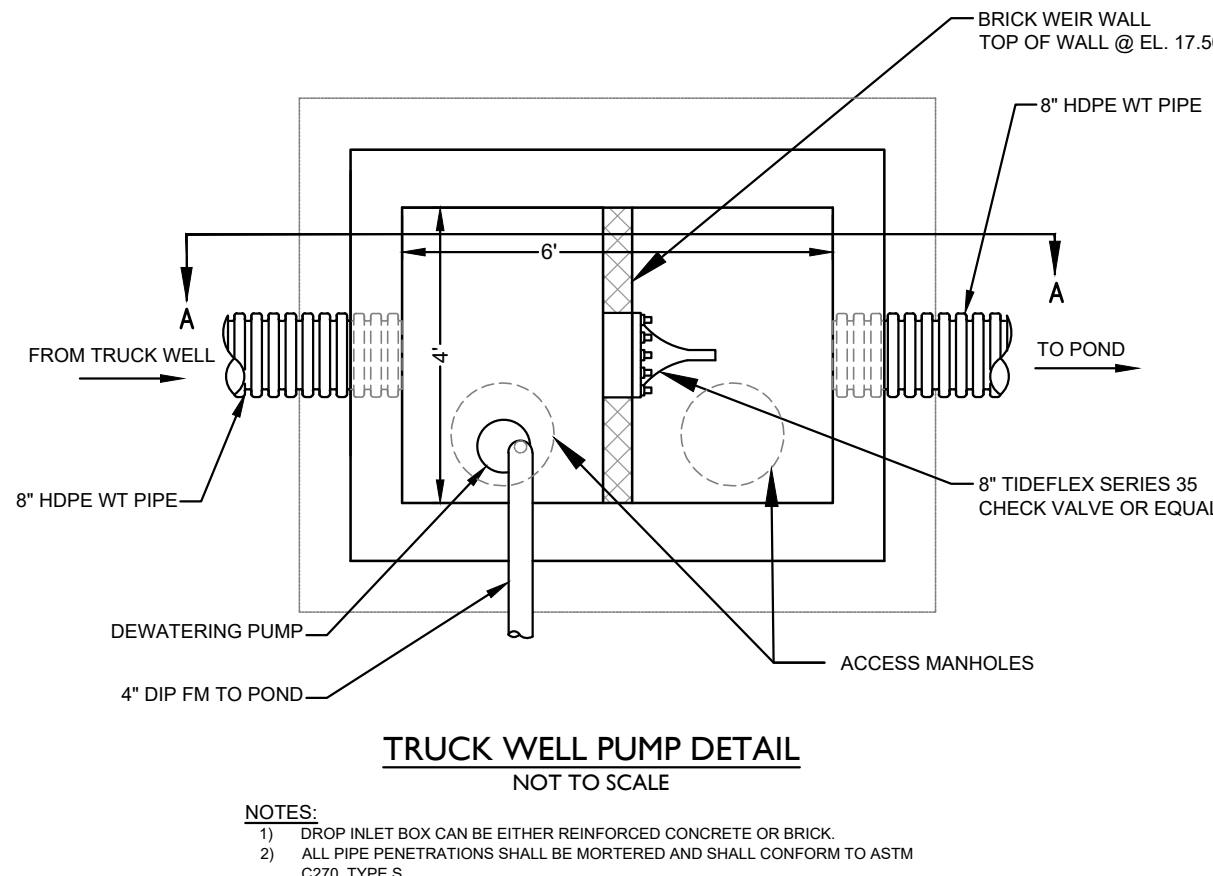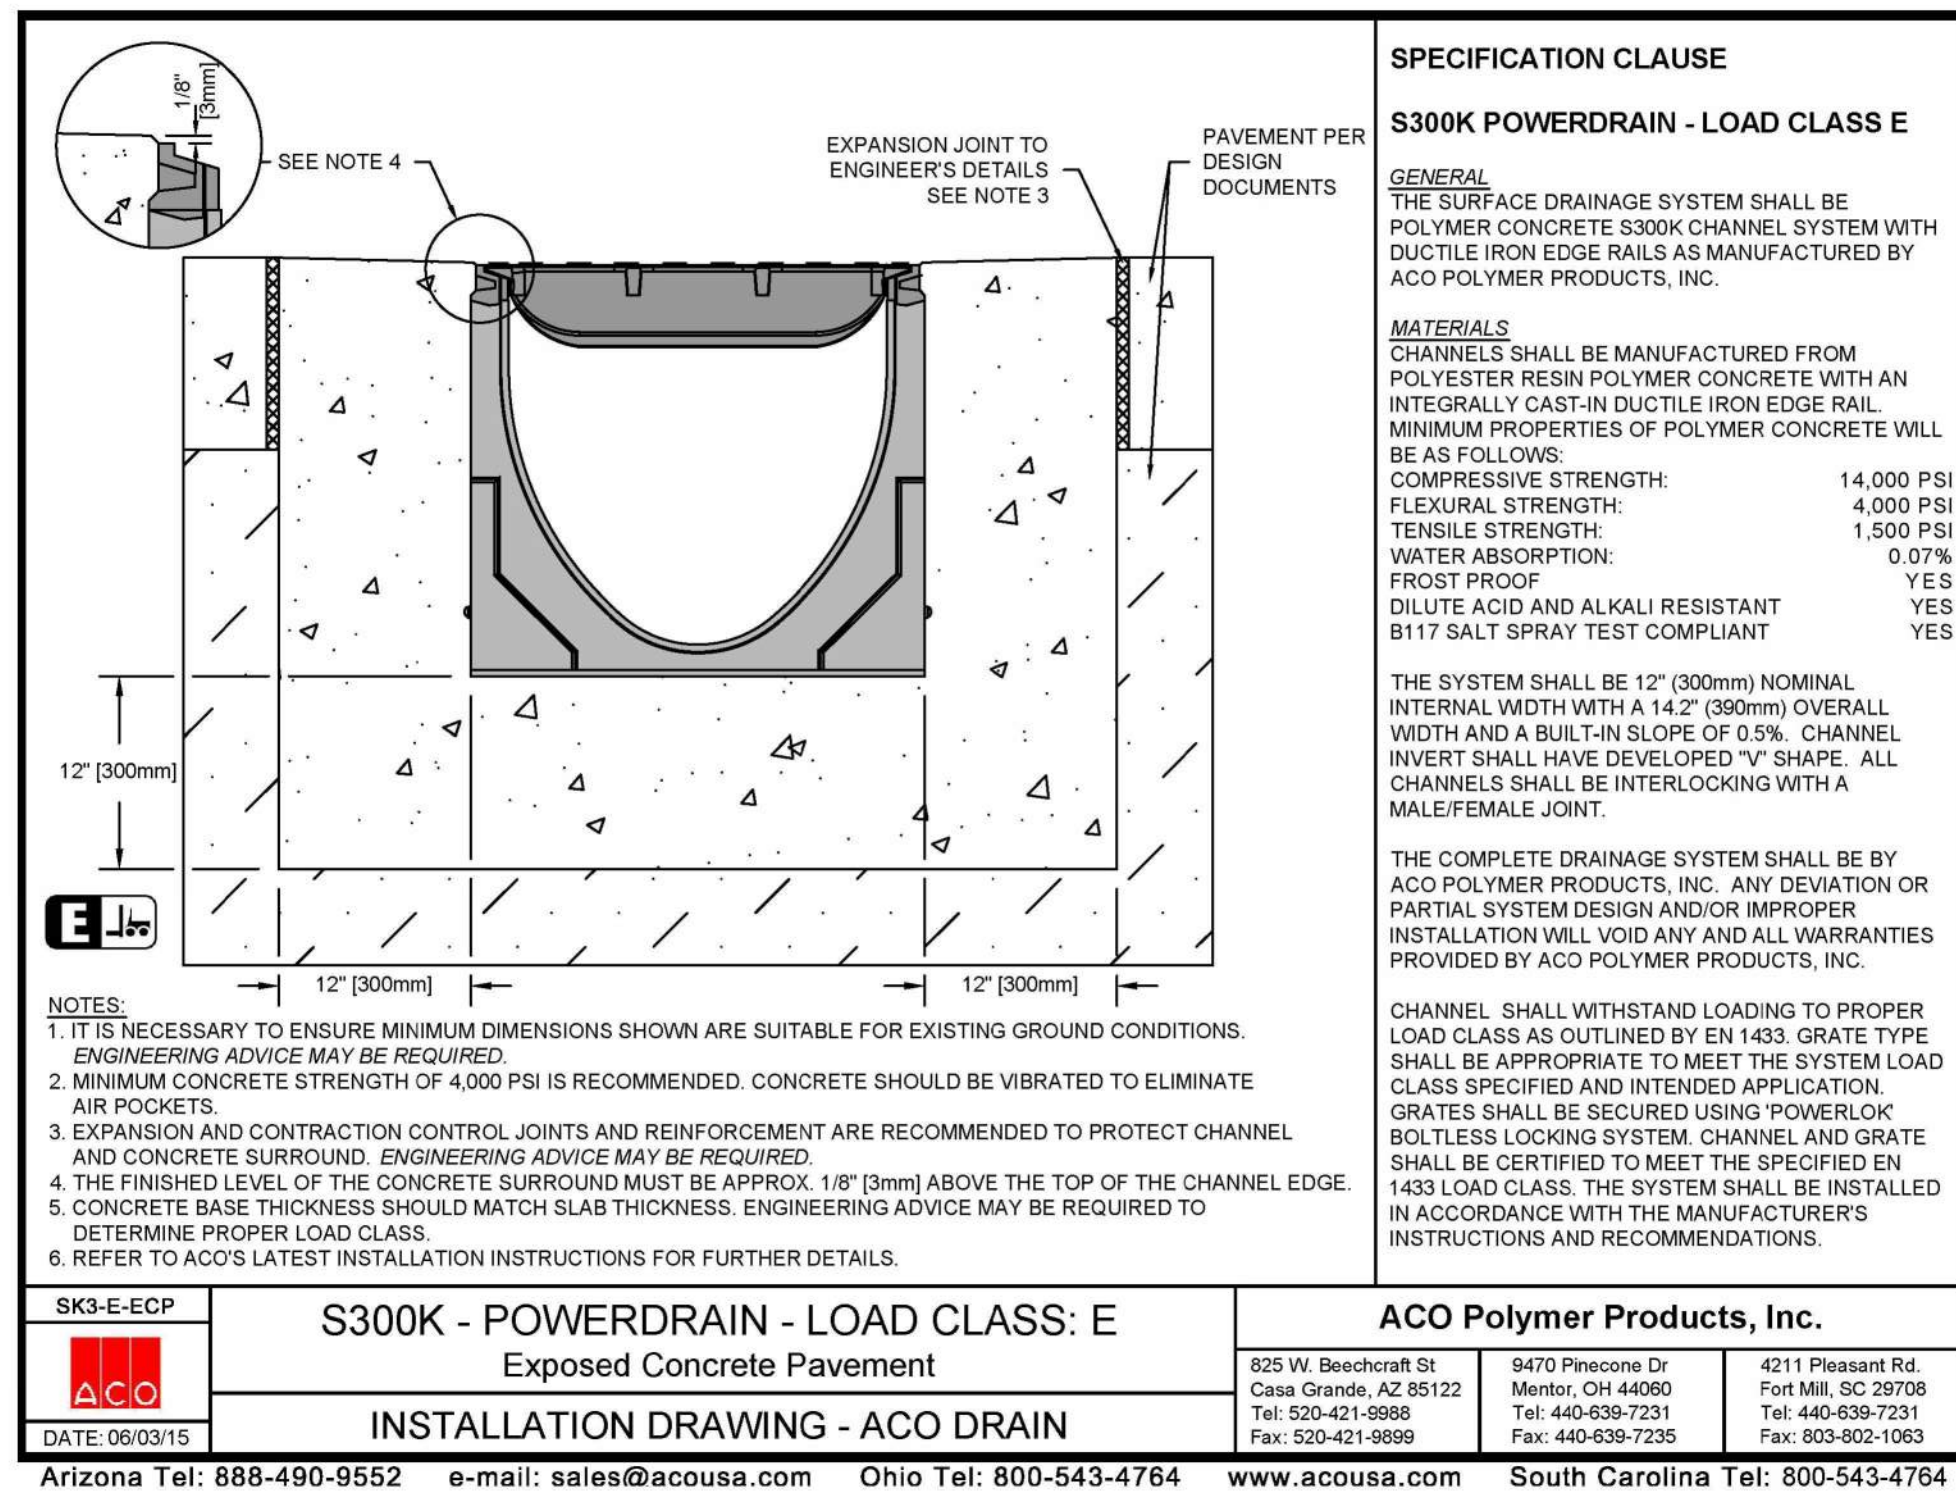

**TRENCH DRAIN DETAIL**

**NOTES:**  
 SK3-010 TO SK3-040  
 WITH SK3-040 AT END 'D' END CAP OUTLET 'D'

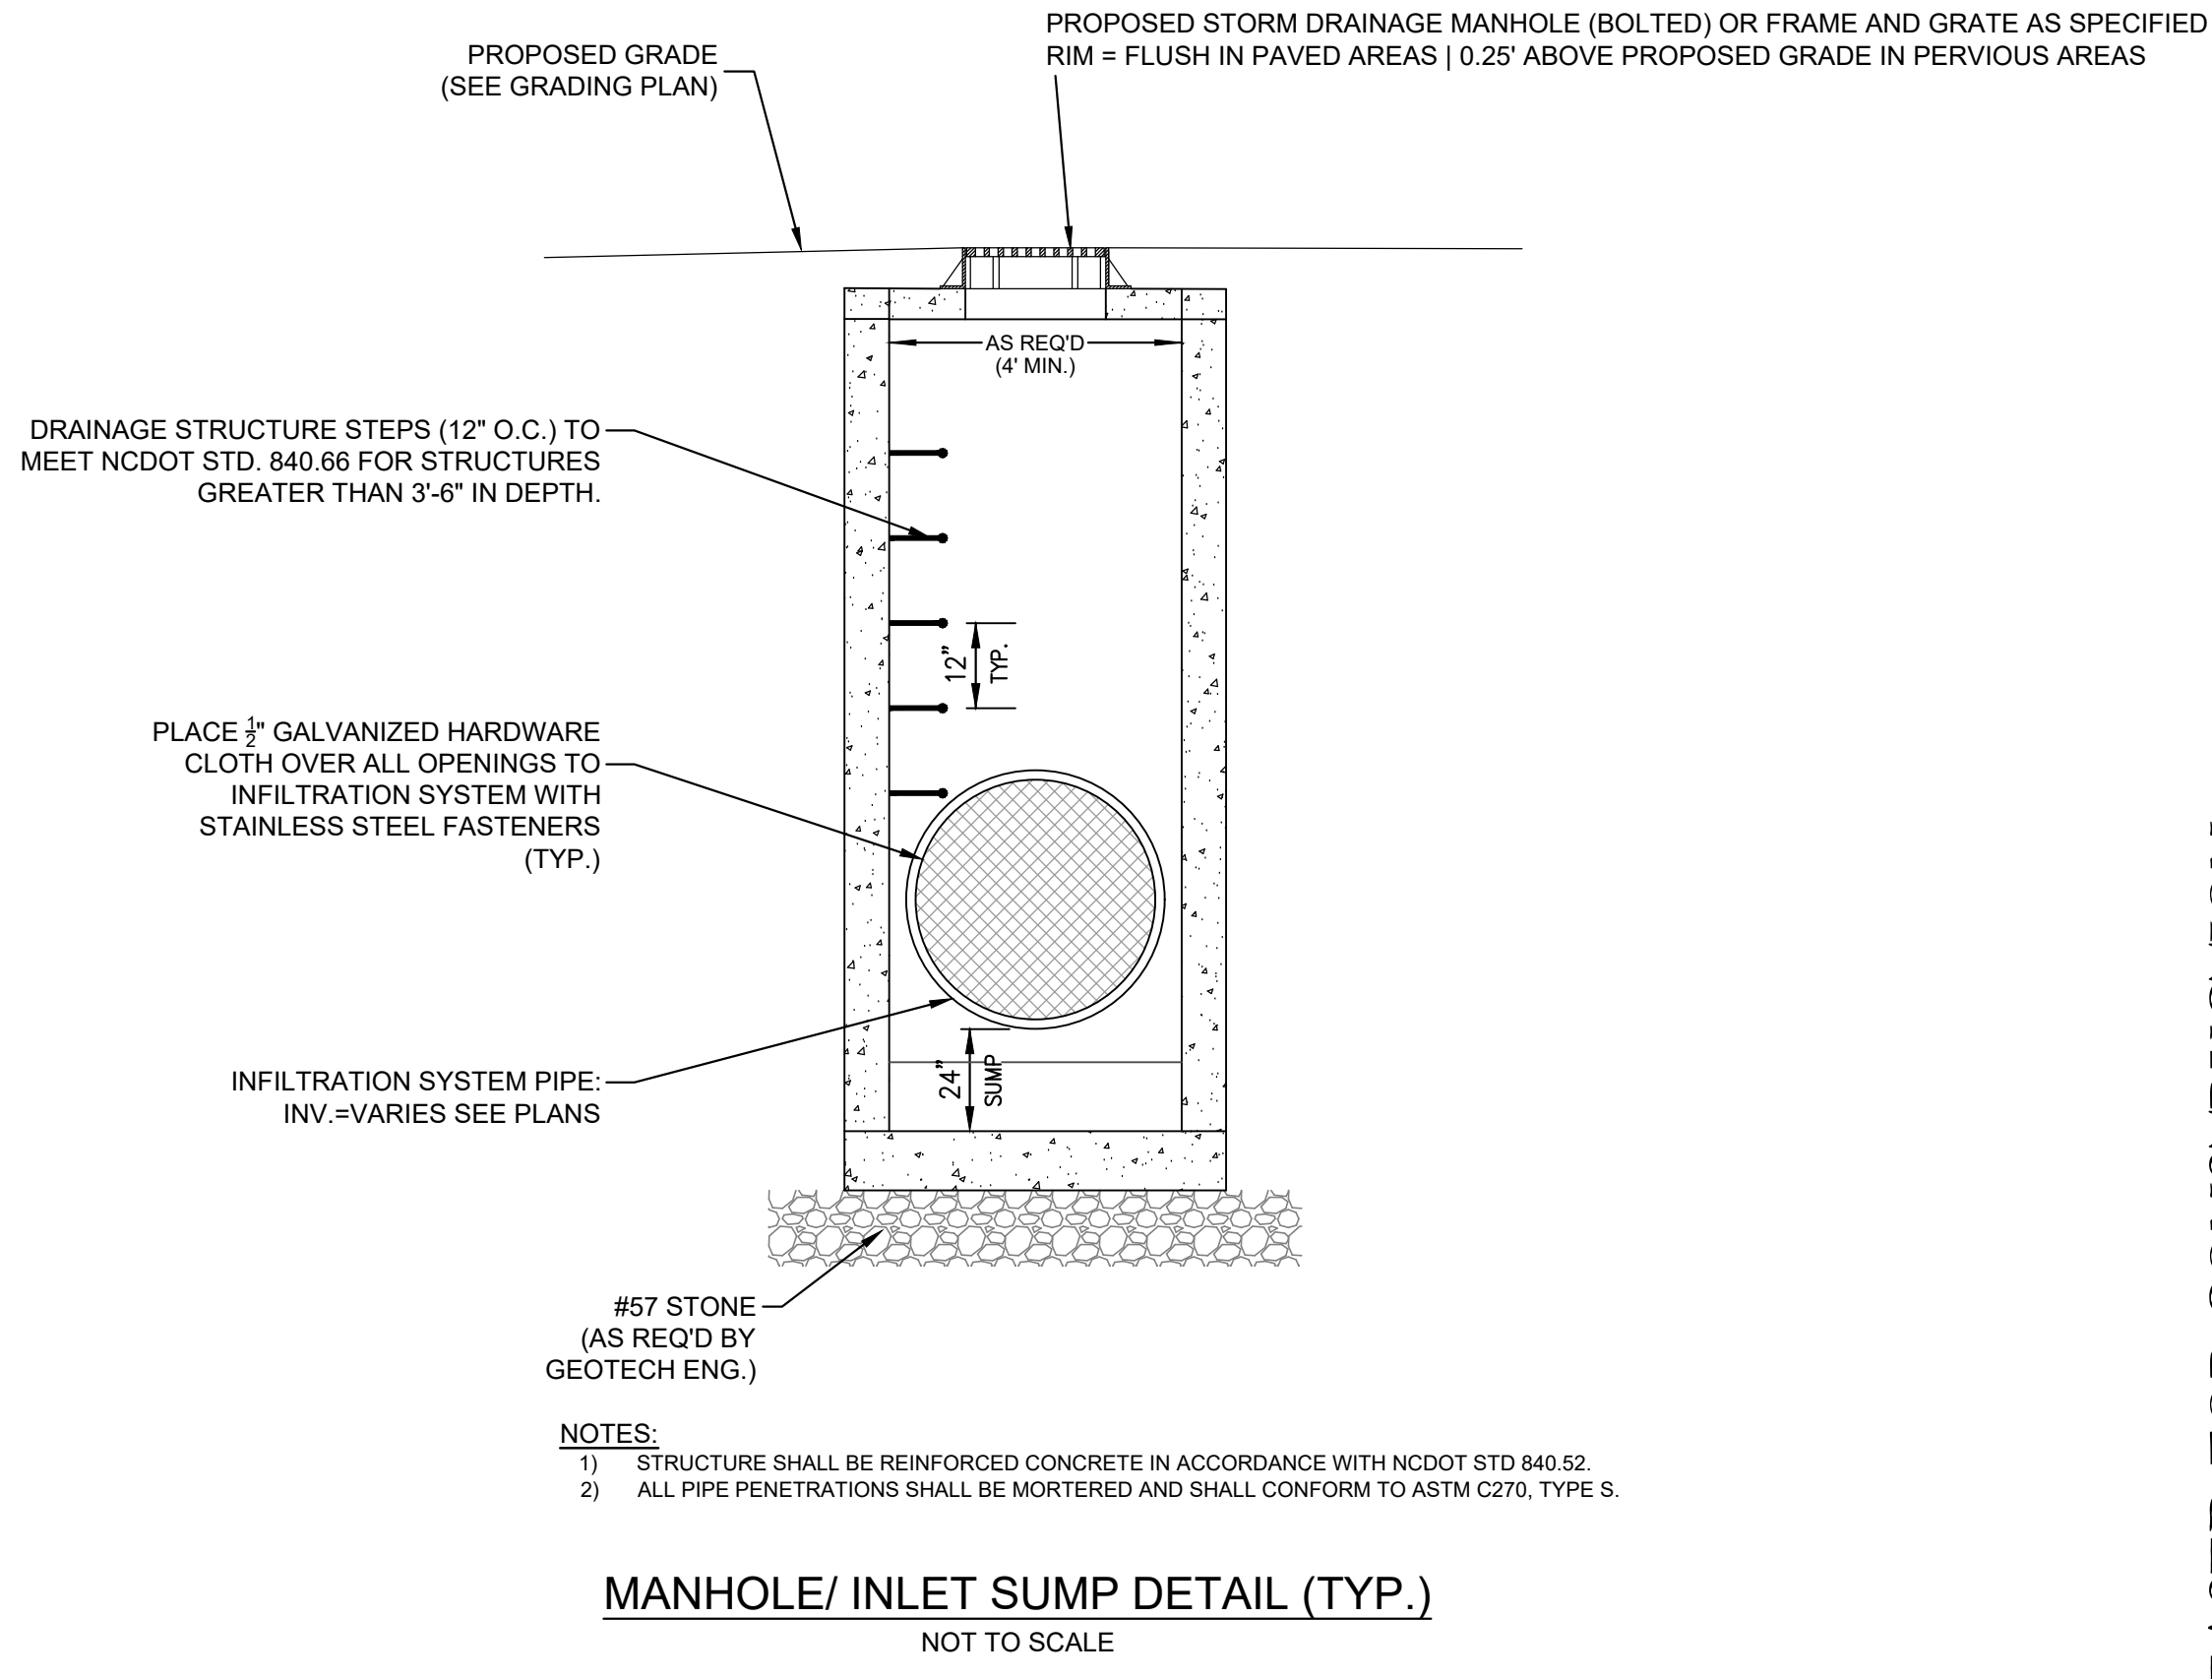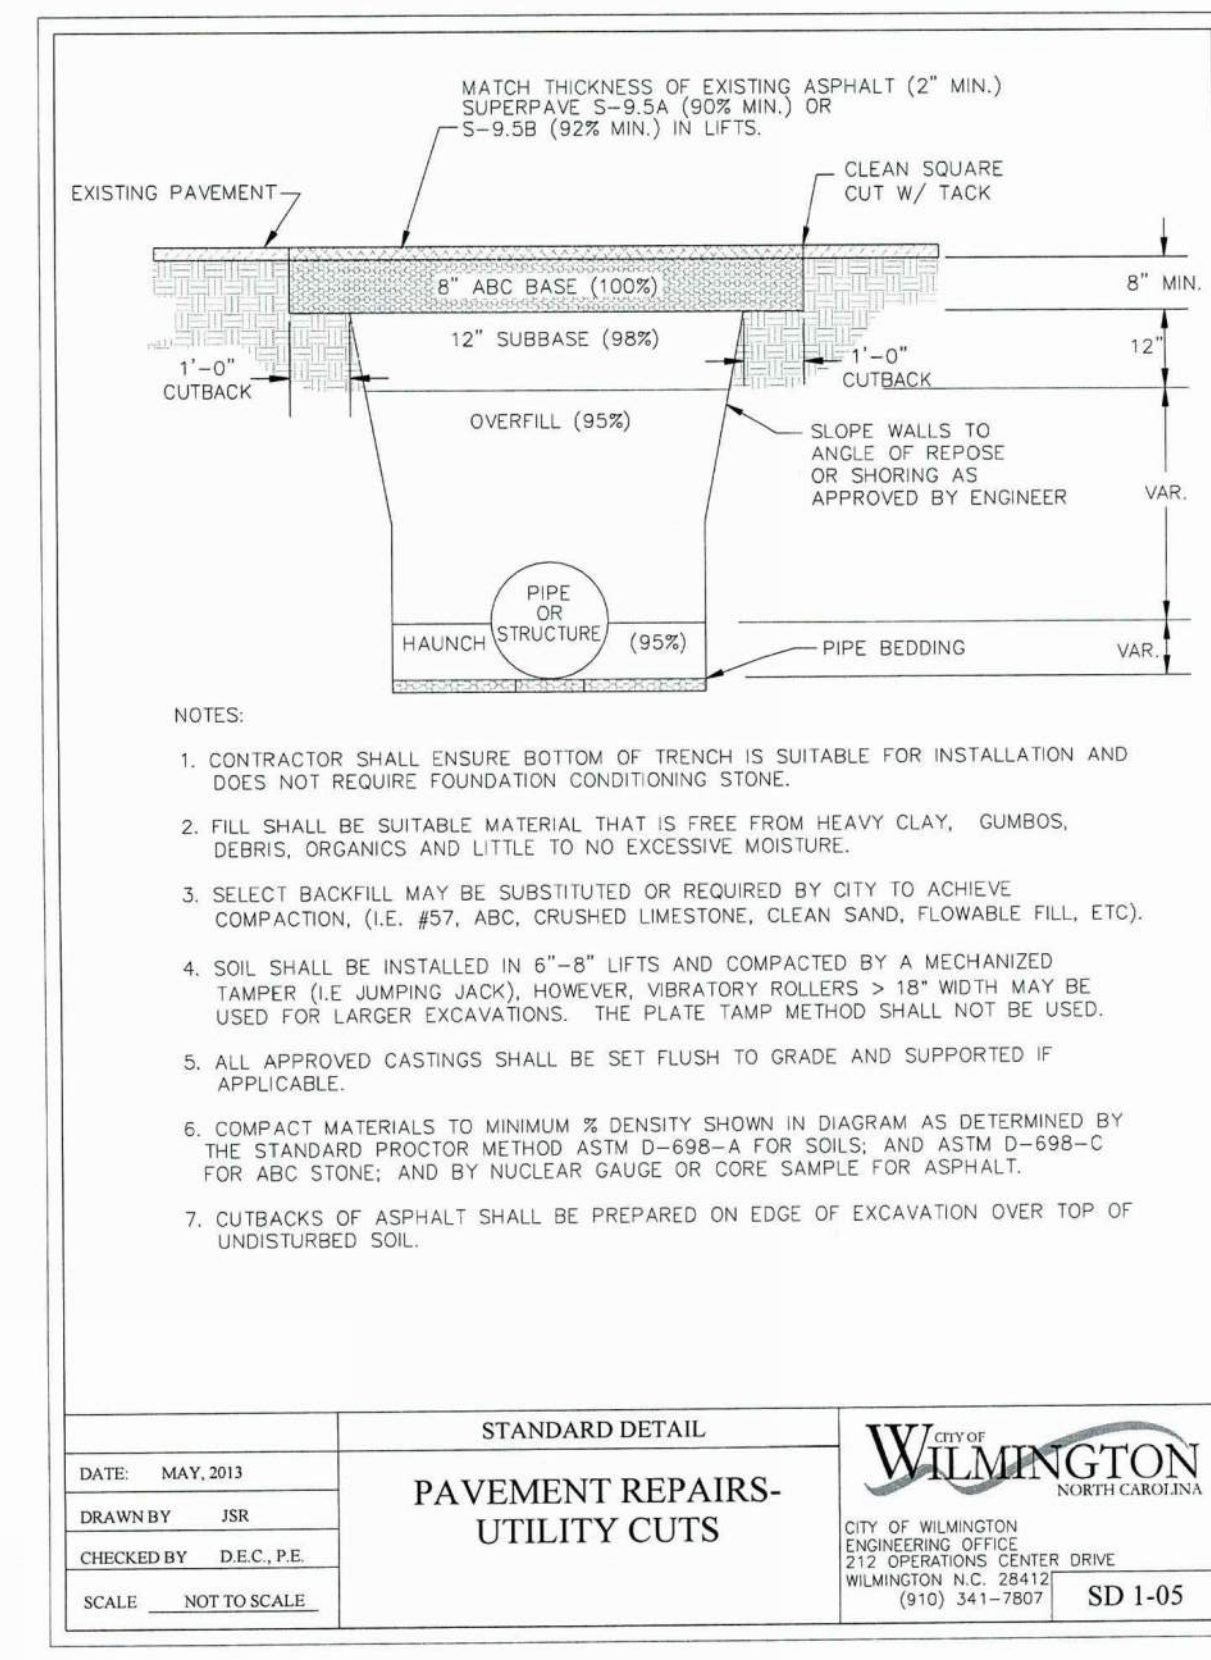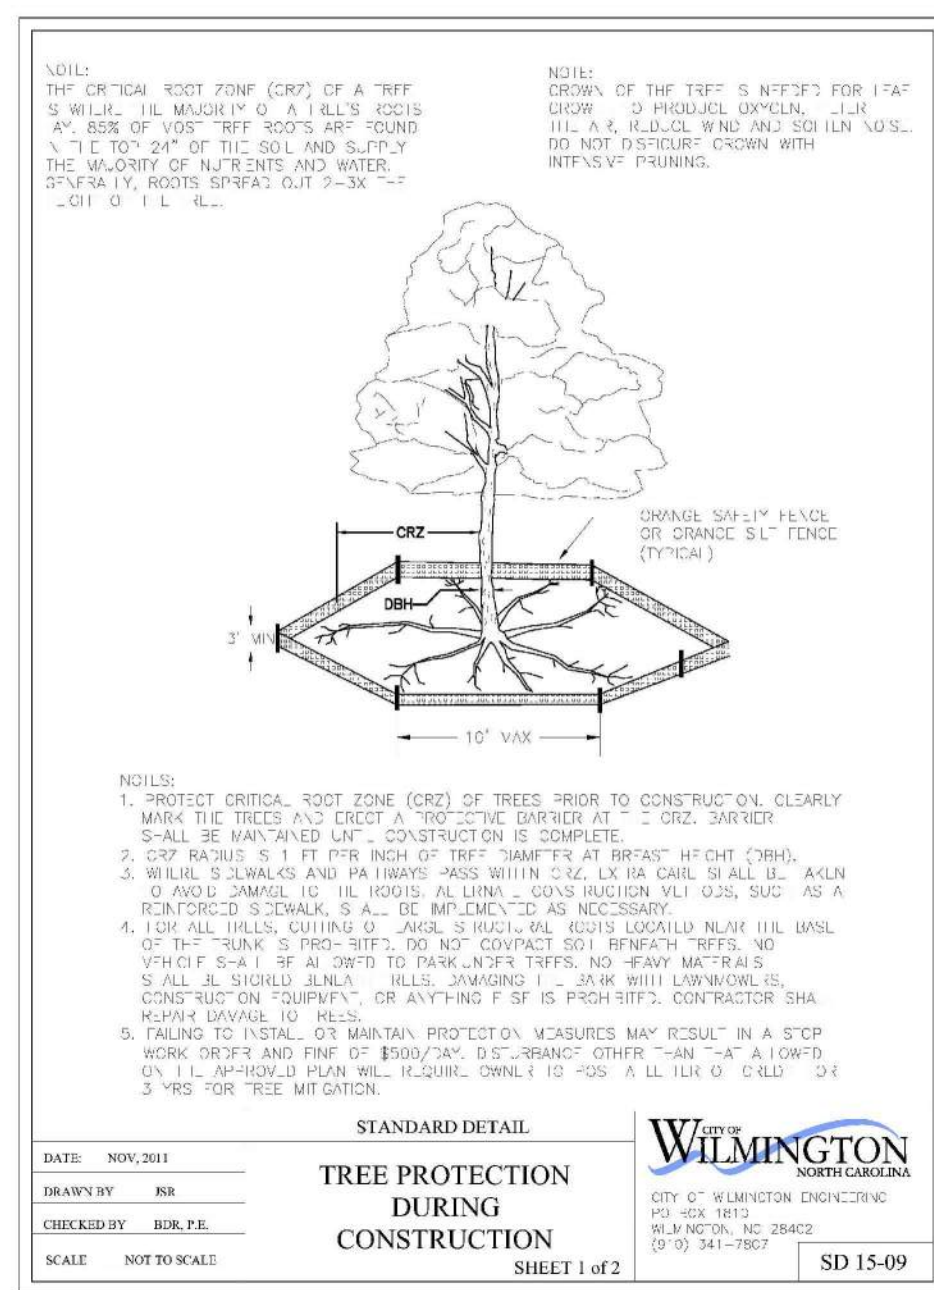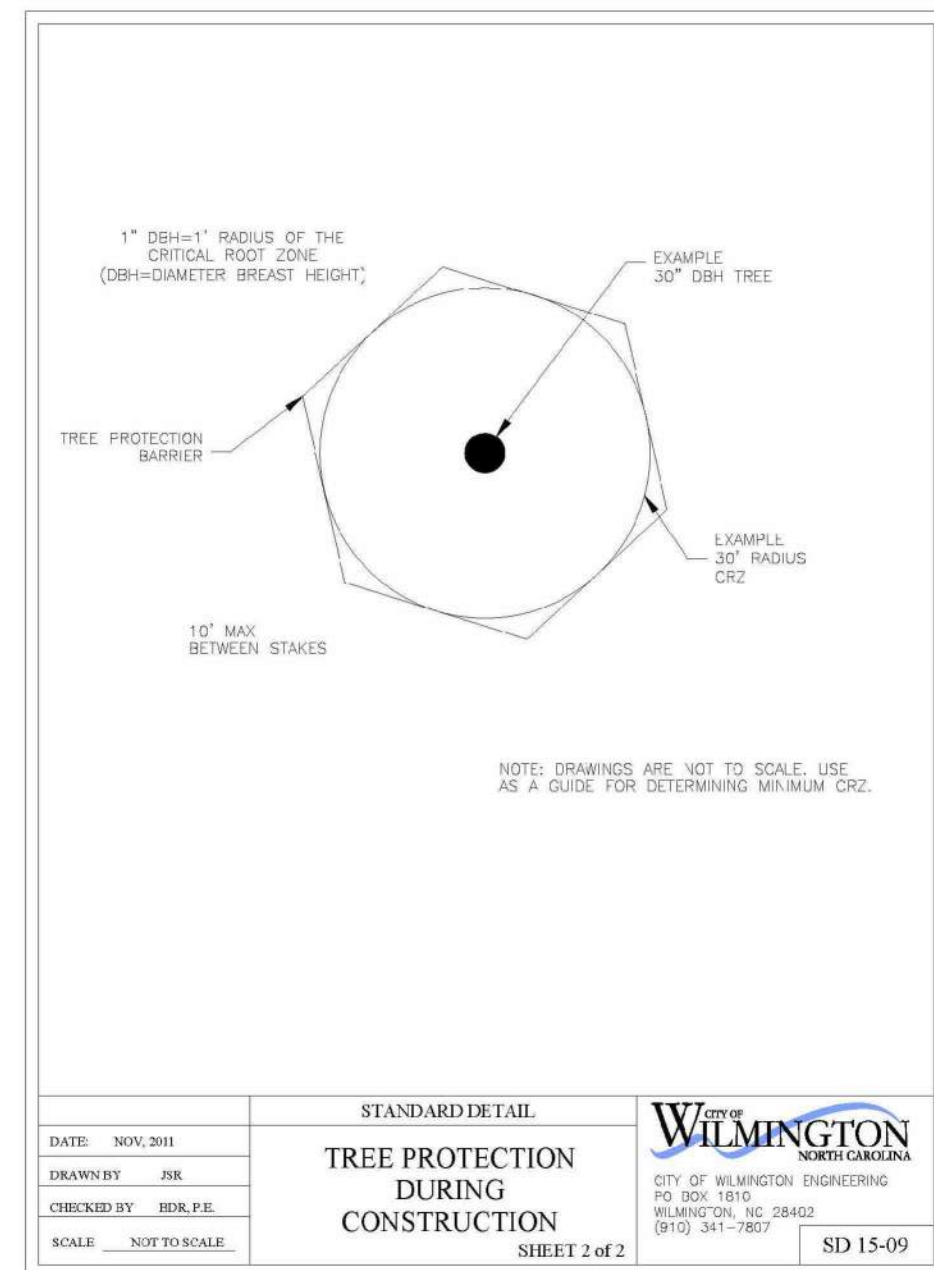

NCDENR PWSS WATER PERMIT #: \_\_\_\_\_ GPD  
 WATER CAPACITY: \_\_\_\_\_ GPD  
 DWQ SEWER PERMIT #: \_\_\_\_\_ GPD  
 SEWER CAPACITY: \_\_\_\_\_ GPD  
 SEWER SHED # AND PLANT: \_\_\_\_\_  
 SEWER TO FLOW THROUGH NEI: YES or NO (CIRCLE ONE)

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.

**Approved Construction Plan**  
 Name \_\_\_\_\_ Date \_\_\_\_\_  
 Planning \_\_\_\_\_  
 Traffic \_\_\_\_\_  
 Fire \_\_\_\_\_

APPROVED STORMWATER MANAGEMENT PLAN  
 Date: \_\_\_\_\_ Permit # \_\_\_\_\_  
 Signed: \_\_\_\_\_

**REVISIONS:**

11/18/21	REV. 1 ADDITIONAL NOTES ADDED
1/22/21	REV. 2 RFI RESPONSE
1/26/22	REV. 3 ADDED SUMPED INLET DETAIL

**CLIENT INFORMATION:**  
 FOOD BANK OF CENTRAL & EASTERN NORTH CAROLINA  
 1924 CAPITAL BLVD.  
 RALEIGH, NC 27604

**PARAMOUNT ENGINEERING**  
 122 Cinema Drive  
 Wilmington, North Carolina 28403  
 (910) 791-6707 (O) (910) 791-6766 (F)  
 NC License #: C-2846

**DETAILS**  
 THE WILMINGTON FOOD BANK  
 GREENFIELD STREET  
 WILMINGTON, NORTH CAROLINA

**PROJECT STATUS**

CONCEPT LAYOUT:	1/28/22
FINAL DESIGN LAYOUT:	PEI
RELEASED FOR CONSTRUCTION:	PEI

**DRAWING INFORMATION**









DATE:	1/28/22
SCALE:	AS SHOWN
DRAWN BY:	PEI
CHECKED BY:	PEI

Professional Seal redacted on electronic copy per City of Wilmington Policy

**C-6.4**

PEI JOB#: 20484.PE

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

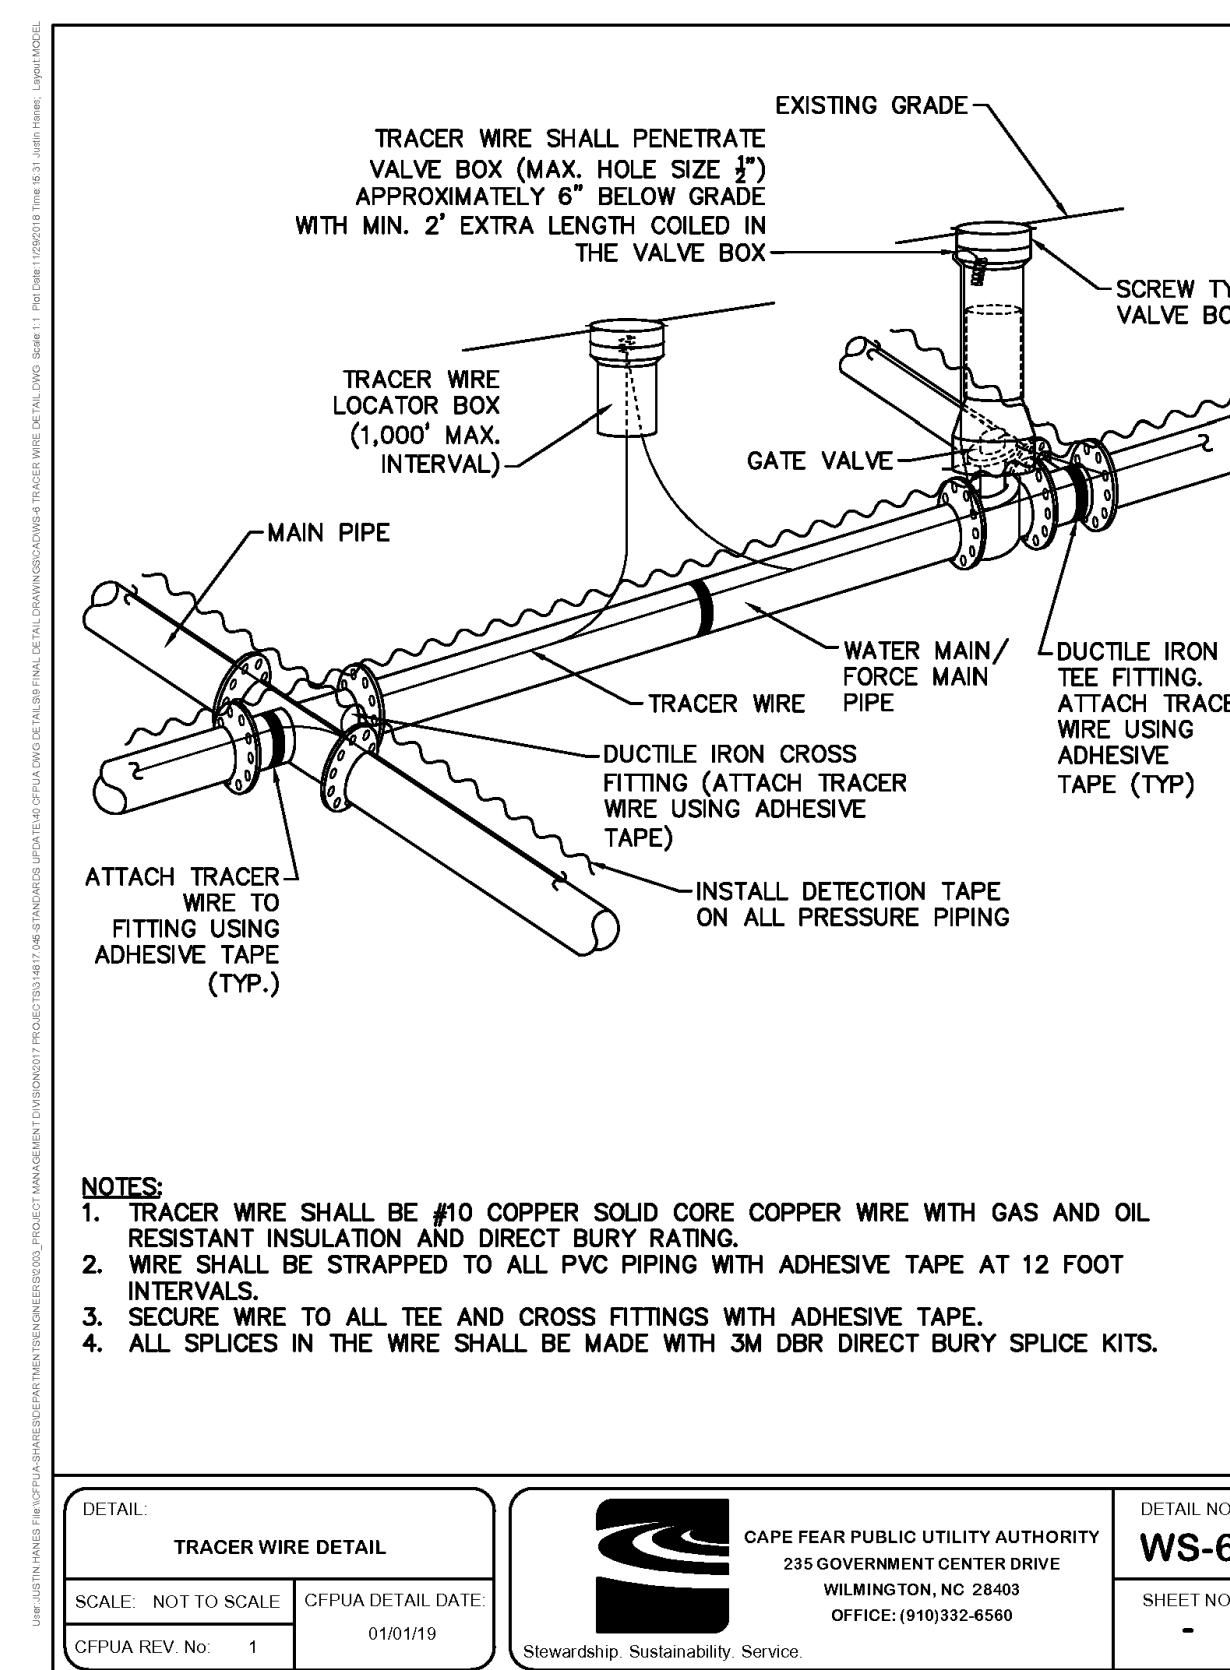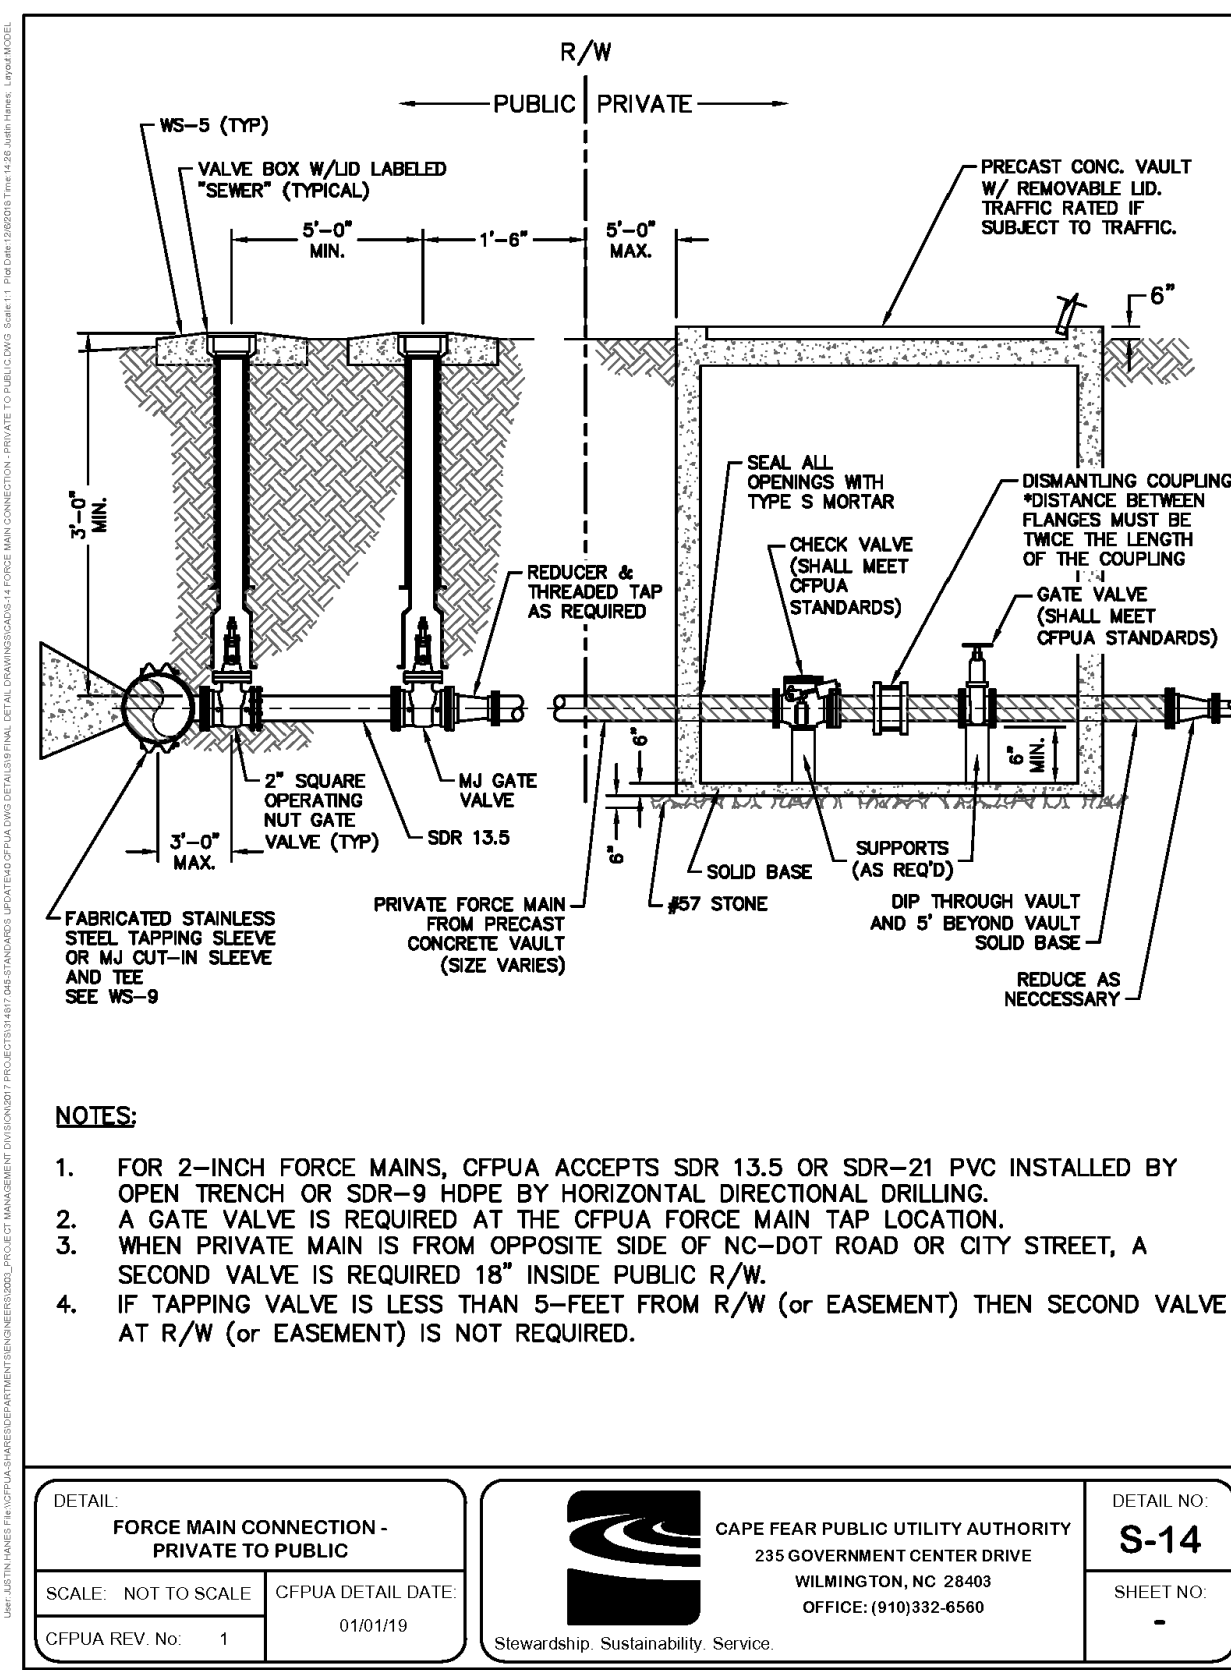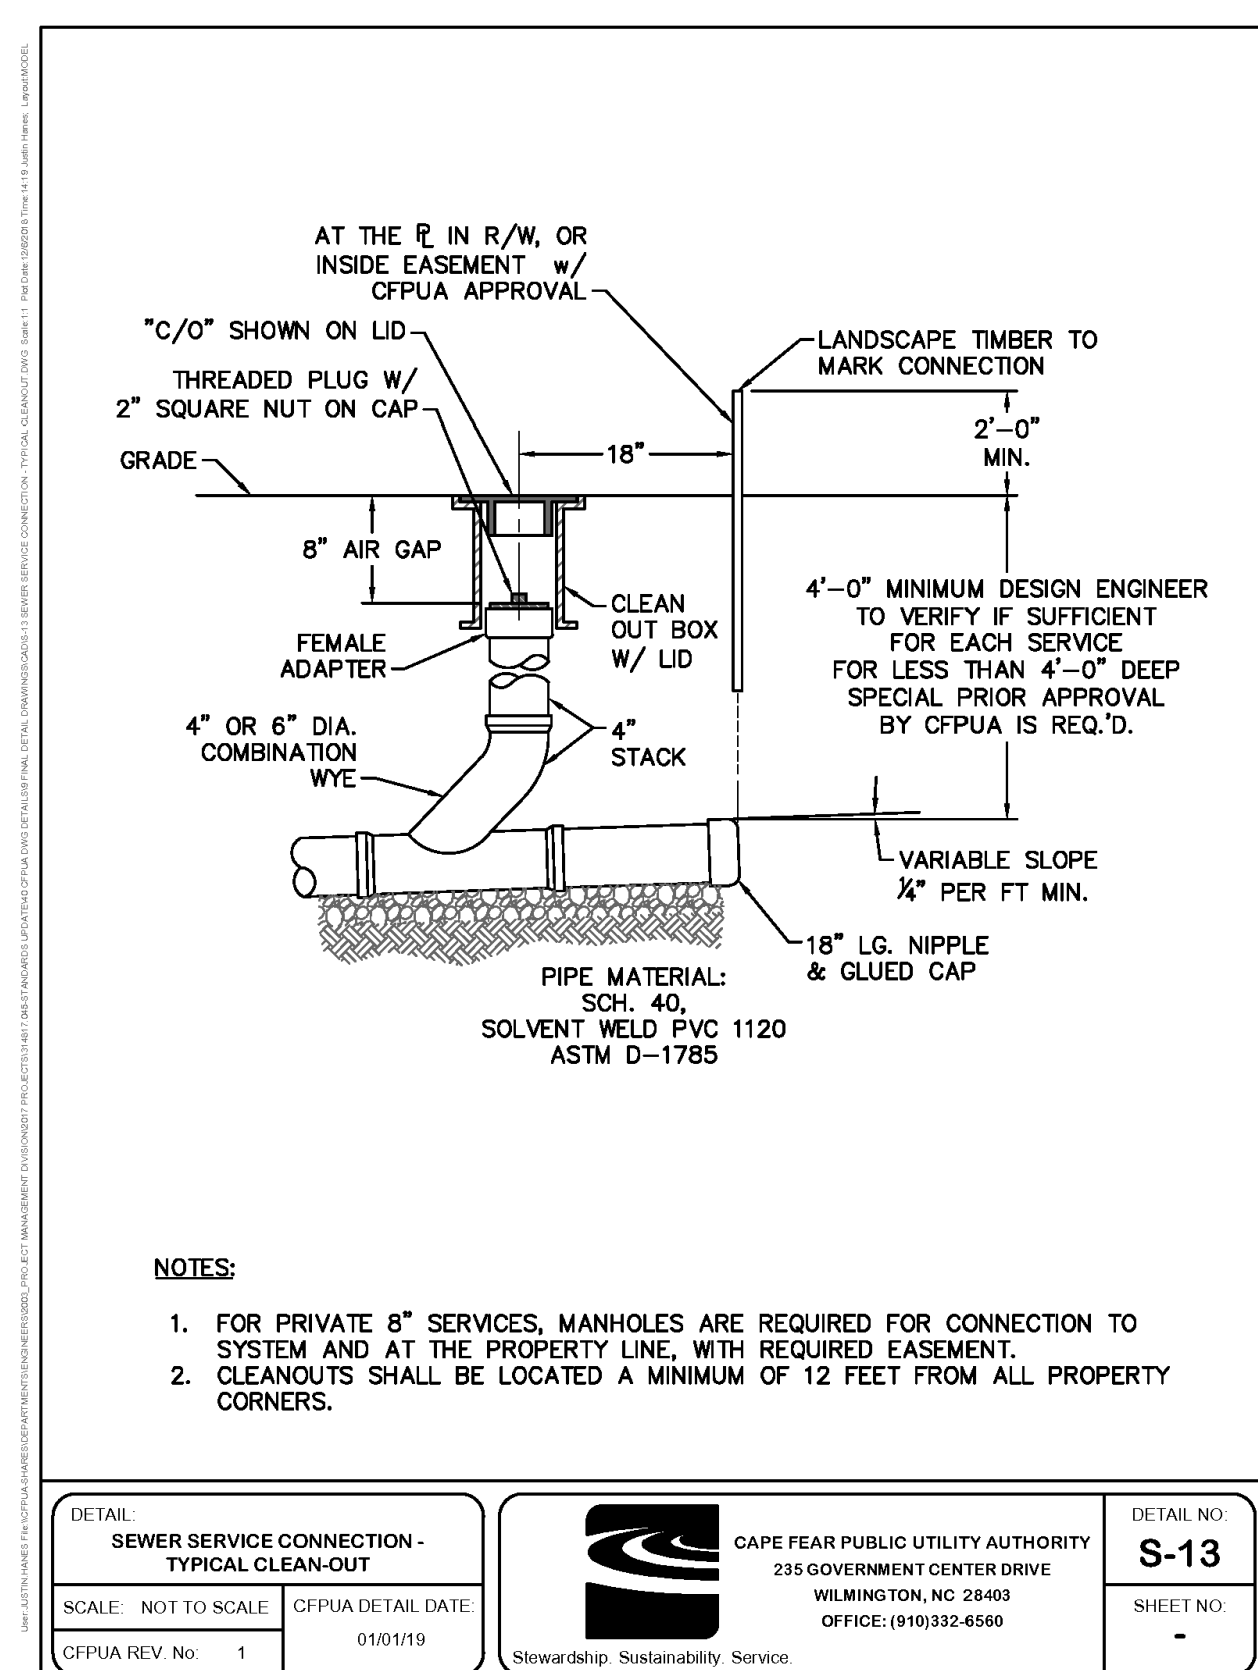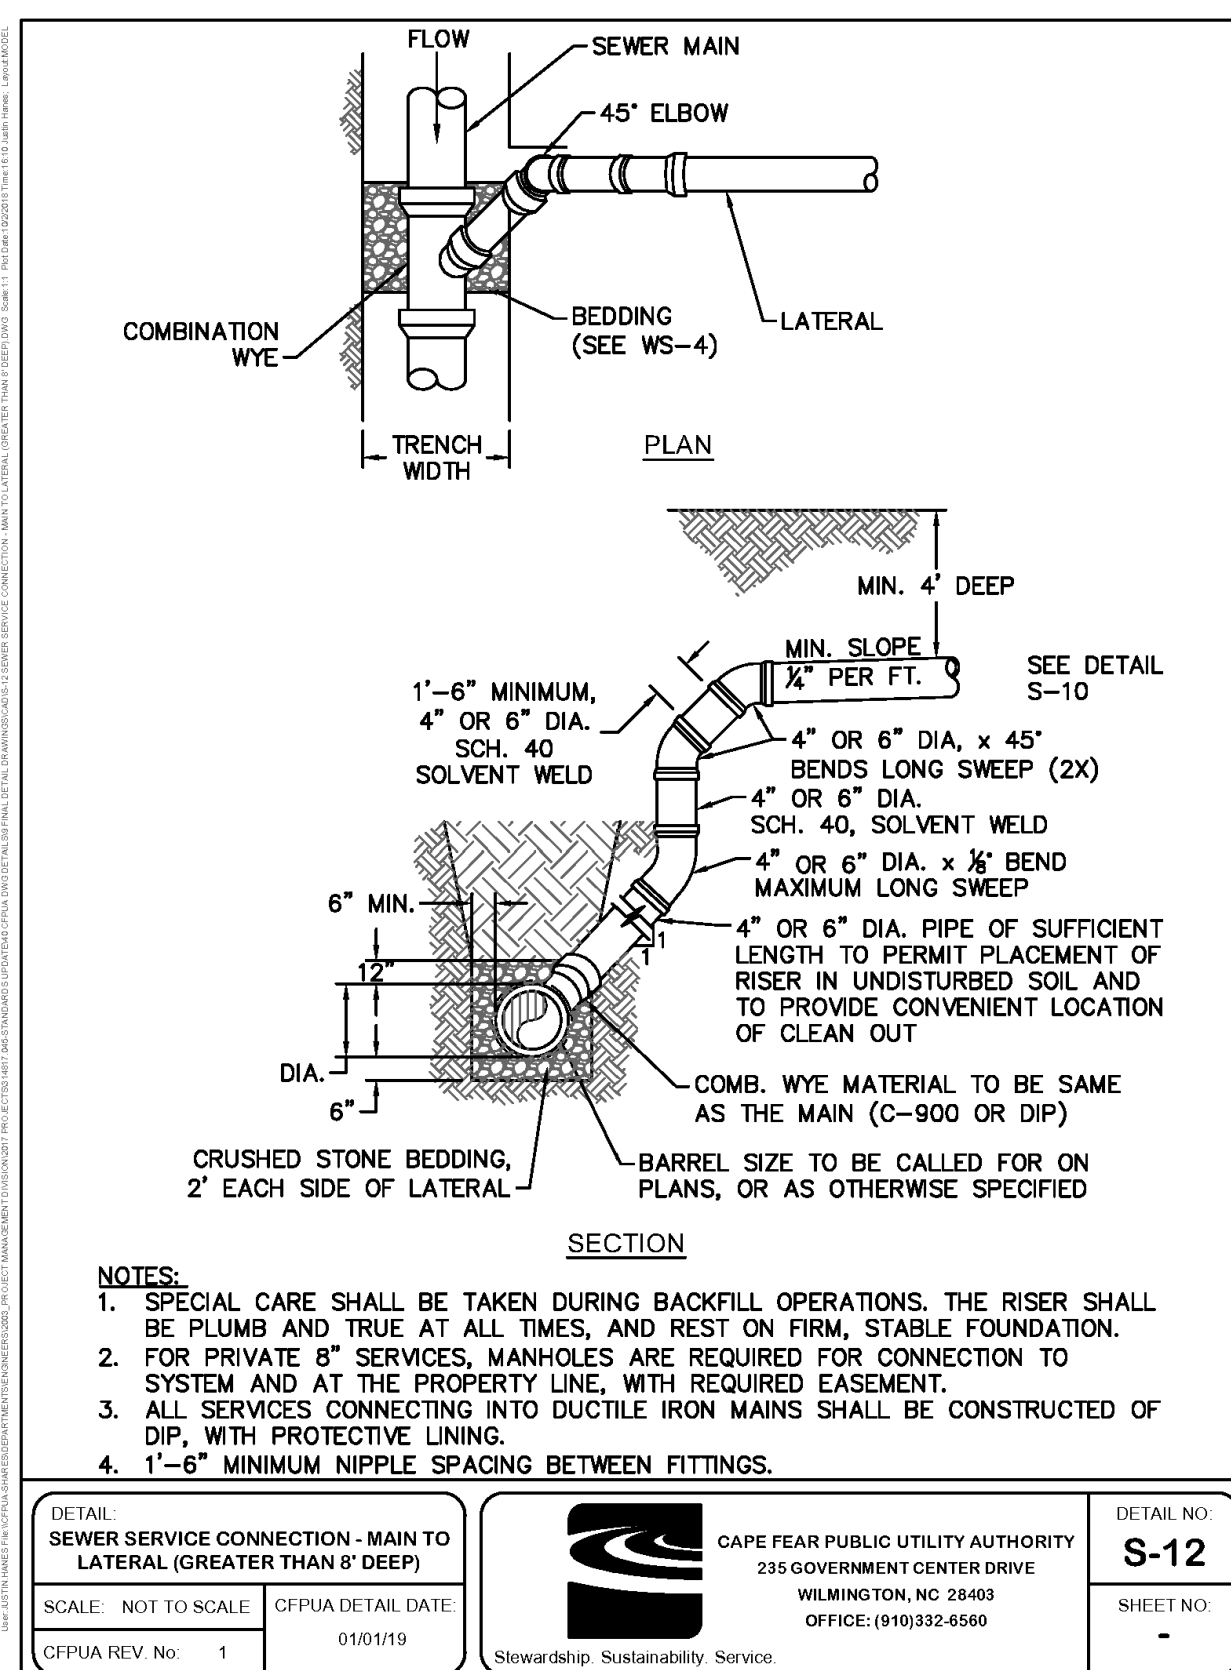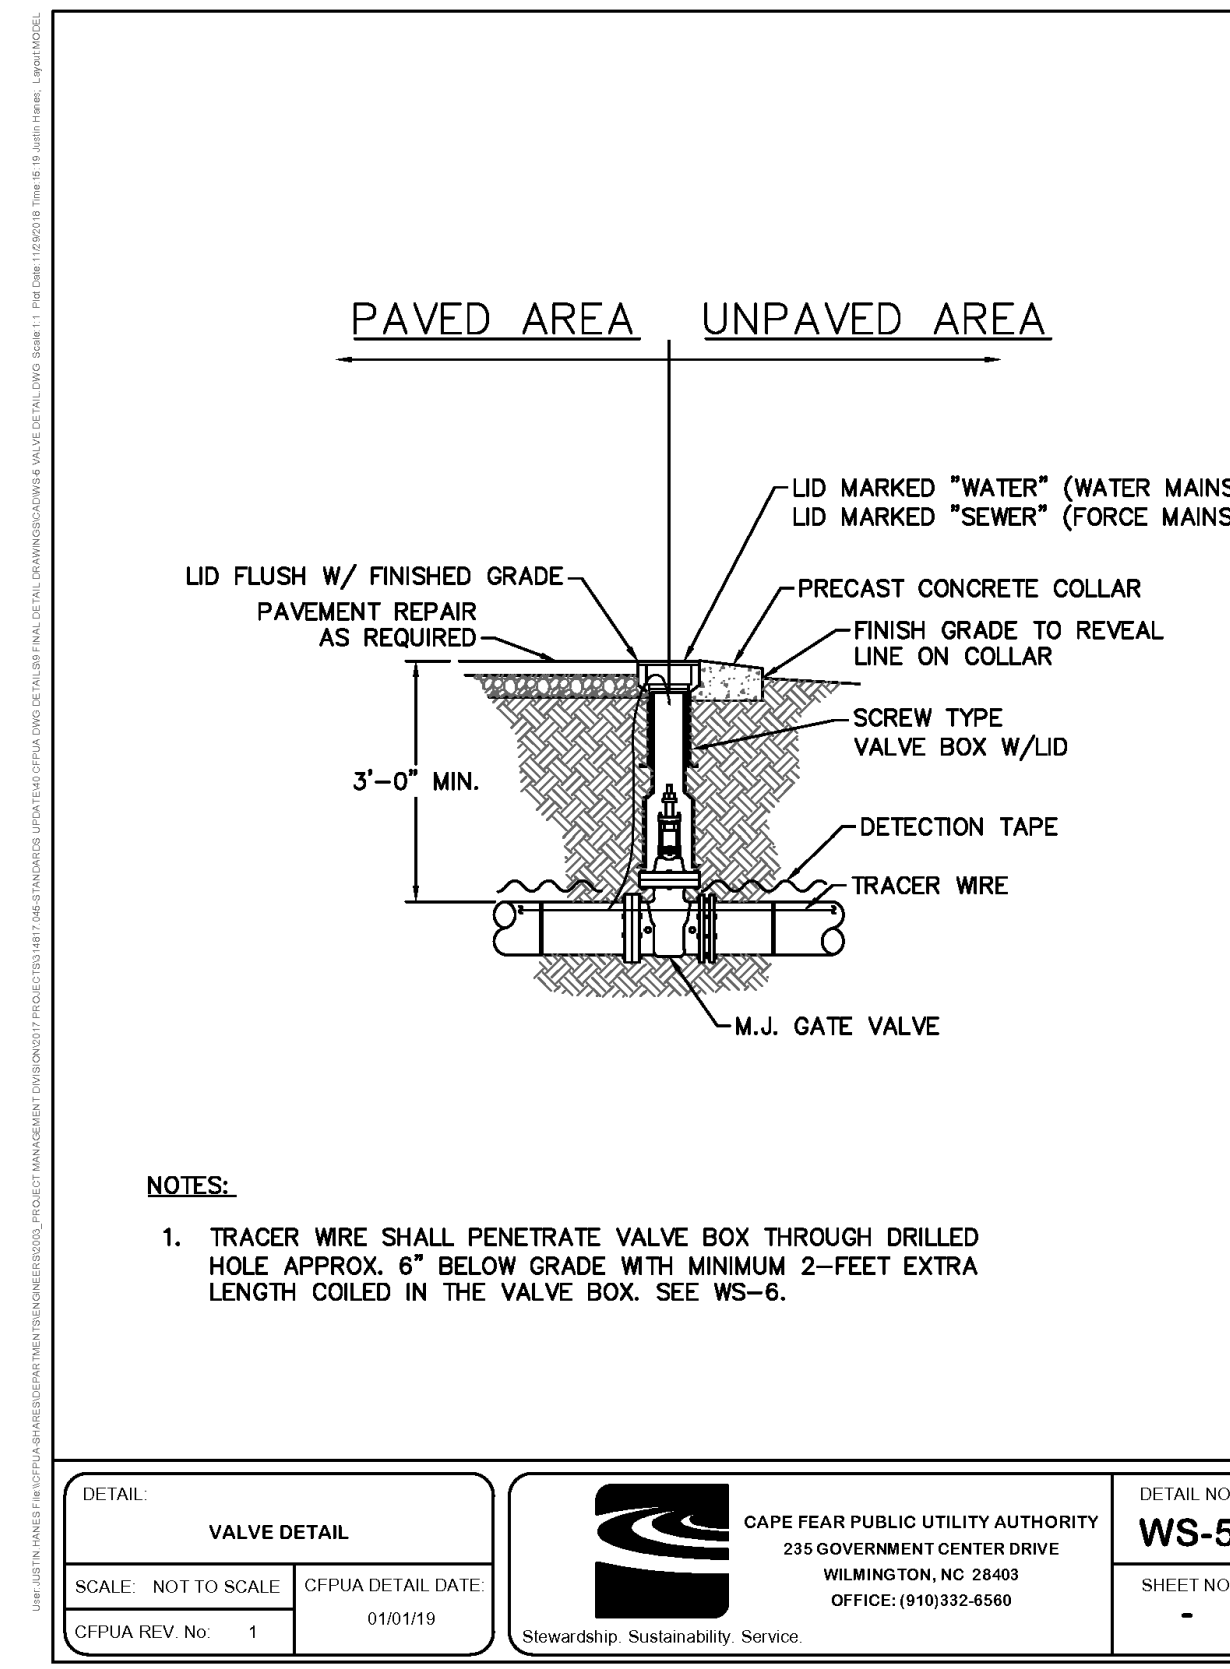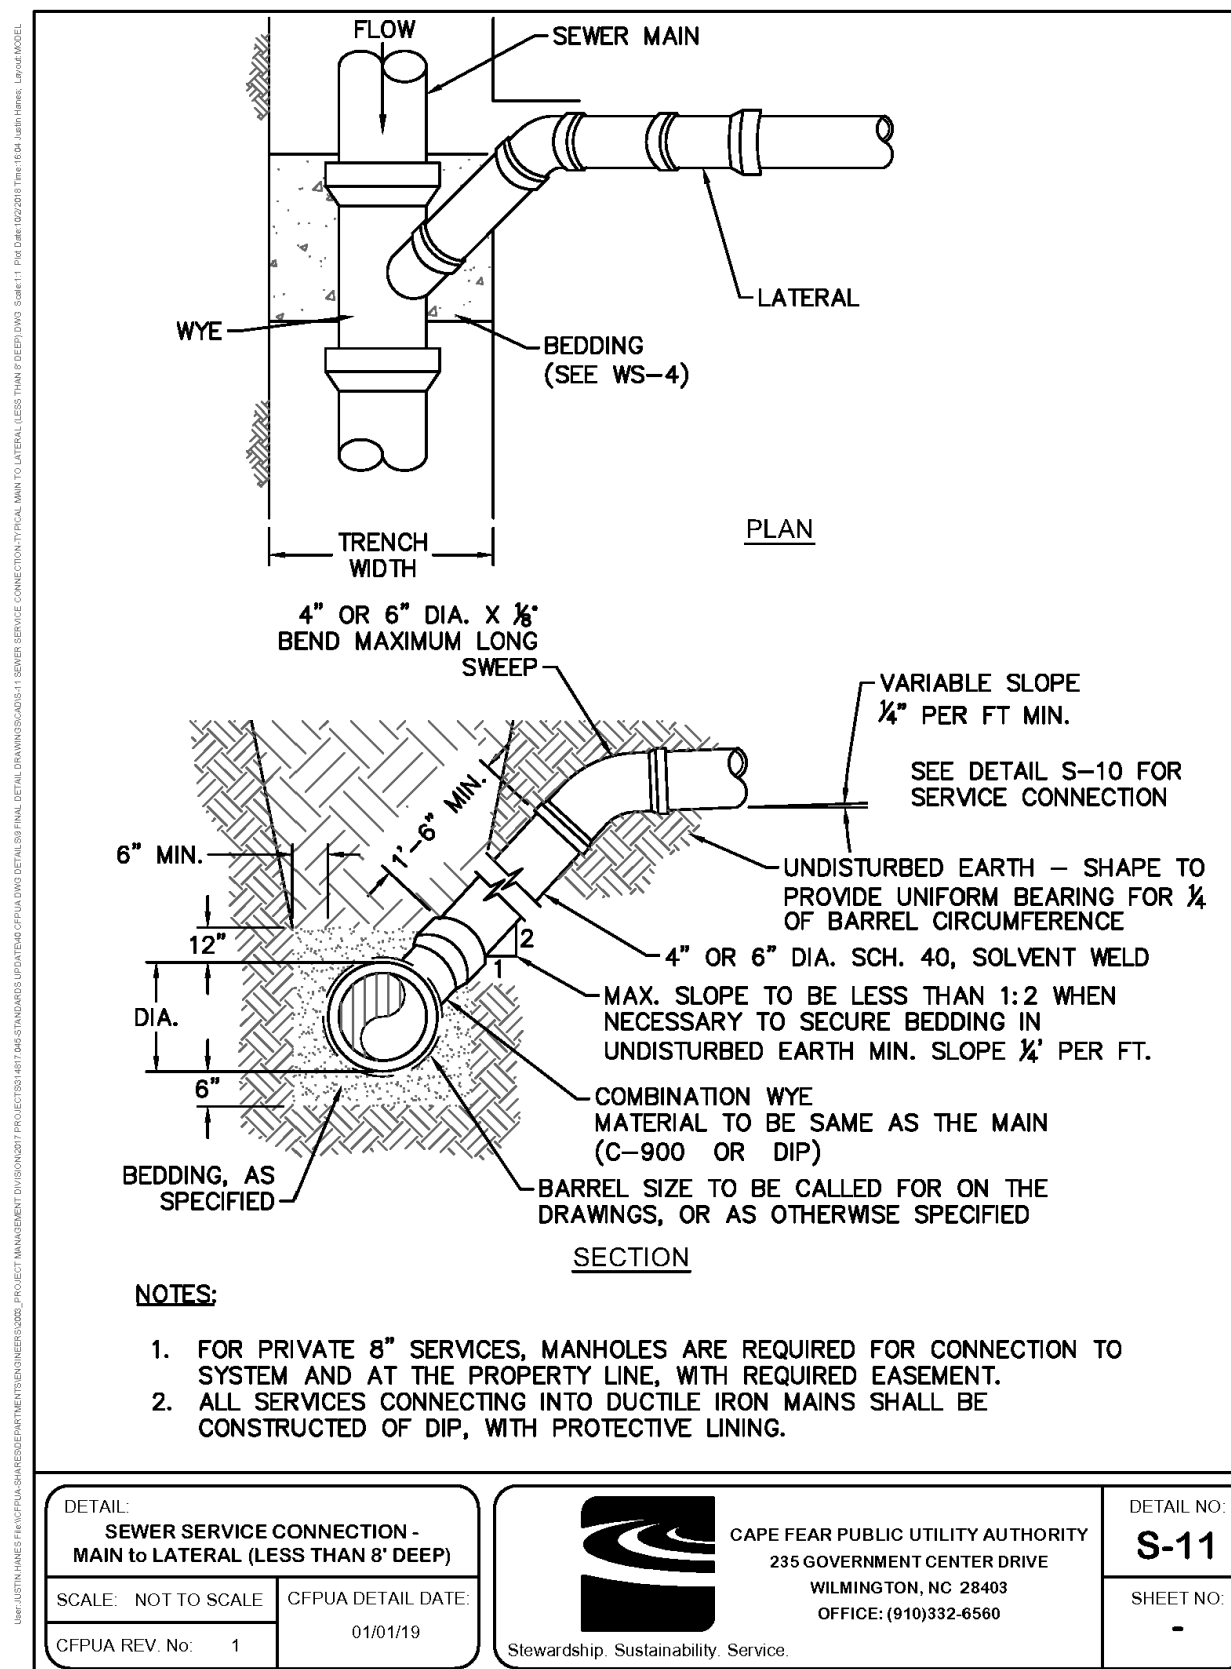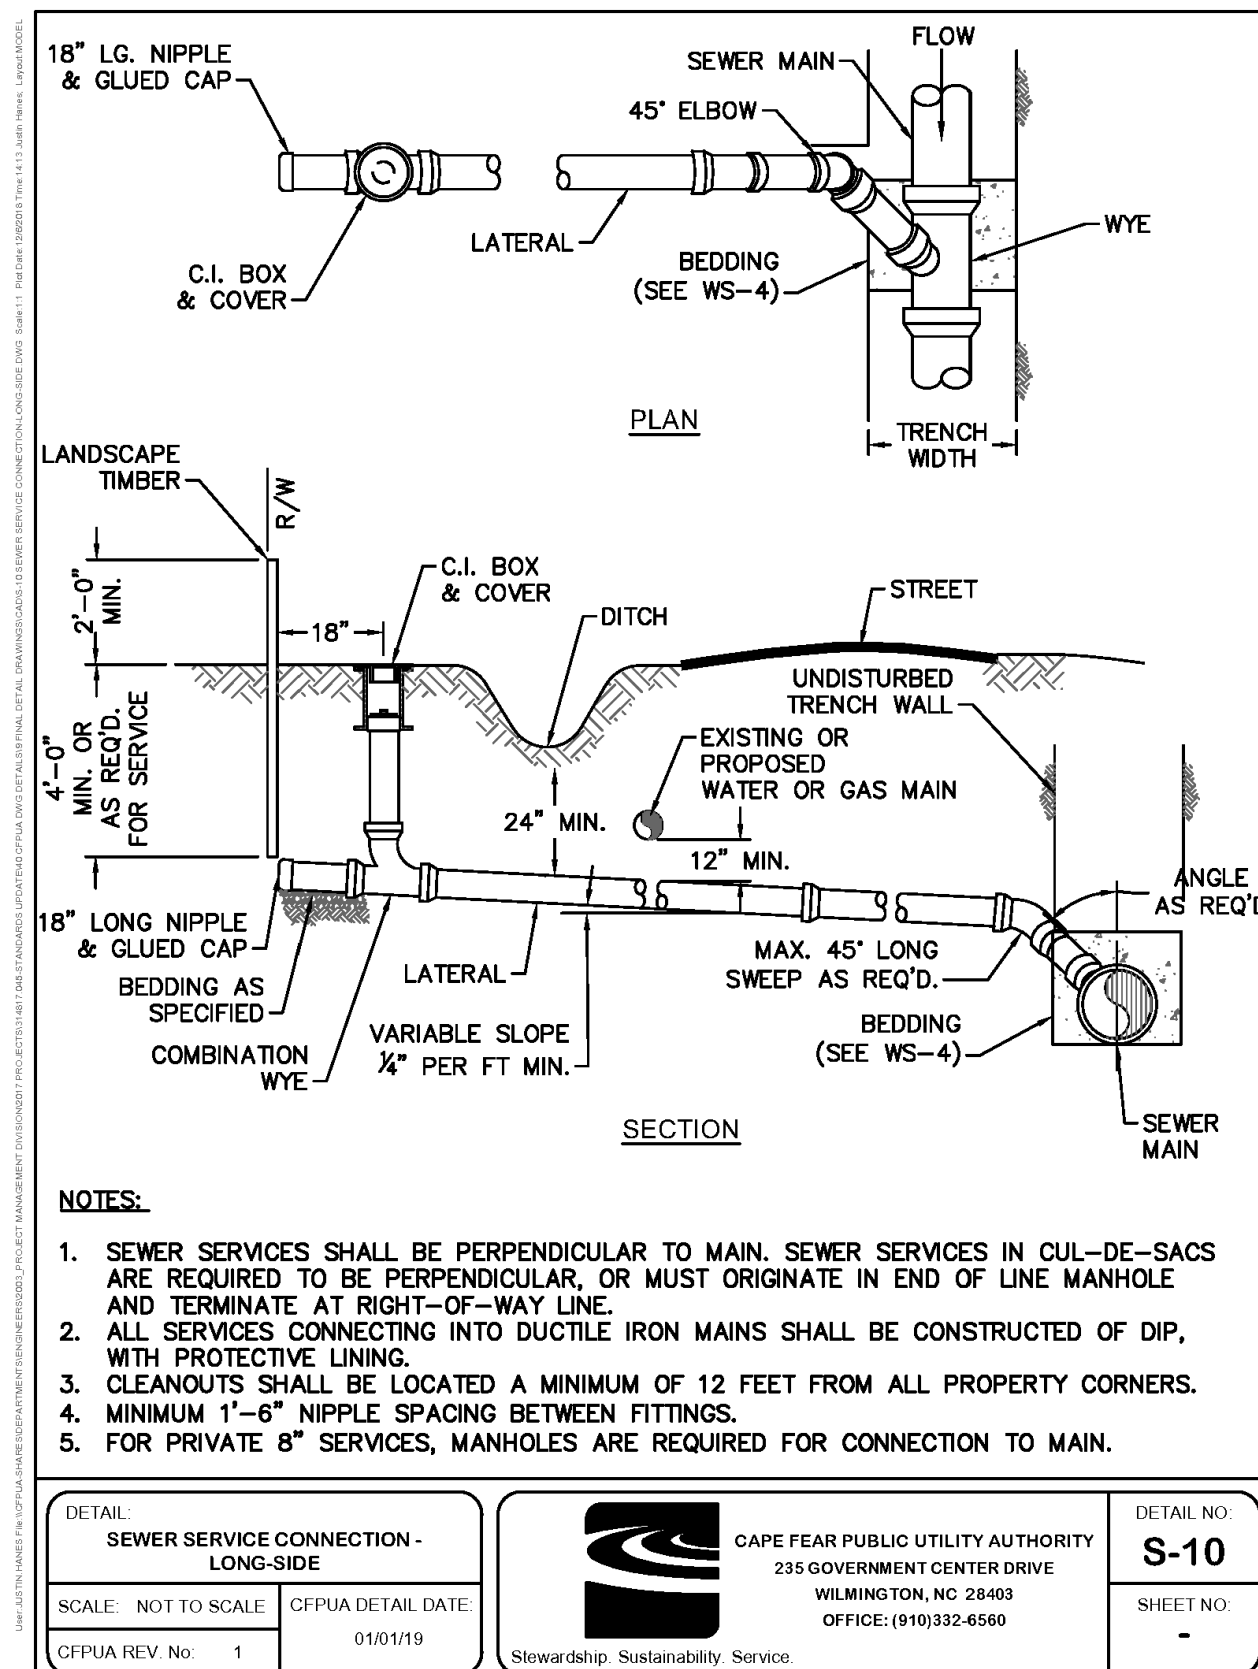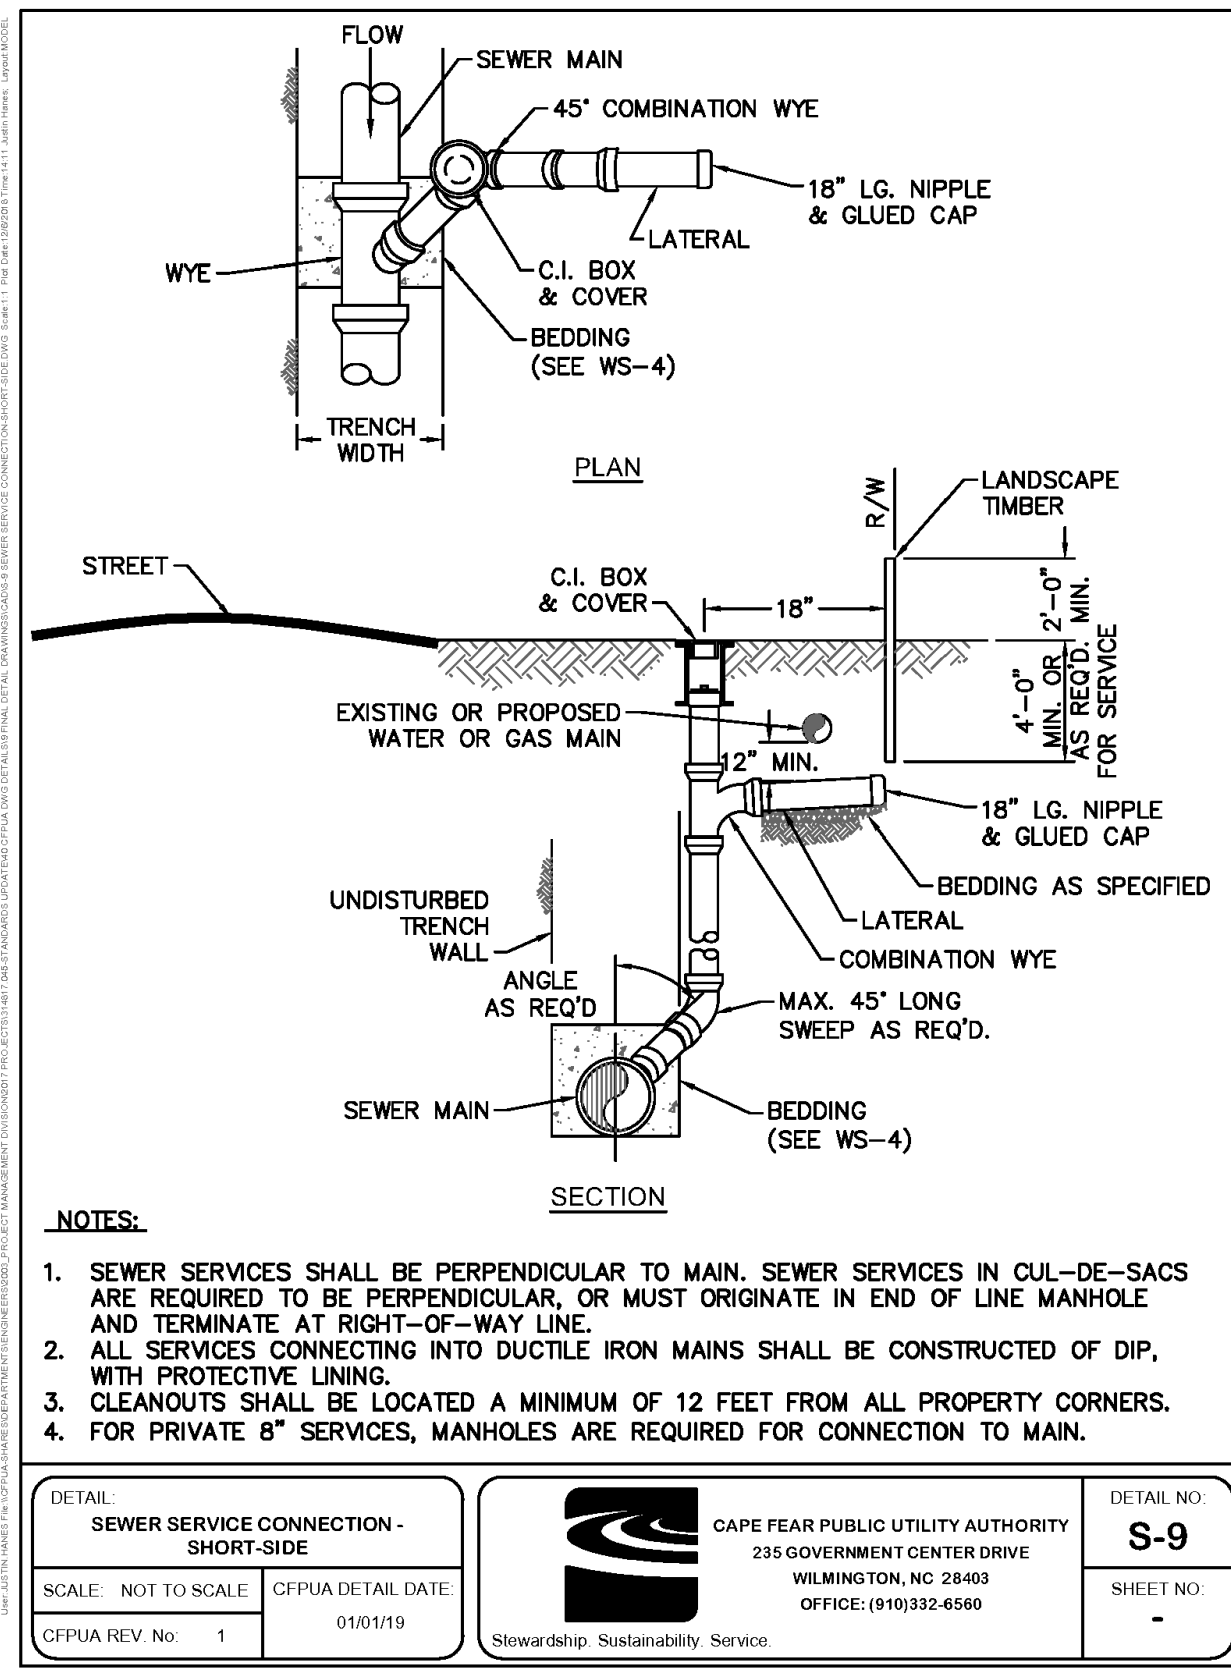

REVISIONS:

CLIENT INFORMATION:

FOOD BANK OF CENTRAL & EASTERN NORTH CAROLINA  
1924 CAPITAL BLVD.  
RALEIGH, NC 27604

PARAMOUNT ENGINEERING, INC.  
122 Cinema Drive  
Wilmington, North Carolina 28403  
(910) 791-6707 (O) (910) 791-6766 (F)  
NC License #: C-2846

CFPWA DETAILS

THE WILMINGTON FOOD BANK  
GREENFIELD STREET  
WILMINGTON, NORTH CAROLINA

PROJECT STATUS:  
CONCEPTUAL LAYOUT:  
FINAL DESIGN:  
RELEASED FOR CONSTRUCTION:

DRAWING INFORMATION:  
DATE: 10/13/21  
SCALE: PER  
DRAWING: PER  
CHECKED: PER

Professional Seal redacted on electronic copy per City of Wilmington Policy

C-7.0

PEI JOB#: 20484.PE

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

NC DENR PWSS WATER PERMIT #: \_\_\_\_\_

WATER CAPACITY: \_\_\_\_\_ GPD

DWQ SEWER PERMIT #: \_\_\_\_\_

SEWER CAPACITY: \_\_\_\_\_ GPD

SEWER SHED # AND PLANT: \_\_\_\_\_

SEWER TO FLOW THROUGH NEI: YES or NO (CIRCLE ONE)

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.

**CITY OF WILMINGTON**  
NORTH CAROLINA

Public Services • Engineering Division

APPROVED STORMWATER MANAGEMENT PLAN

Date: \_\_\_\_\_ Permit # \_\_\_\_\_

Signed: \_\_\_\_\_








Approved Construction Plan

Name \_\_\_\_\_ Date \_\_\_\_\_

Planning \_\_\_\_\_

Traffic \_\_\_\_\_

Fire \_\_\_\_\_

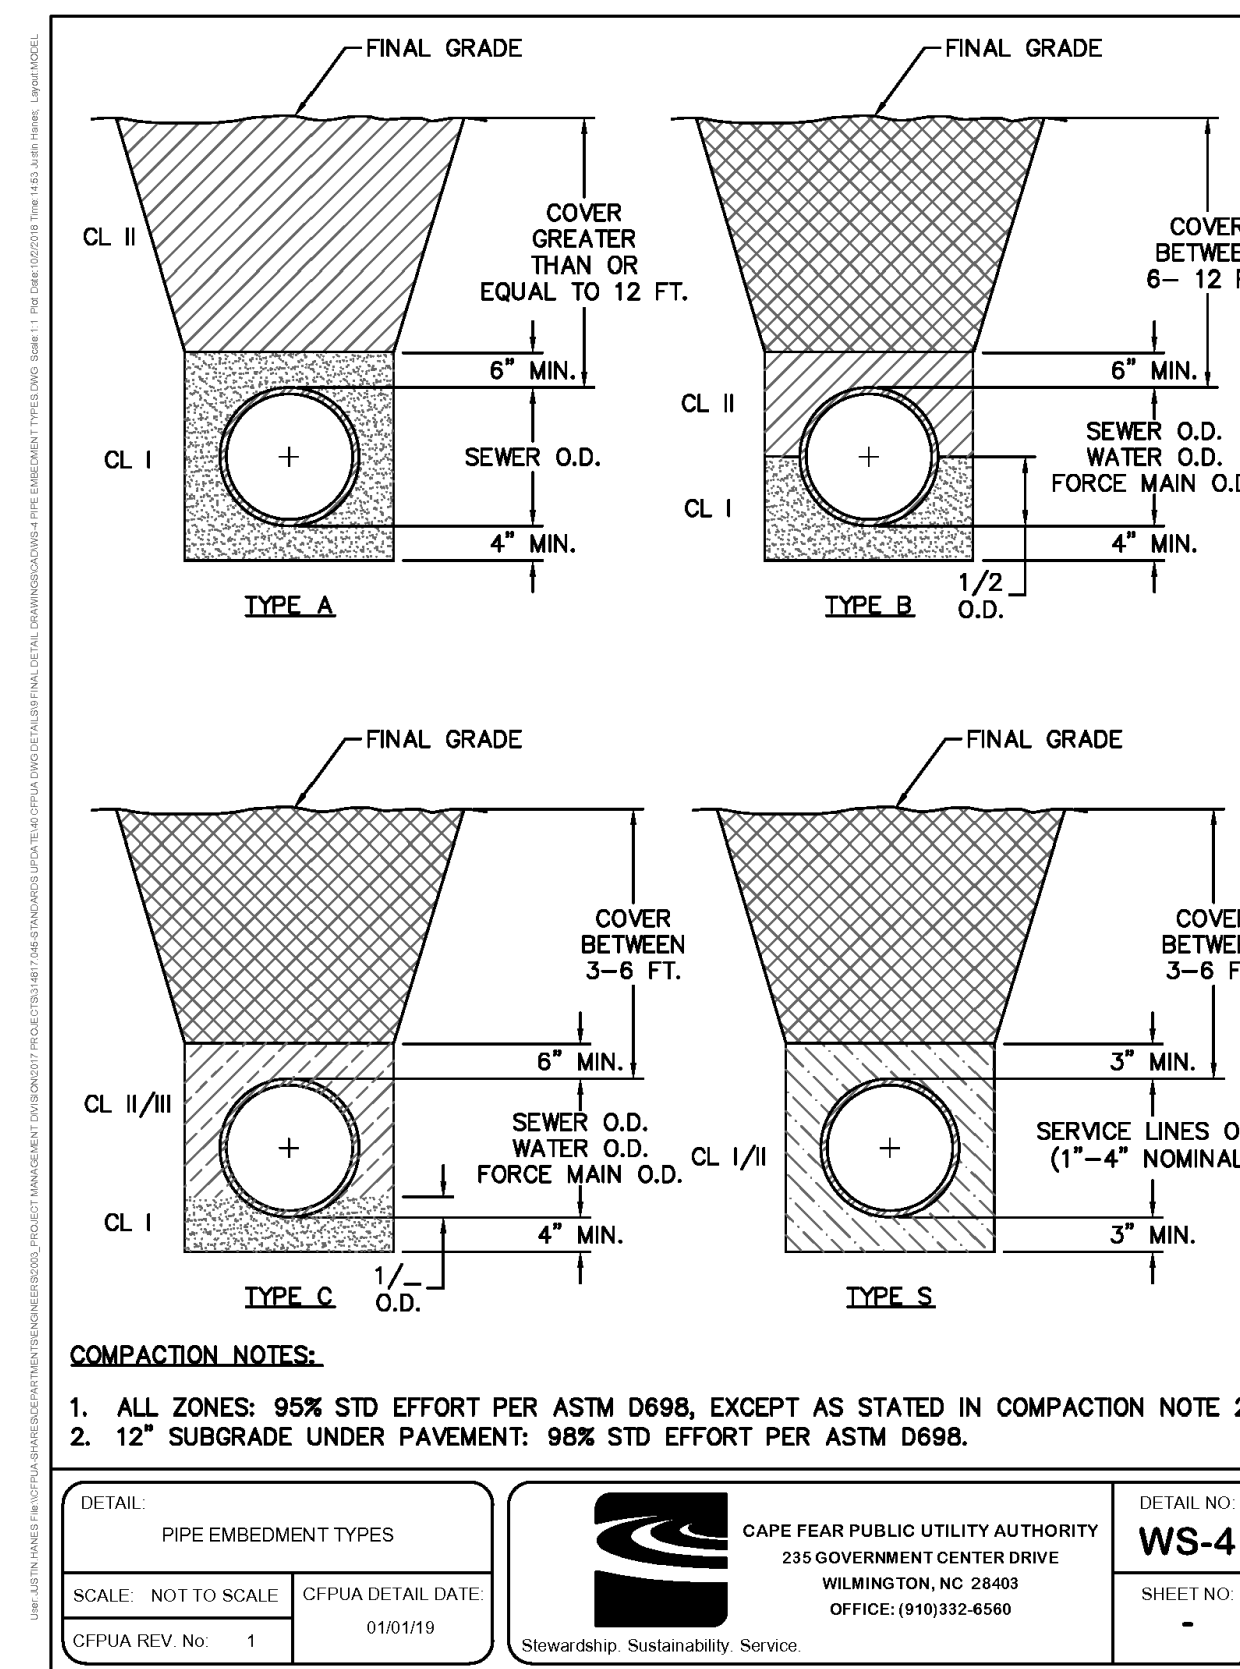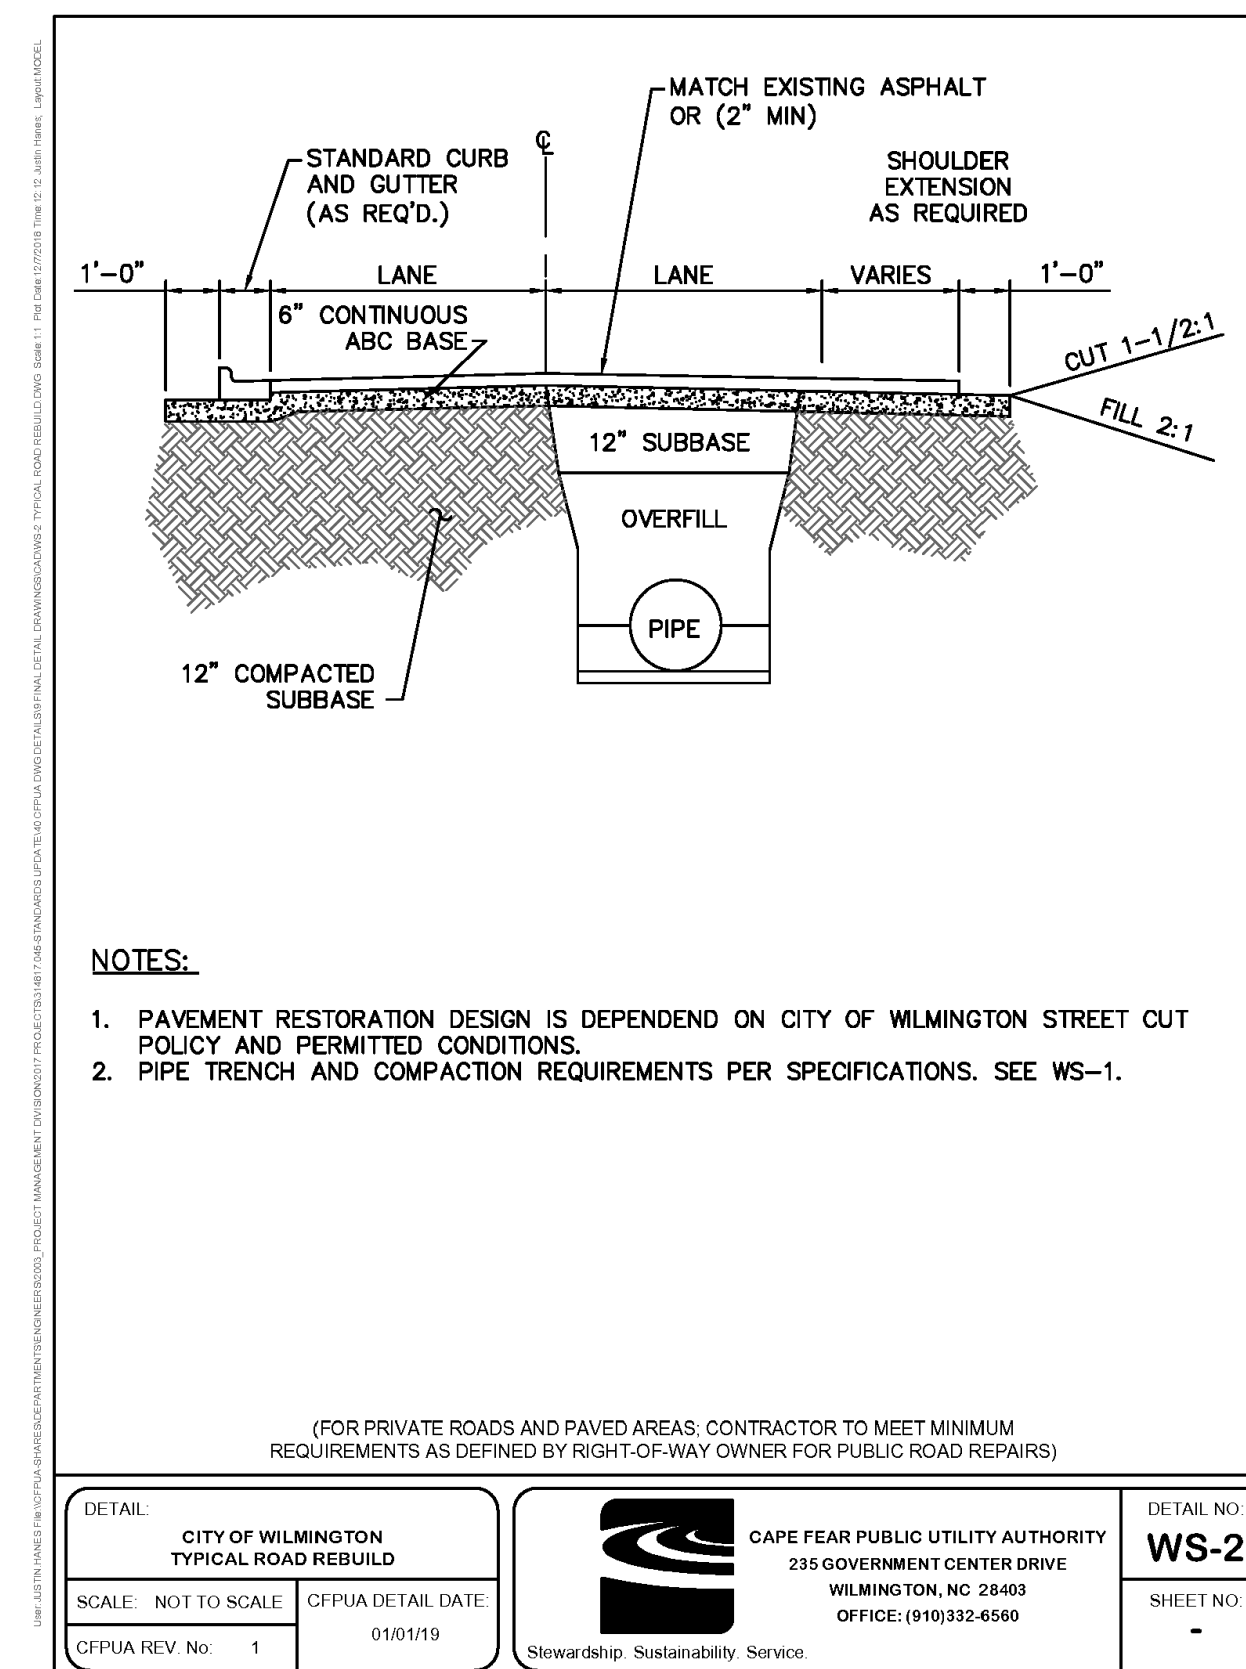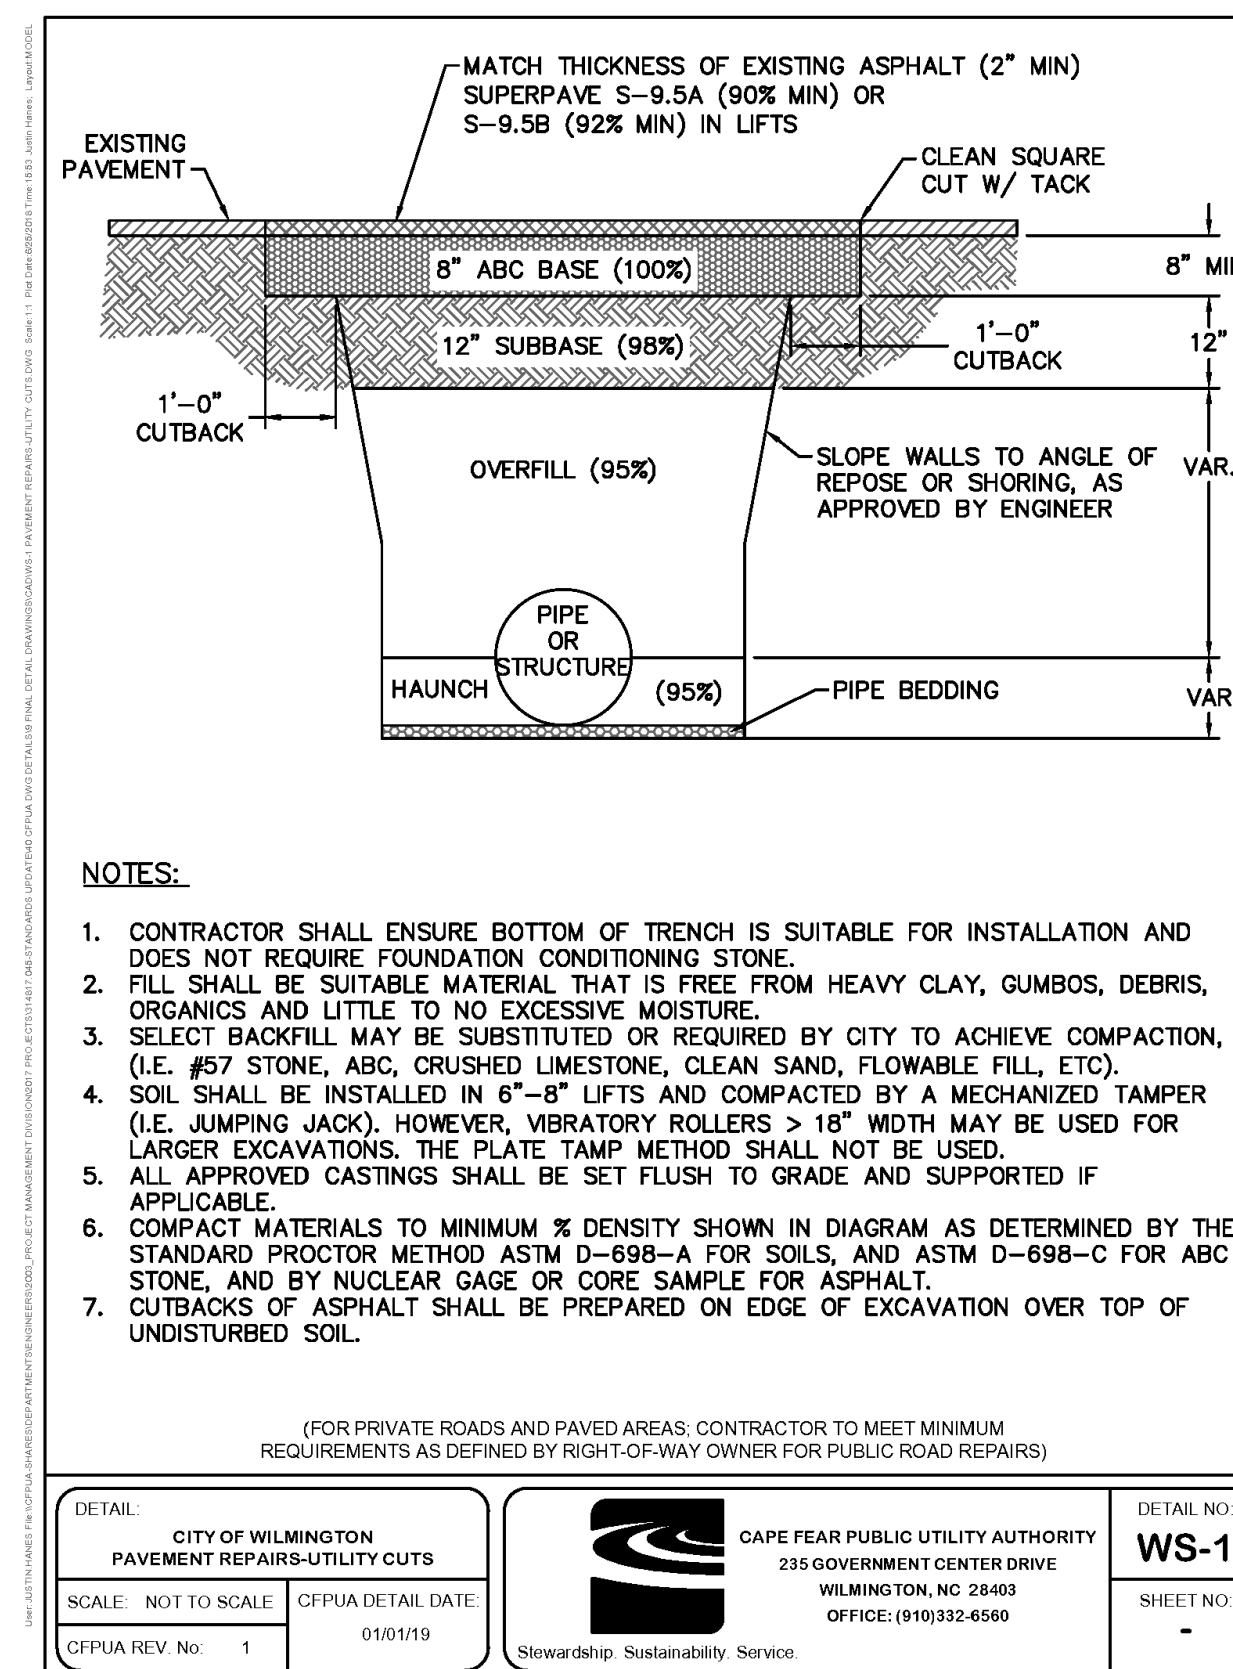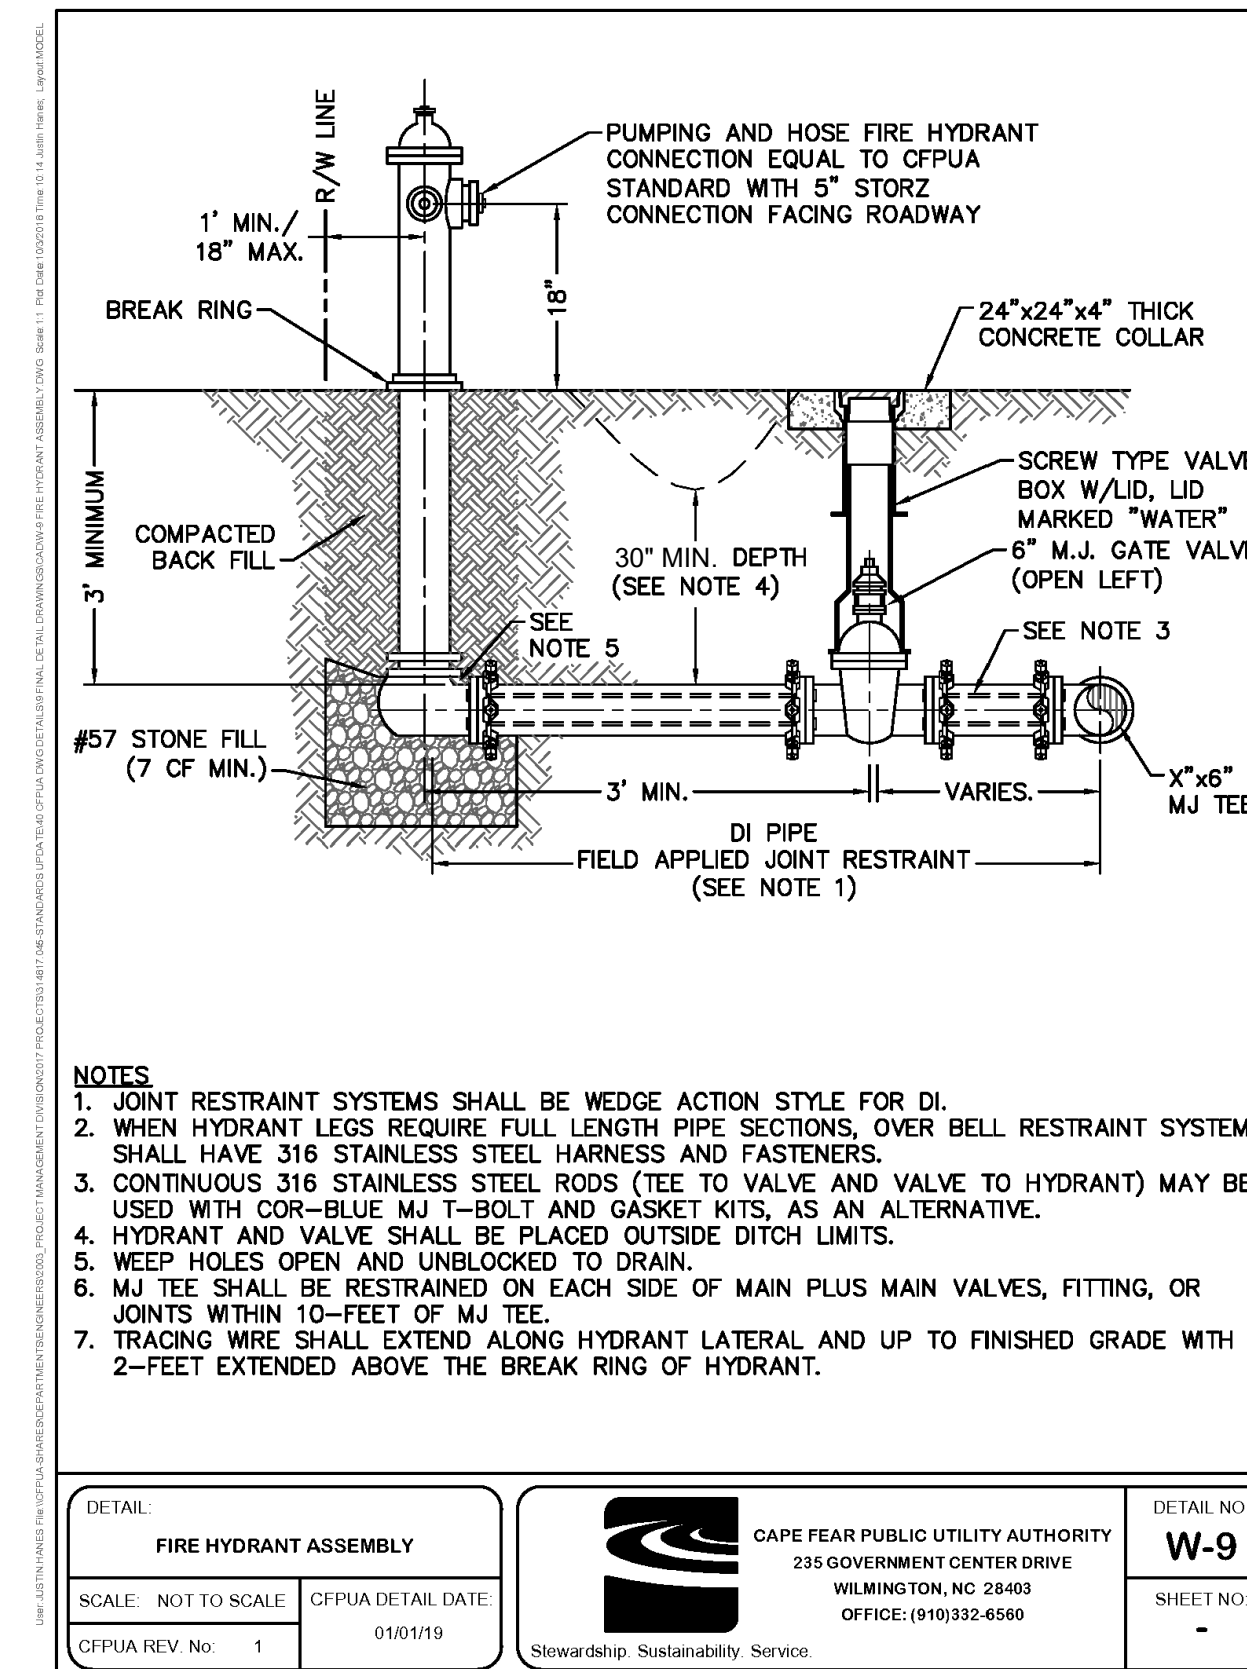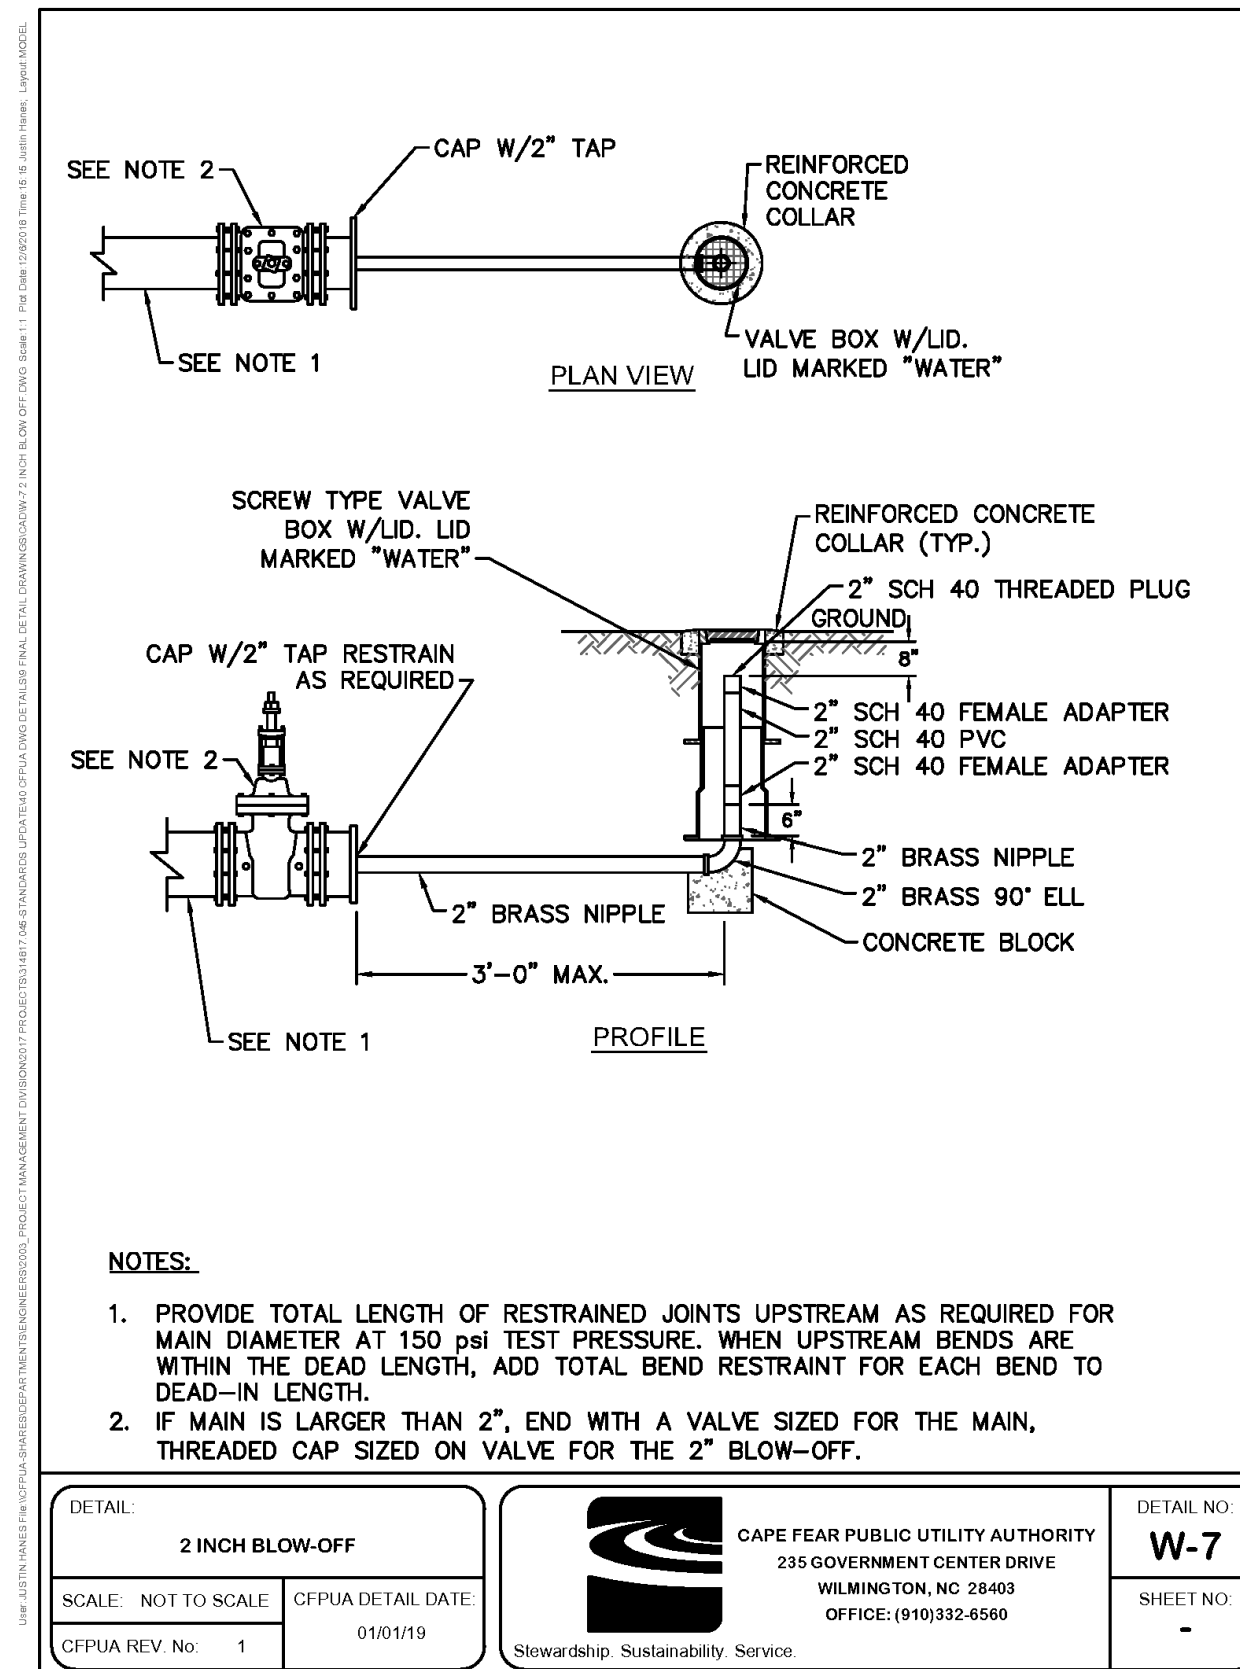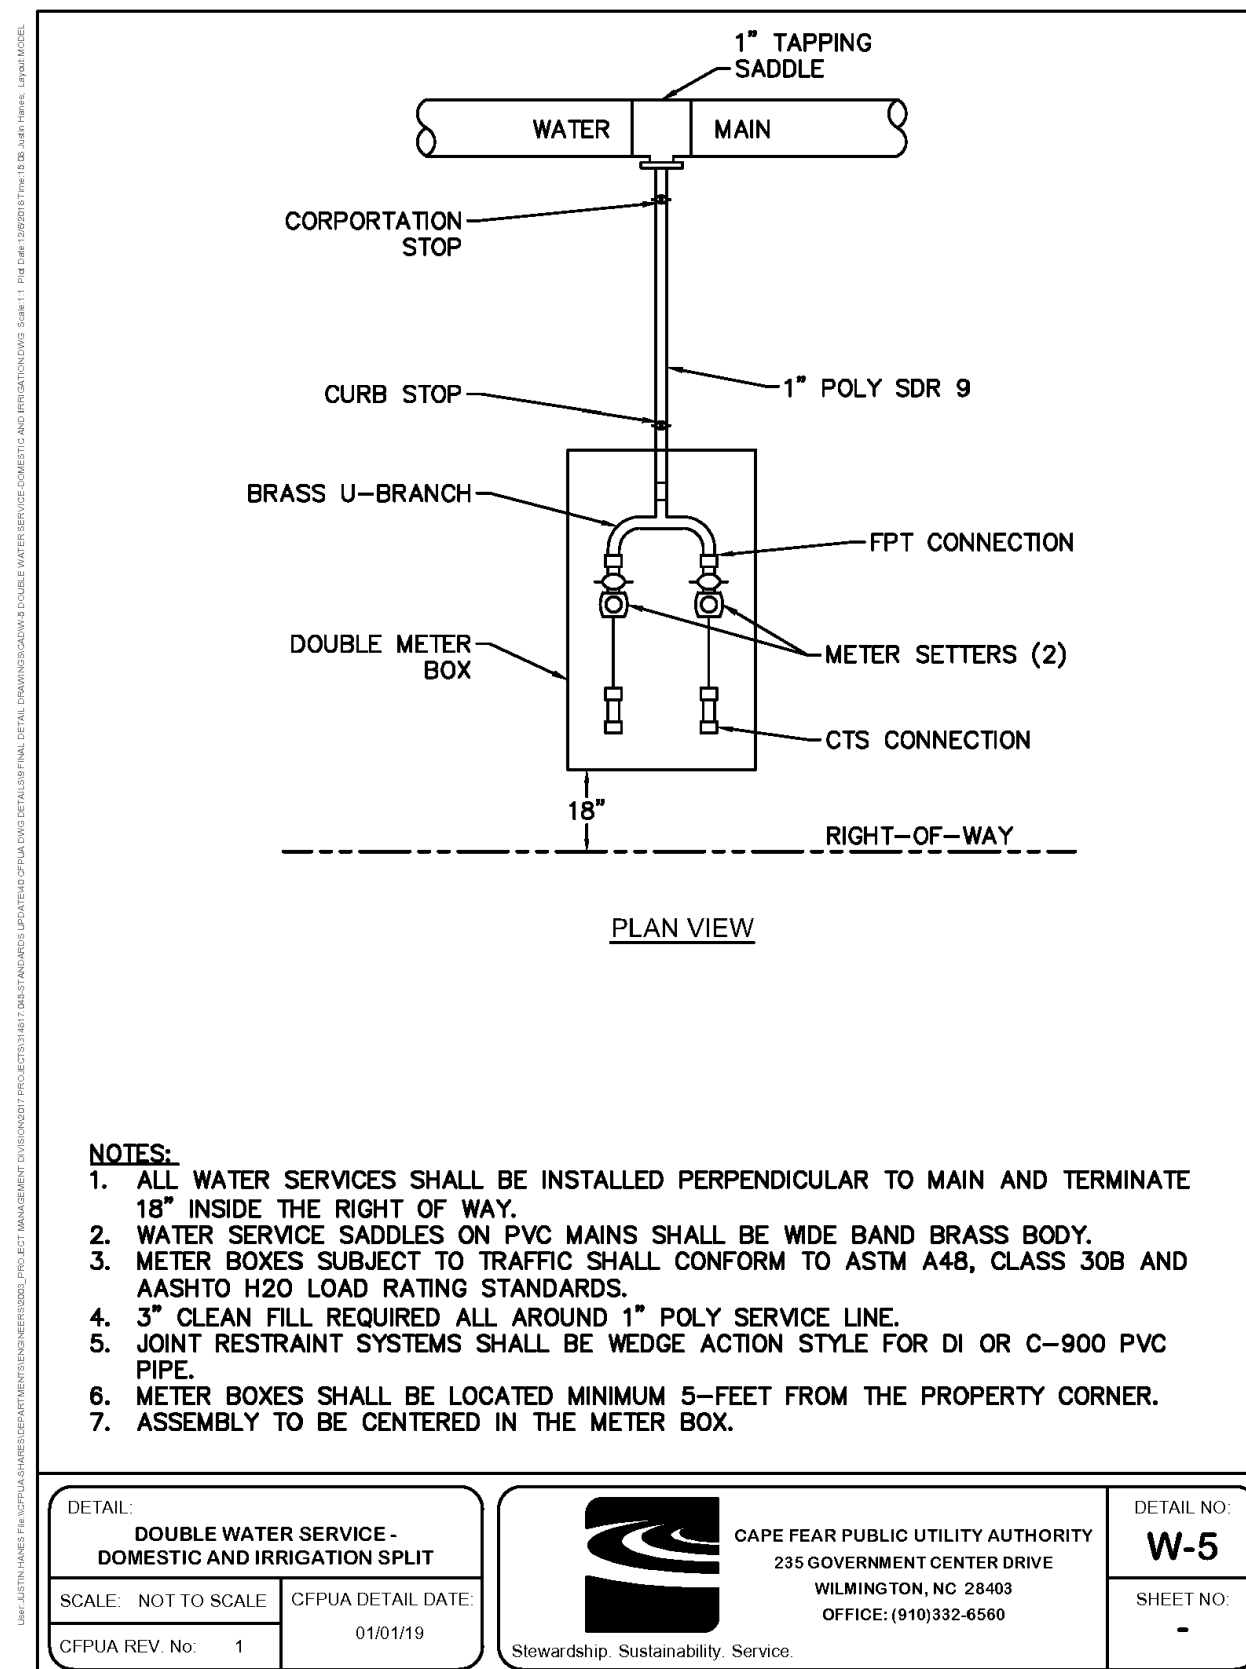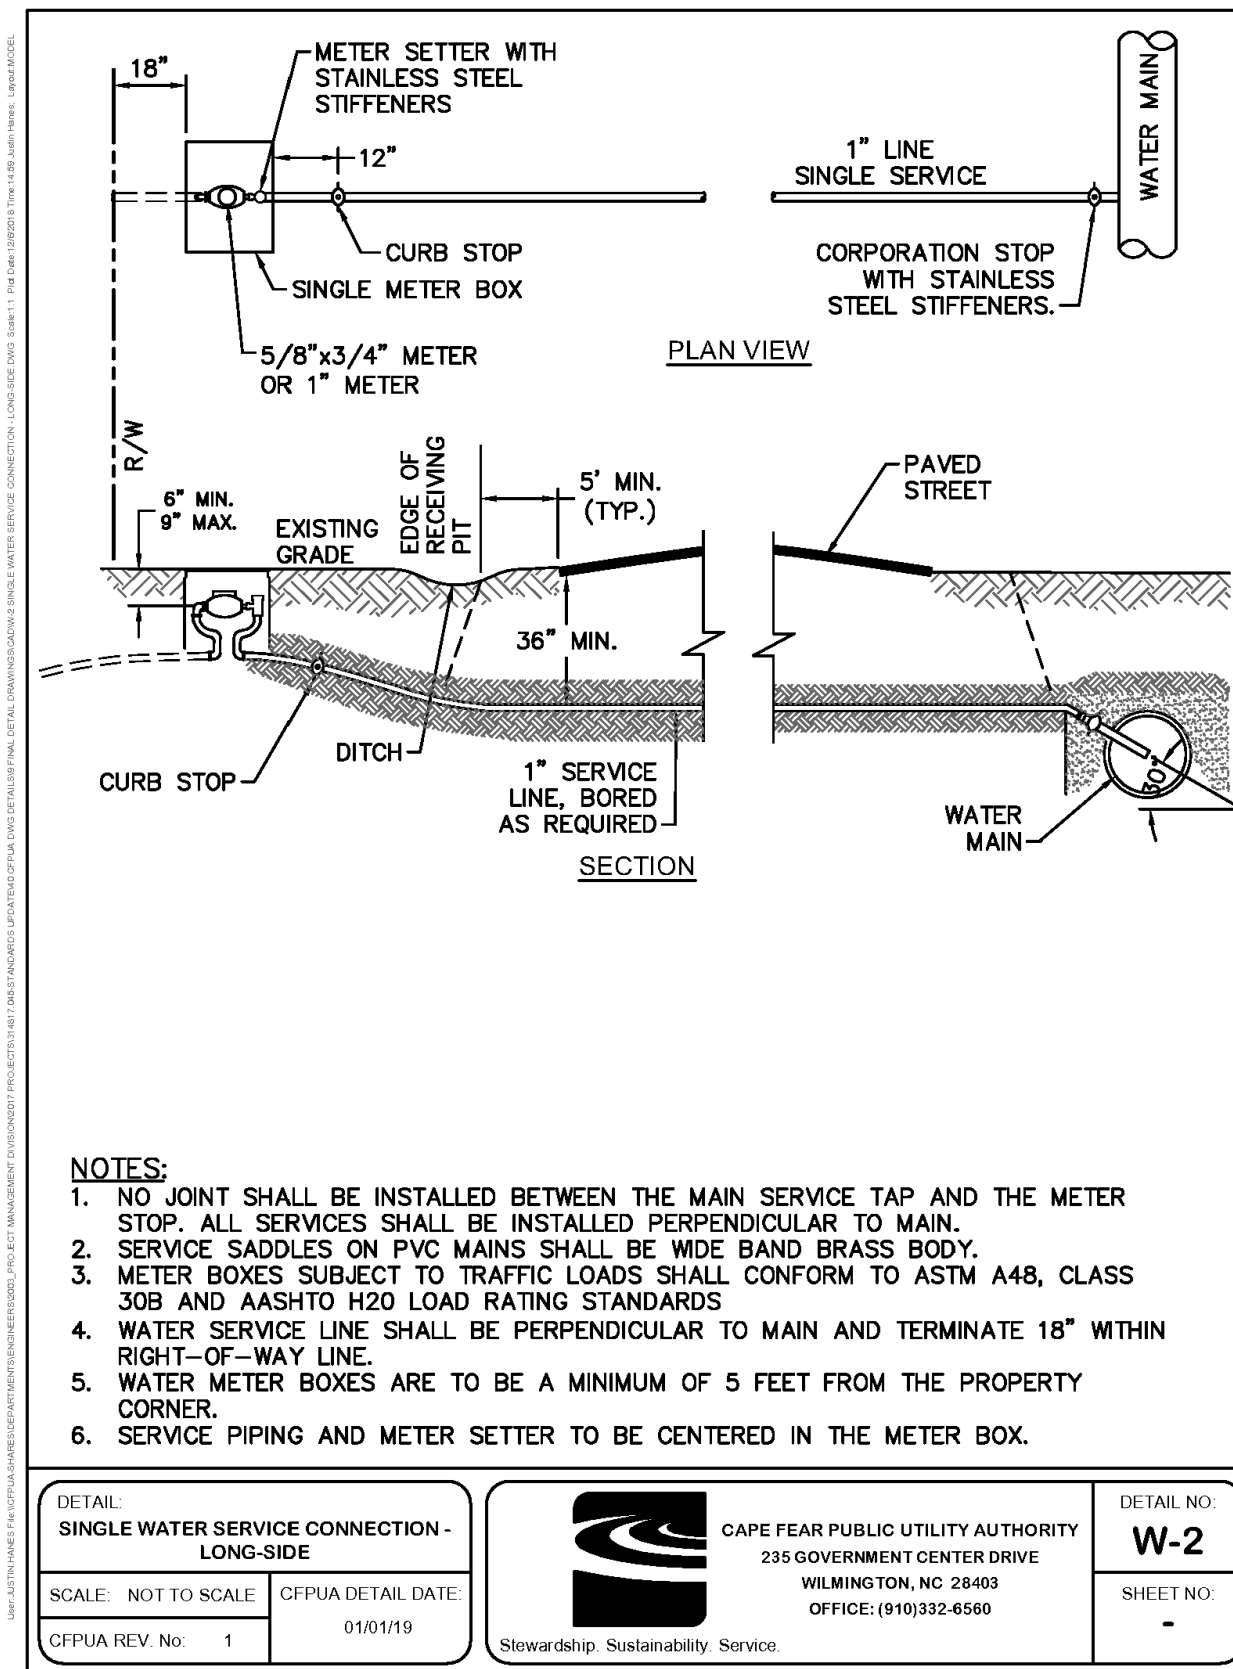

NCDENR PWSS WATER PERMIT #: \_\_\_\_\_  
 WATER CAPACITY: \_\_\_\_\_ GPD  
 DWQ SEWER PERMIT #: \_\_\_\_\_  
 SEWER CAPACITY: \_\_\_\_\_ GPD  
 SEWER SHED # AND PLANT: \_\_\_\_\_  
 SEWER TO FLOW THROUGH NEI: YES OR NO (CIRCLE ONE)

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.

**Approved Construction Plan**  
 Name \_\_\_\_\_ Date \_\_\_\_\_  
 Planning \_\_\_\_\_  
 Traffic \_\_\_\_\_  
 Fire \_\_\_\_\_

APPROVED STORMWATER MANAGEMENT PLAN  
 Date: \_\_\_\_\_ Permit # \_\_\_\_\_  
 Signed: \_\_\_\_\_

**REVISIONS:**

CLIENT INFORMATION:  
 FOOD BANK OF CENTRAL & EASTERN NORTH CAROLINA  
 1924 CAPITAL BLVD.  
 RALEIGH, NC 27604

**PARAMOUNT ENGINEERING**  
 122 Cinema Drive  
 Wilmington, North Carolina 28403  
 (910) 791-6707 (O) (910) 791-6766 (F)  
 N.C. License # C-2846

CFPWA DETAILS  
 THE WILMINGTON FOOD BANK  
 GREENFIELD STREET  
 WILMINGTON, NORTH CAROLINA







PROJECT STATUS:  
 CONCEPT LAYOUT: \_\_\_\_\_  
 PRELIMINARY LAYOUT: \_\_\_\_\_  
 FINAL DESIGN LAYOUT: \_\_\_\_\_  
 RELEASED FOR CONSTRUCTION: \_\_\_\_\_

DRAWING INFORMATION:  
 DATE: 10/13/21  
 SCALE: \_\_\_\_\_  
 DRAWING: \_\_\_\_\_  
 CHECKED: \_\_\_\_\_

Professional Seal redacted on electronic copy per City of Wilmington Policy

**C-7.1**  
 PEI JOB#: 20484.PE

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

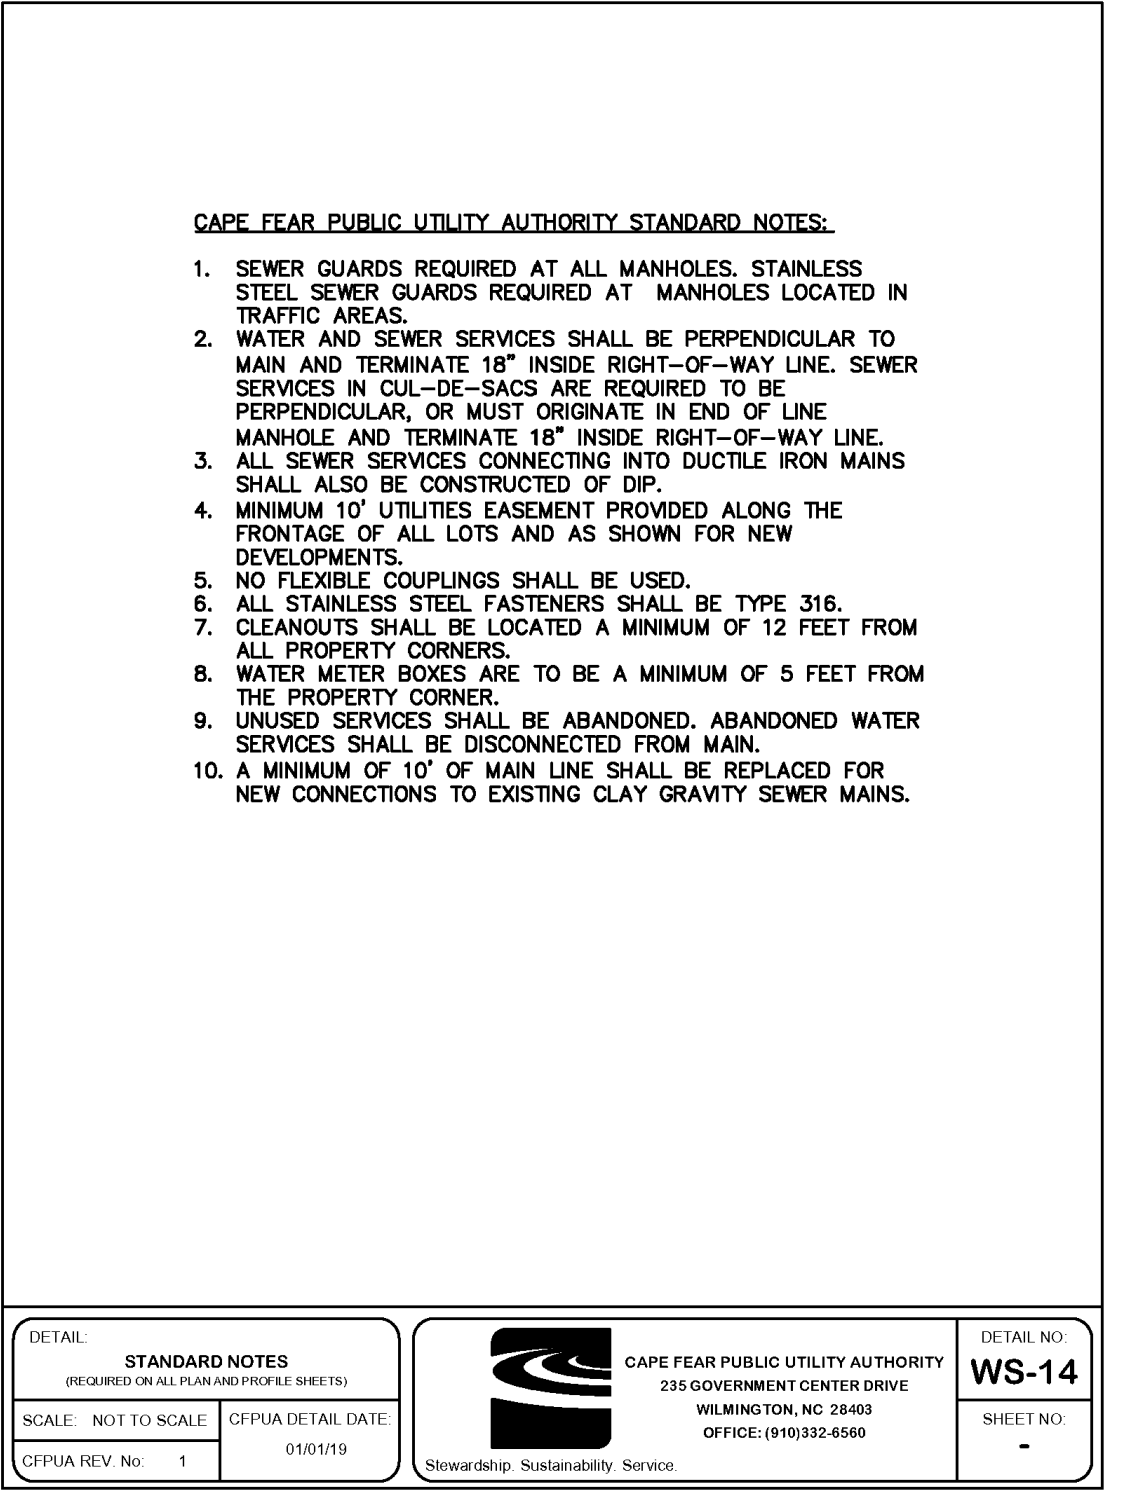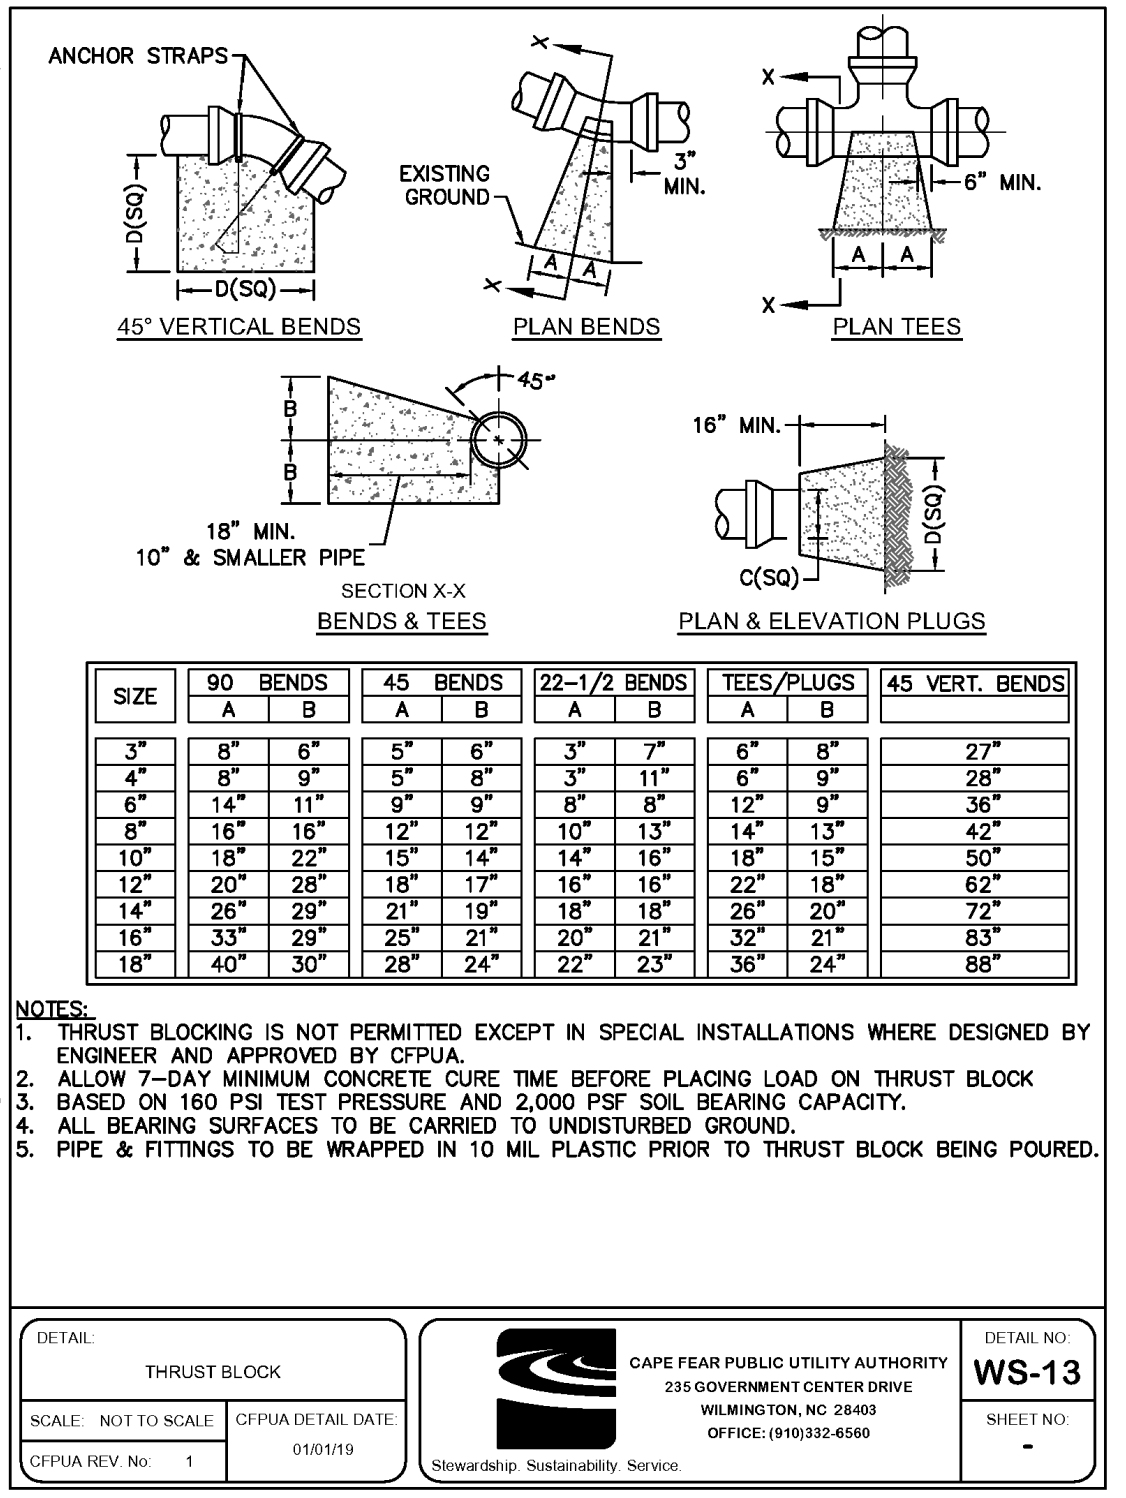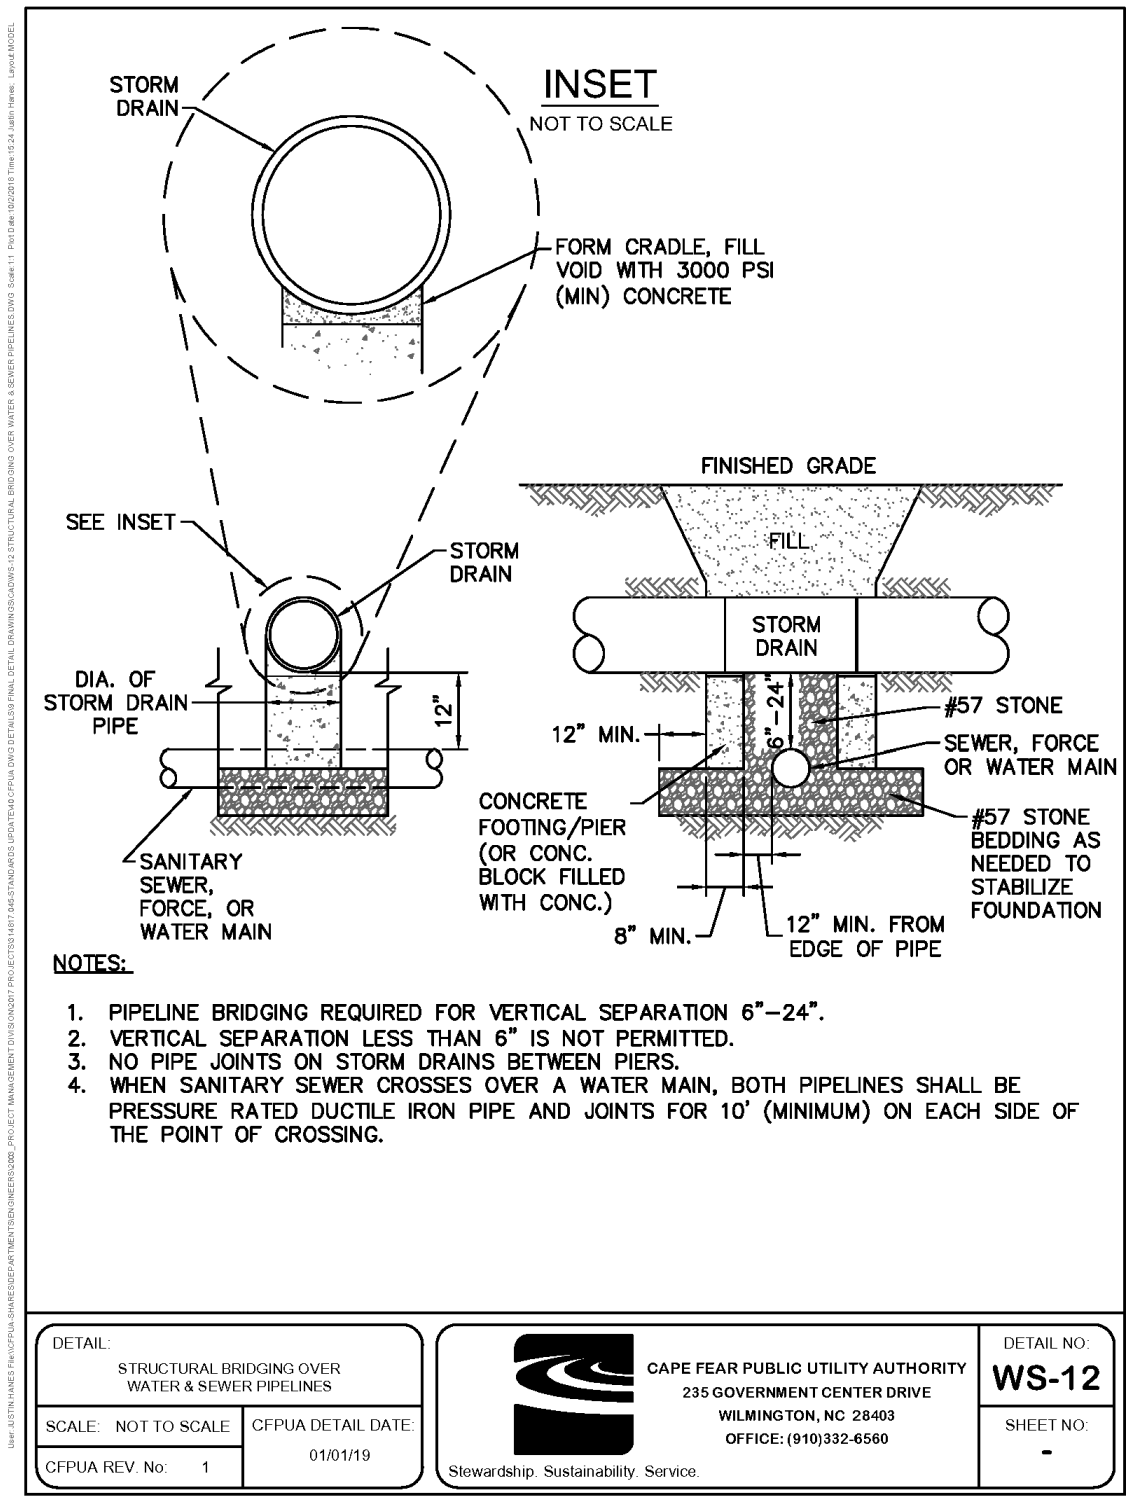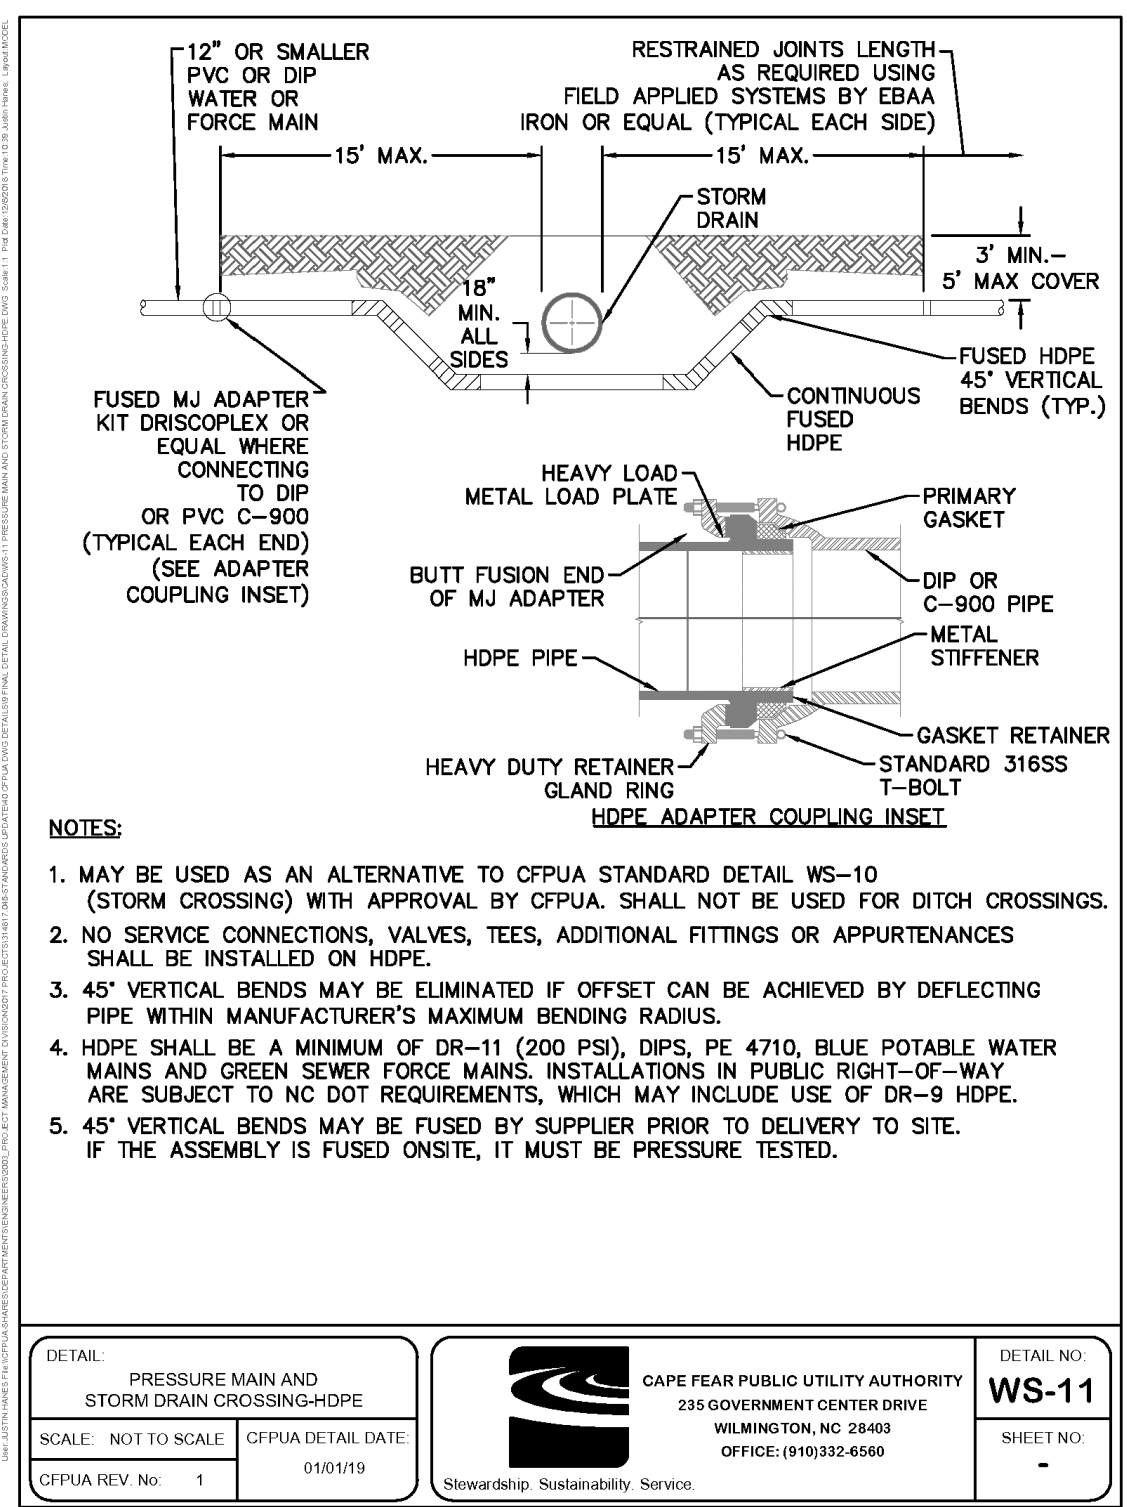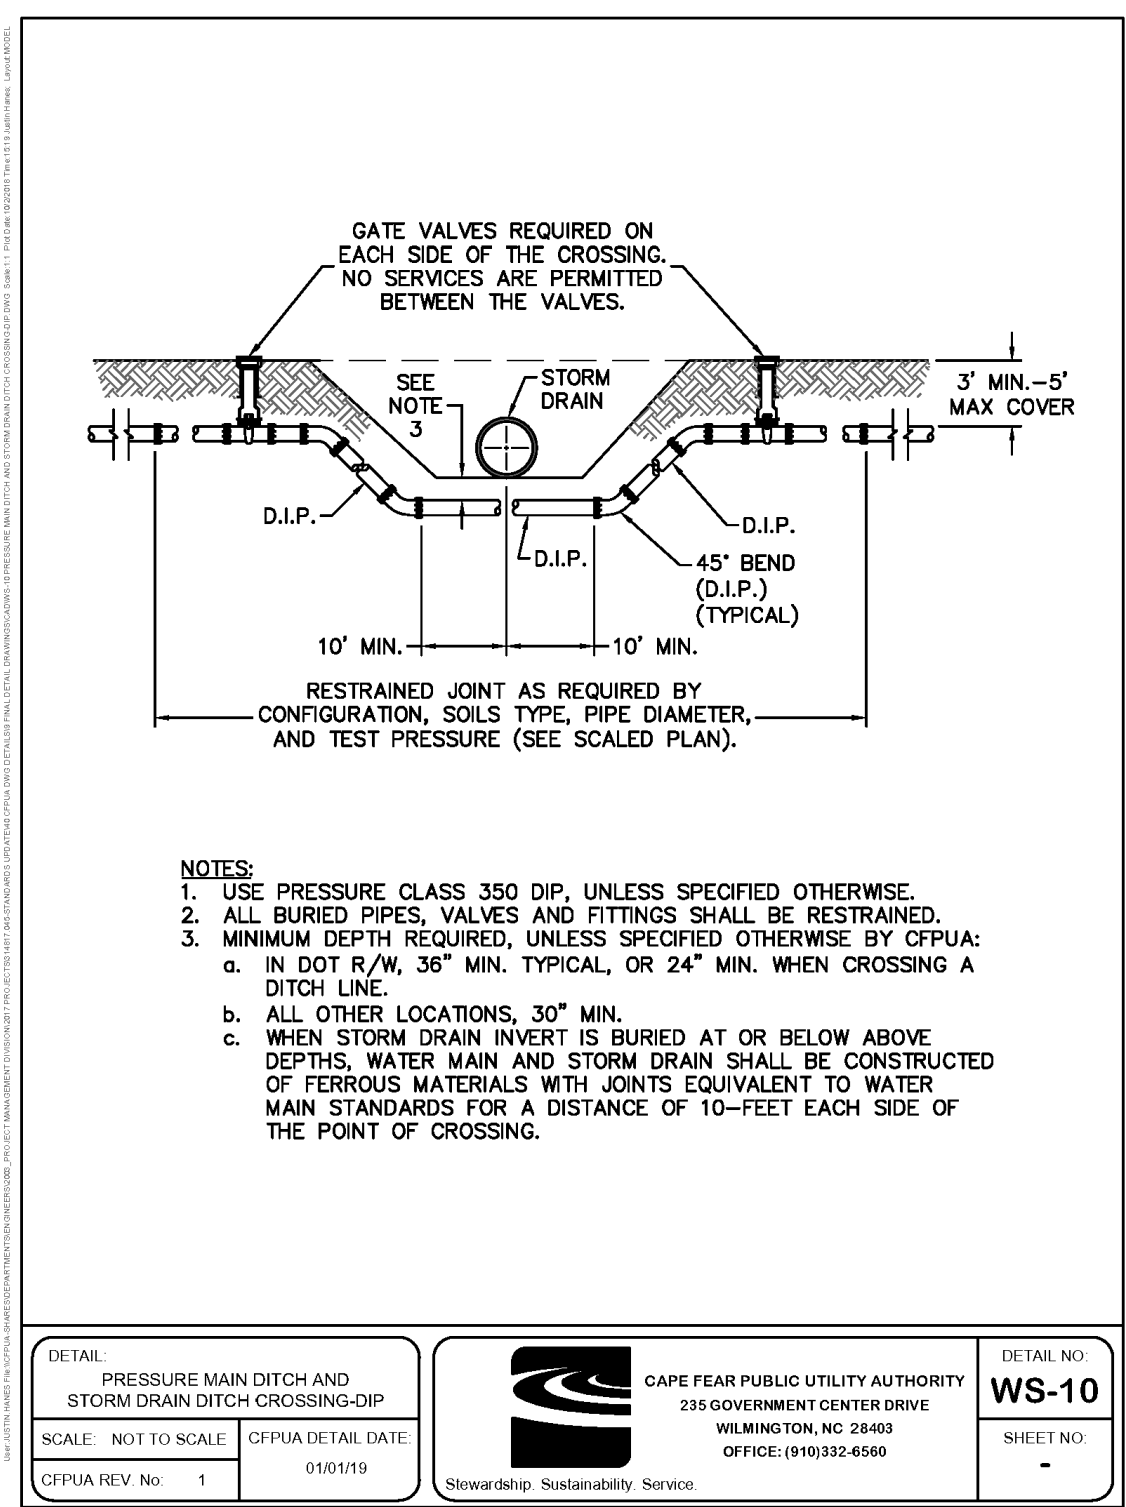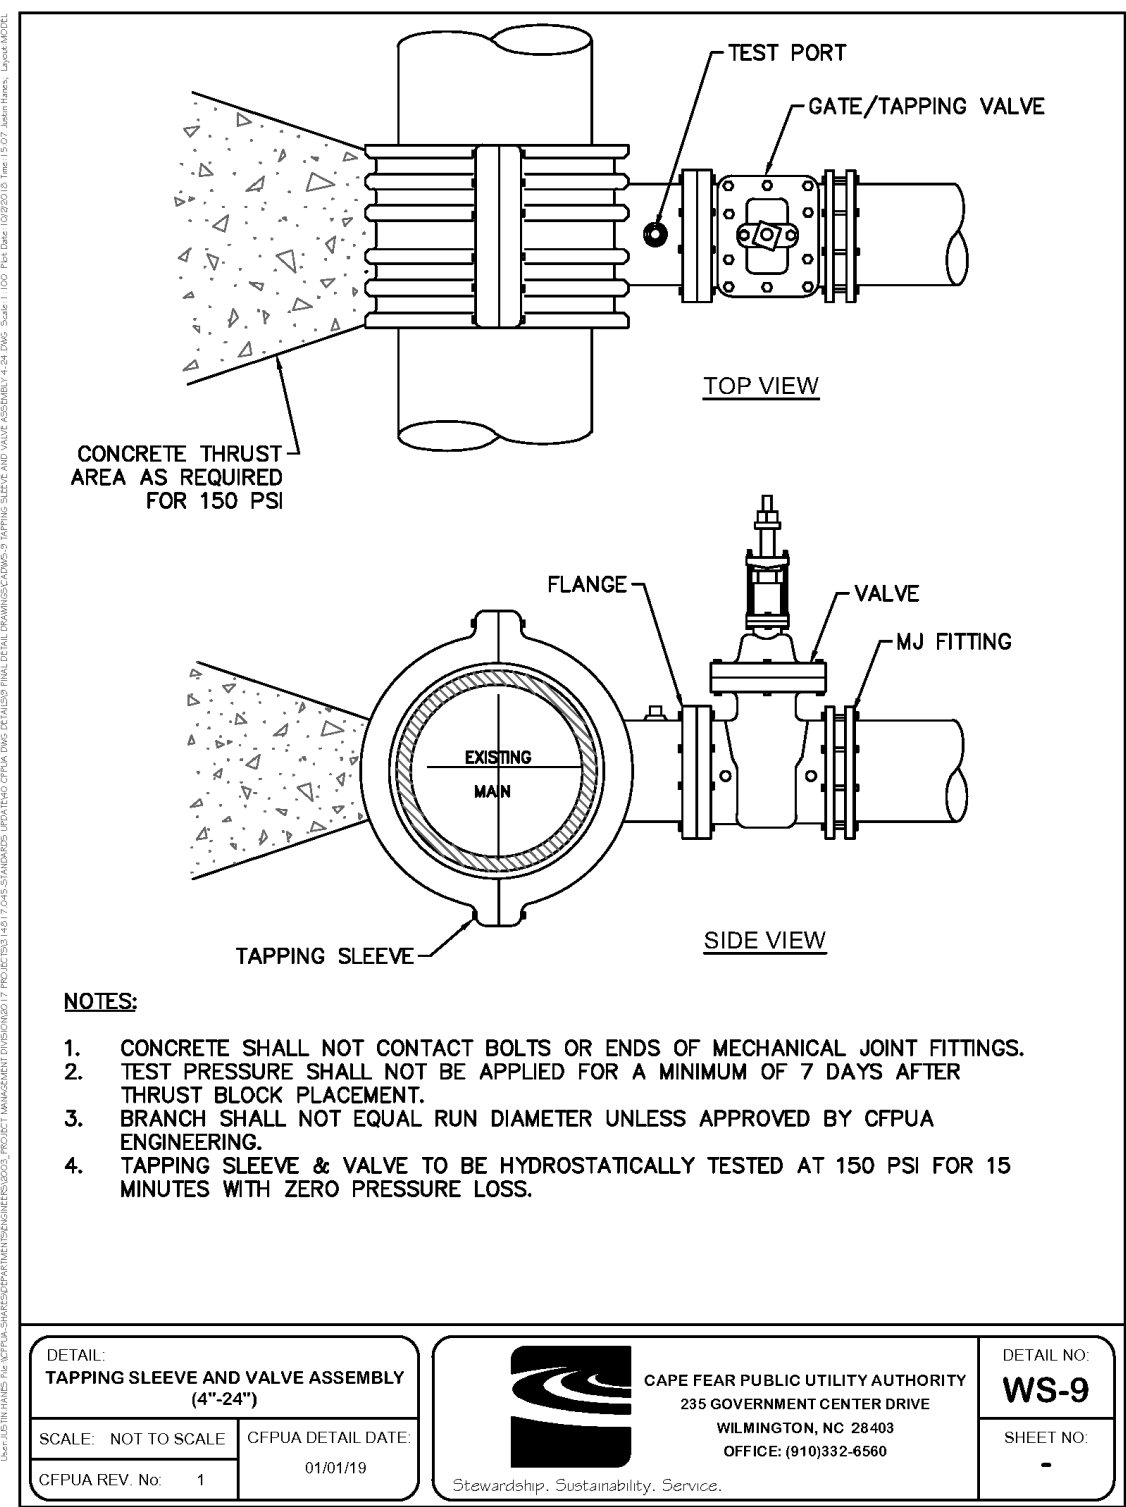

PROJECT STATUS:  
CONCEPTUAL LAYOUT:  
FINAL DESIGN LAYOUT:  
RELEASED FOR CONSTRUCTION

DRAWING INFORMATION:  
DATE: 10/13/21  
SCALE: PEI  
DRAWN BY: PEI  
CHECKED: PEI

SEAL: [Professional Seal] CA  
Professional Seal redacted on electronic copy per City of Wilmington Policy

PEI JOB#: 20484.PE

NCDENR PWSS WATER PERMIT #: \_\_\_\_\_  
WATER CAPACITY: \_\_\_\_\_ GPD

DWQ SEWER PERMIT #: \_\_\_\_\_  
SEWER CAPACITY: \_\_\_\_\_ GPD

SEWER TO FLOW THROUGH NEI: YES or NO (CIRCLE ONE)

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.

**Approved Construction Plan**  
Name \_\_\_\_\_ Date \_\_\_\_\_

Planning \_\_\_\_\_  
Traffic \_\_\_\_\_  
Fire \_\_\_\_\_

Date: \_\_\_\_\_ Permit #: \_\_\_\_\_  
Signed: \_\_\_\_\_


APPROVED STORMWATER MANAGEMENT PLAN

**WILMINGTON**  
NORTH CAROLINA  
Public Services • Engineering Division


APPROVED STORMWATER MANAGEMENT PLAN

Date: \_\_\_\_\_ Permit #: \_\_\_\_\_  
Signed: \_\_\_\_\_



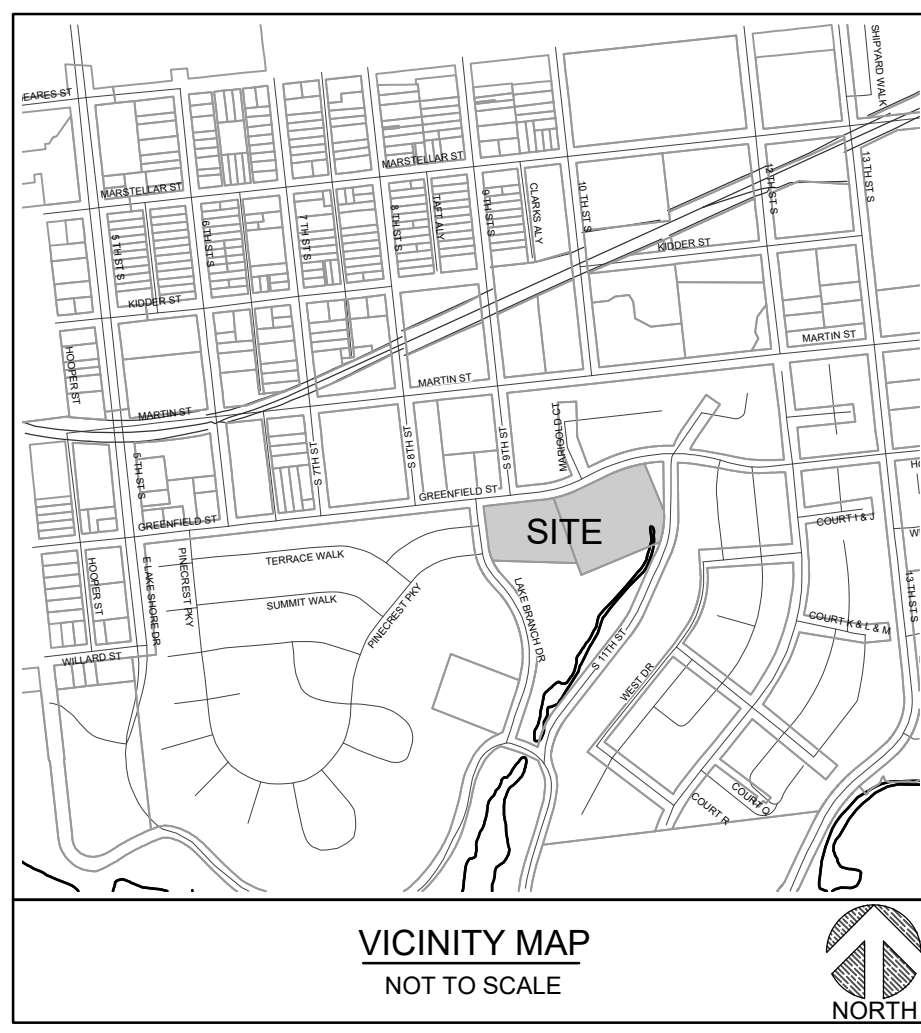

VICINITY MAP  
NOT TO SCALE

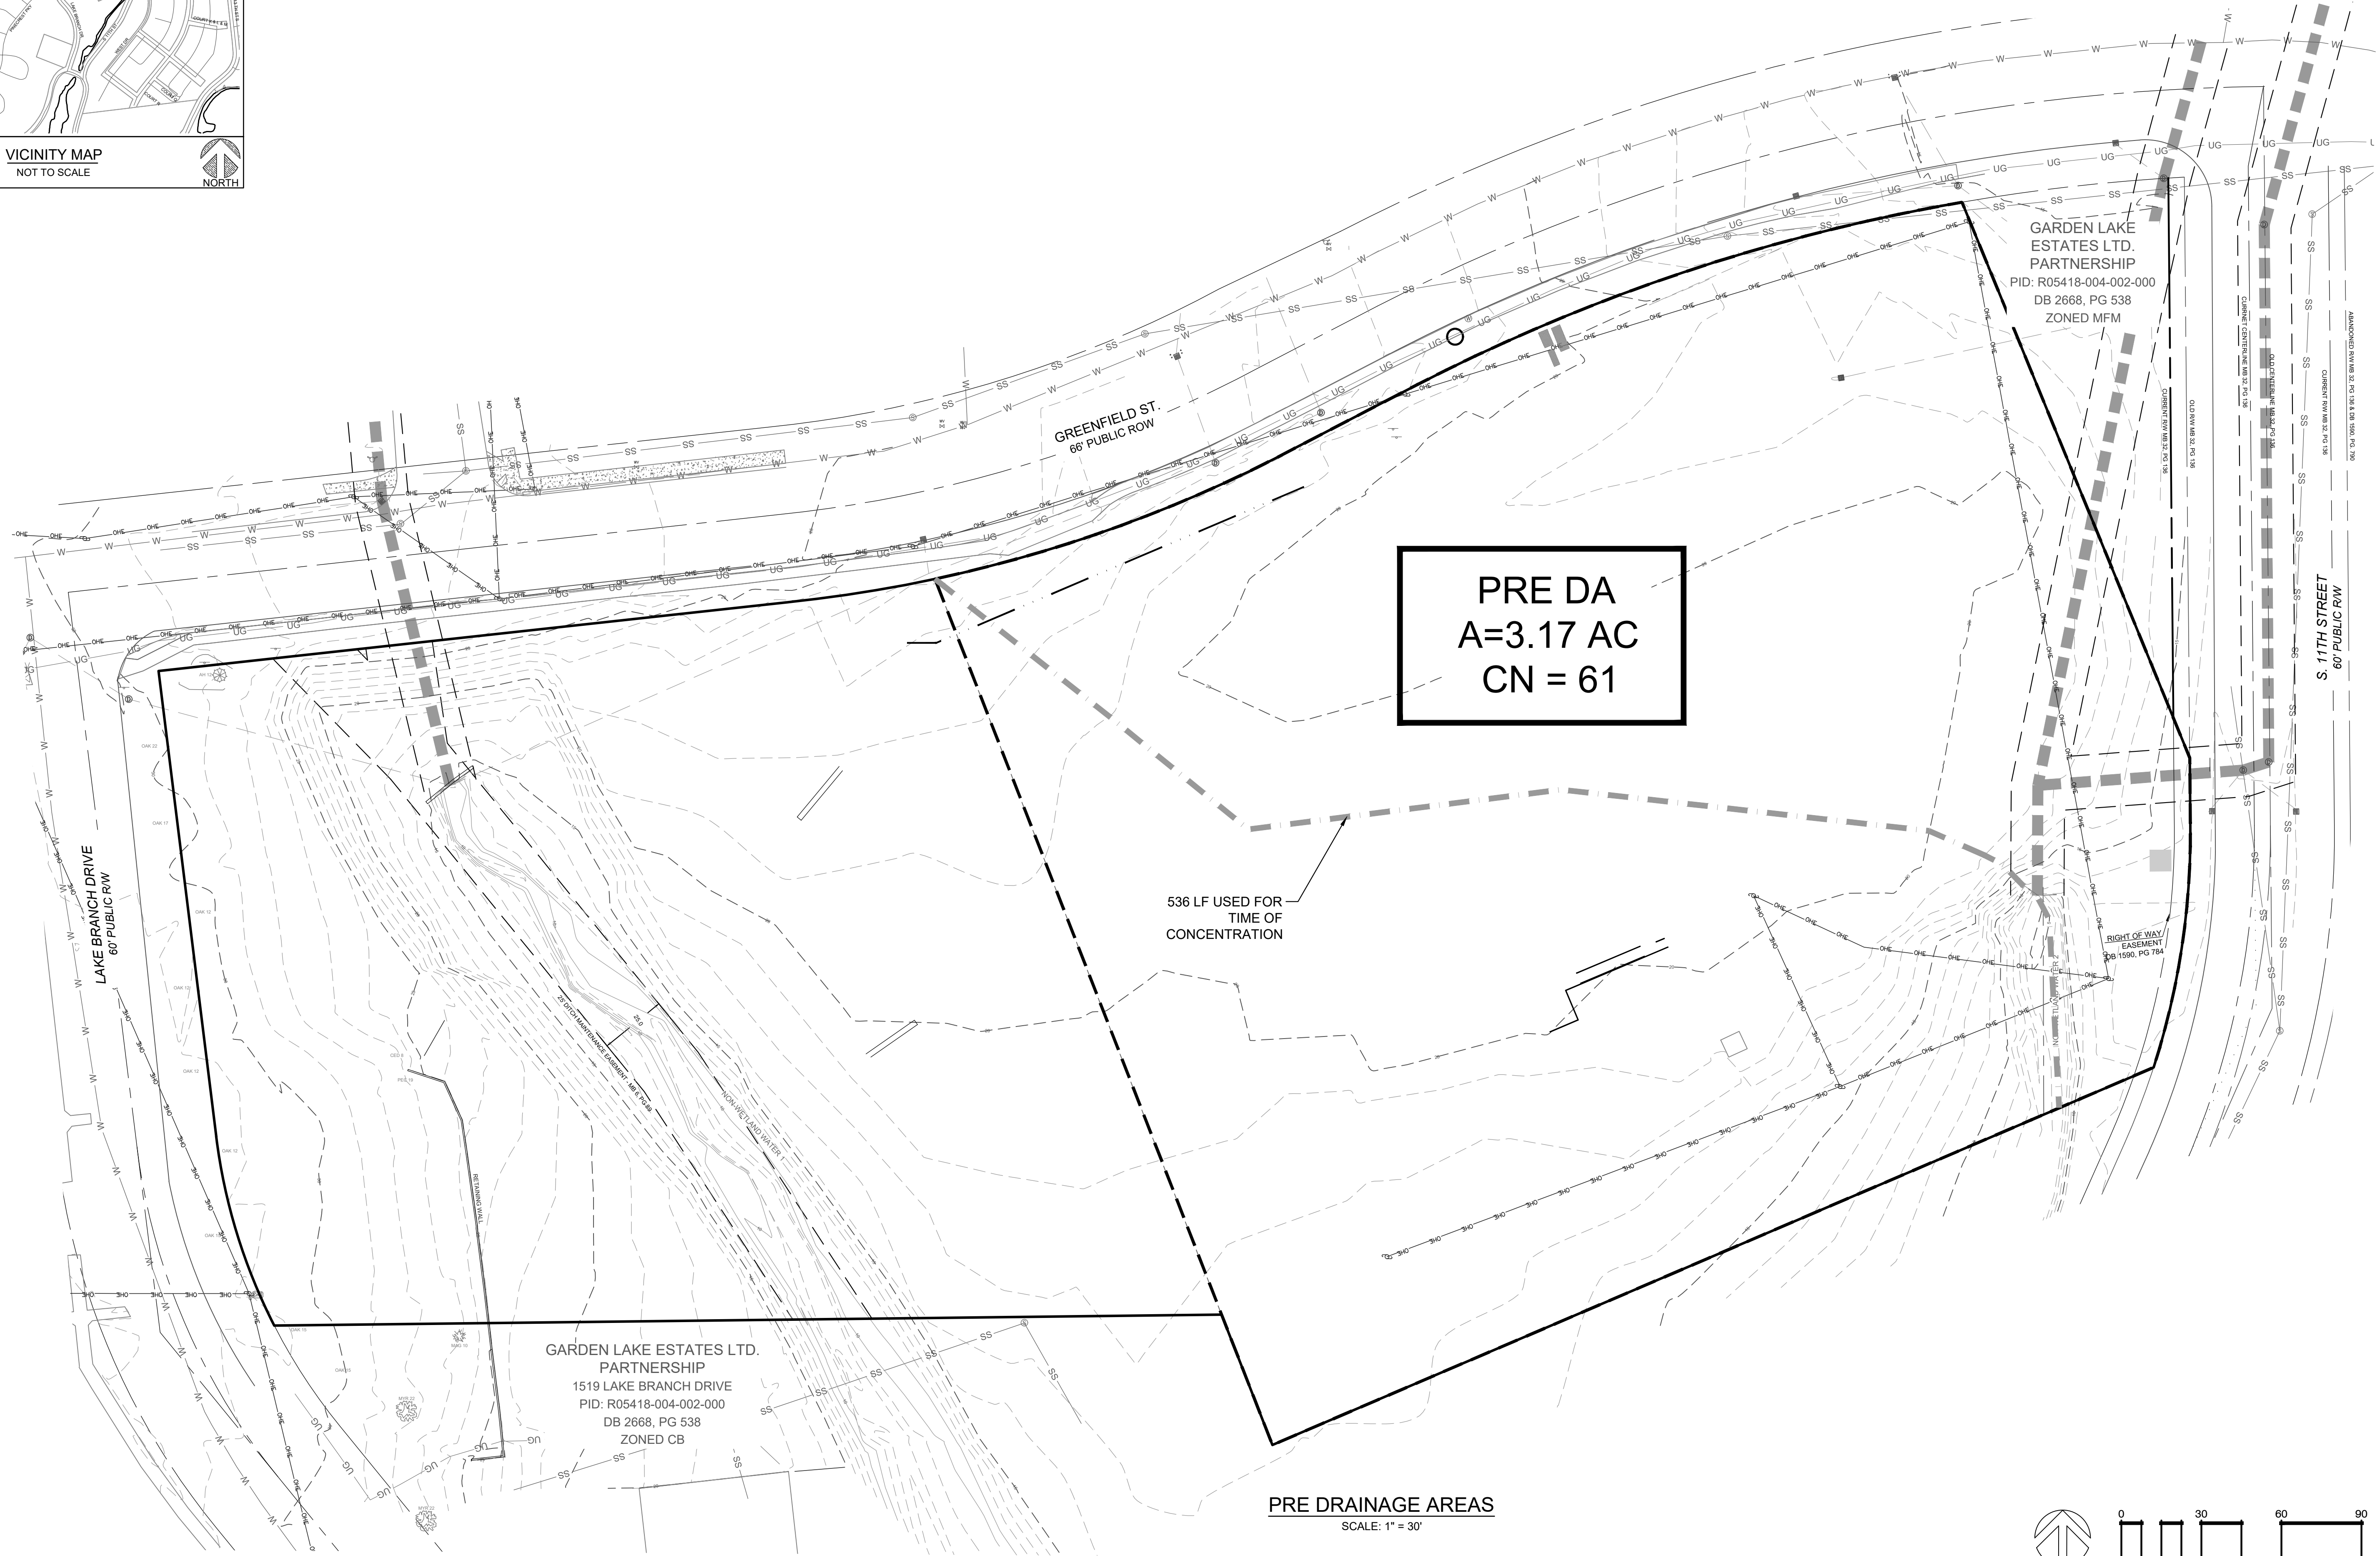


PRE DA  
A=3.17 AC  
CN = 61

536 LF USED FOR  
TIME OF  
CONCENTRATION

GARDEN LAKE ESTATES LTD.  
PARTNERSHIP  
1519 LAKE BRANCH DRIVE  
PID: R05418-004-002-000  
DB 2668, PG 538  
ZONED CB

GARDEN LAKE  
ESTATES LTD.  
PARTNERSHIP  
PID: R05418-004-002-000  
DB 2668, PG 538  
ZONED MFM

PRE DRAINAGE AREAS  
SCALE: 1" = 30'

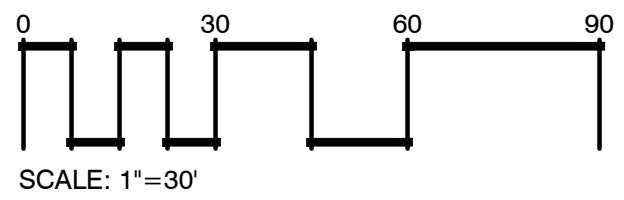

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

NO.	REVISIONS

CLIENT INFORMATION:  
FOOD BANK OF CENTRAL &  
EASTERN NORTH CAROLINA  
1924 CAPITAL BLVD.  
RALEIGH, NC 27604



**PARAMOUNTE**  
ENGINEERING, INC.  
122 Cinema Drive  
Wilmington, North Carolina 28403  
(910) 791-6707 (O) (910) 791-6760 (F)  
NC License #: C-2846

PRE DA MAP  
THE WILMINGTON FOOD BANK  
GREENFIELD STREET  
WILMINGTON, NORTH CAROLINA

PROJECT STATUS	DRAWING INFORMATION
ORIGINAL LAYOUT:	DATE: 10/02/20
FINAL DESIGN:	SCALE: 1" = 30'
RELEASED FOR CONSTRUCTION:	DRAWN BY: GIB
	CHEKED: GIB

Professional Seal  
redacted on  
electronic copy  
per City of  
Wilmington Policy

**DA-1**  
PEI JOB#: 20484.PE

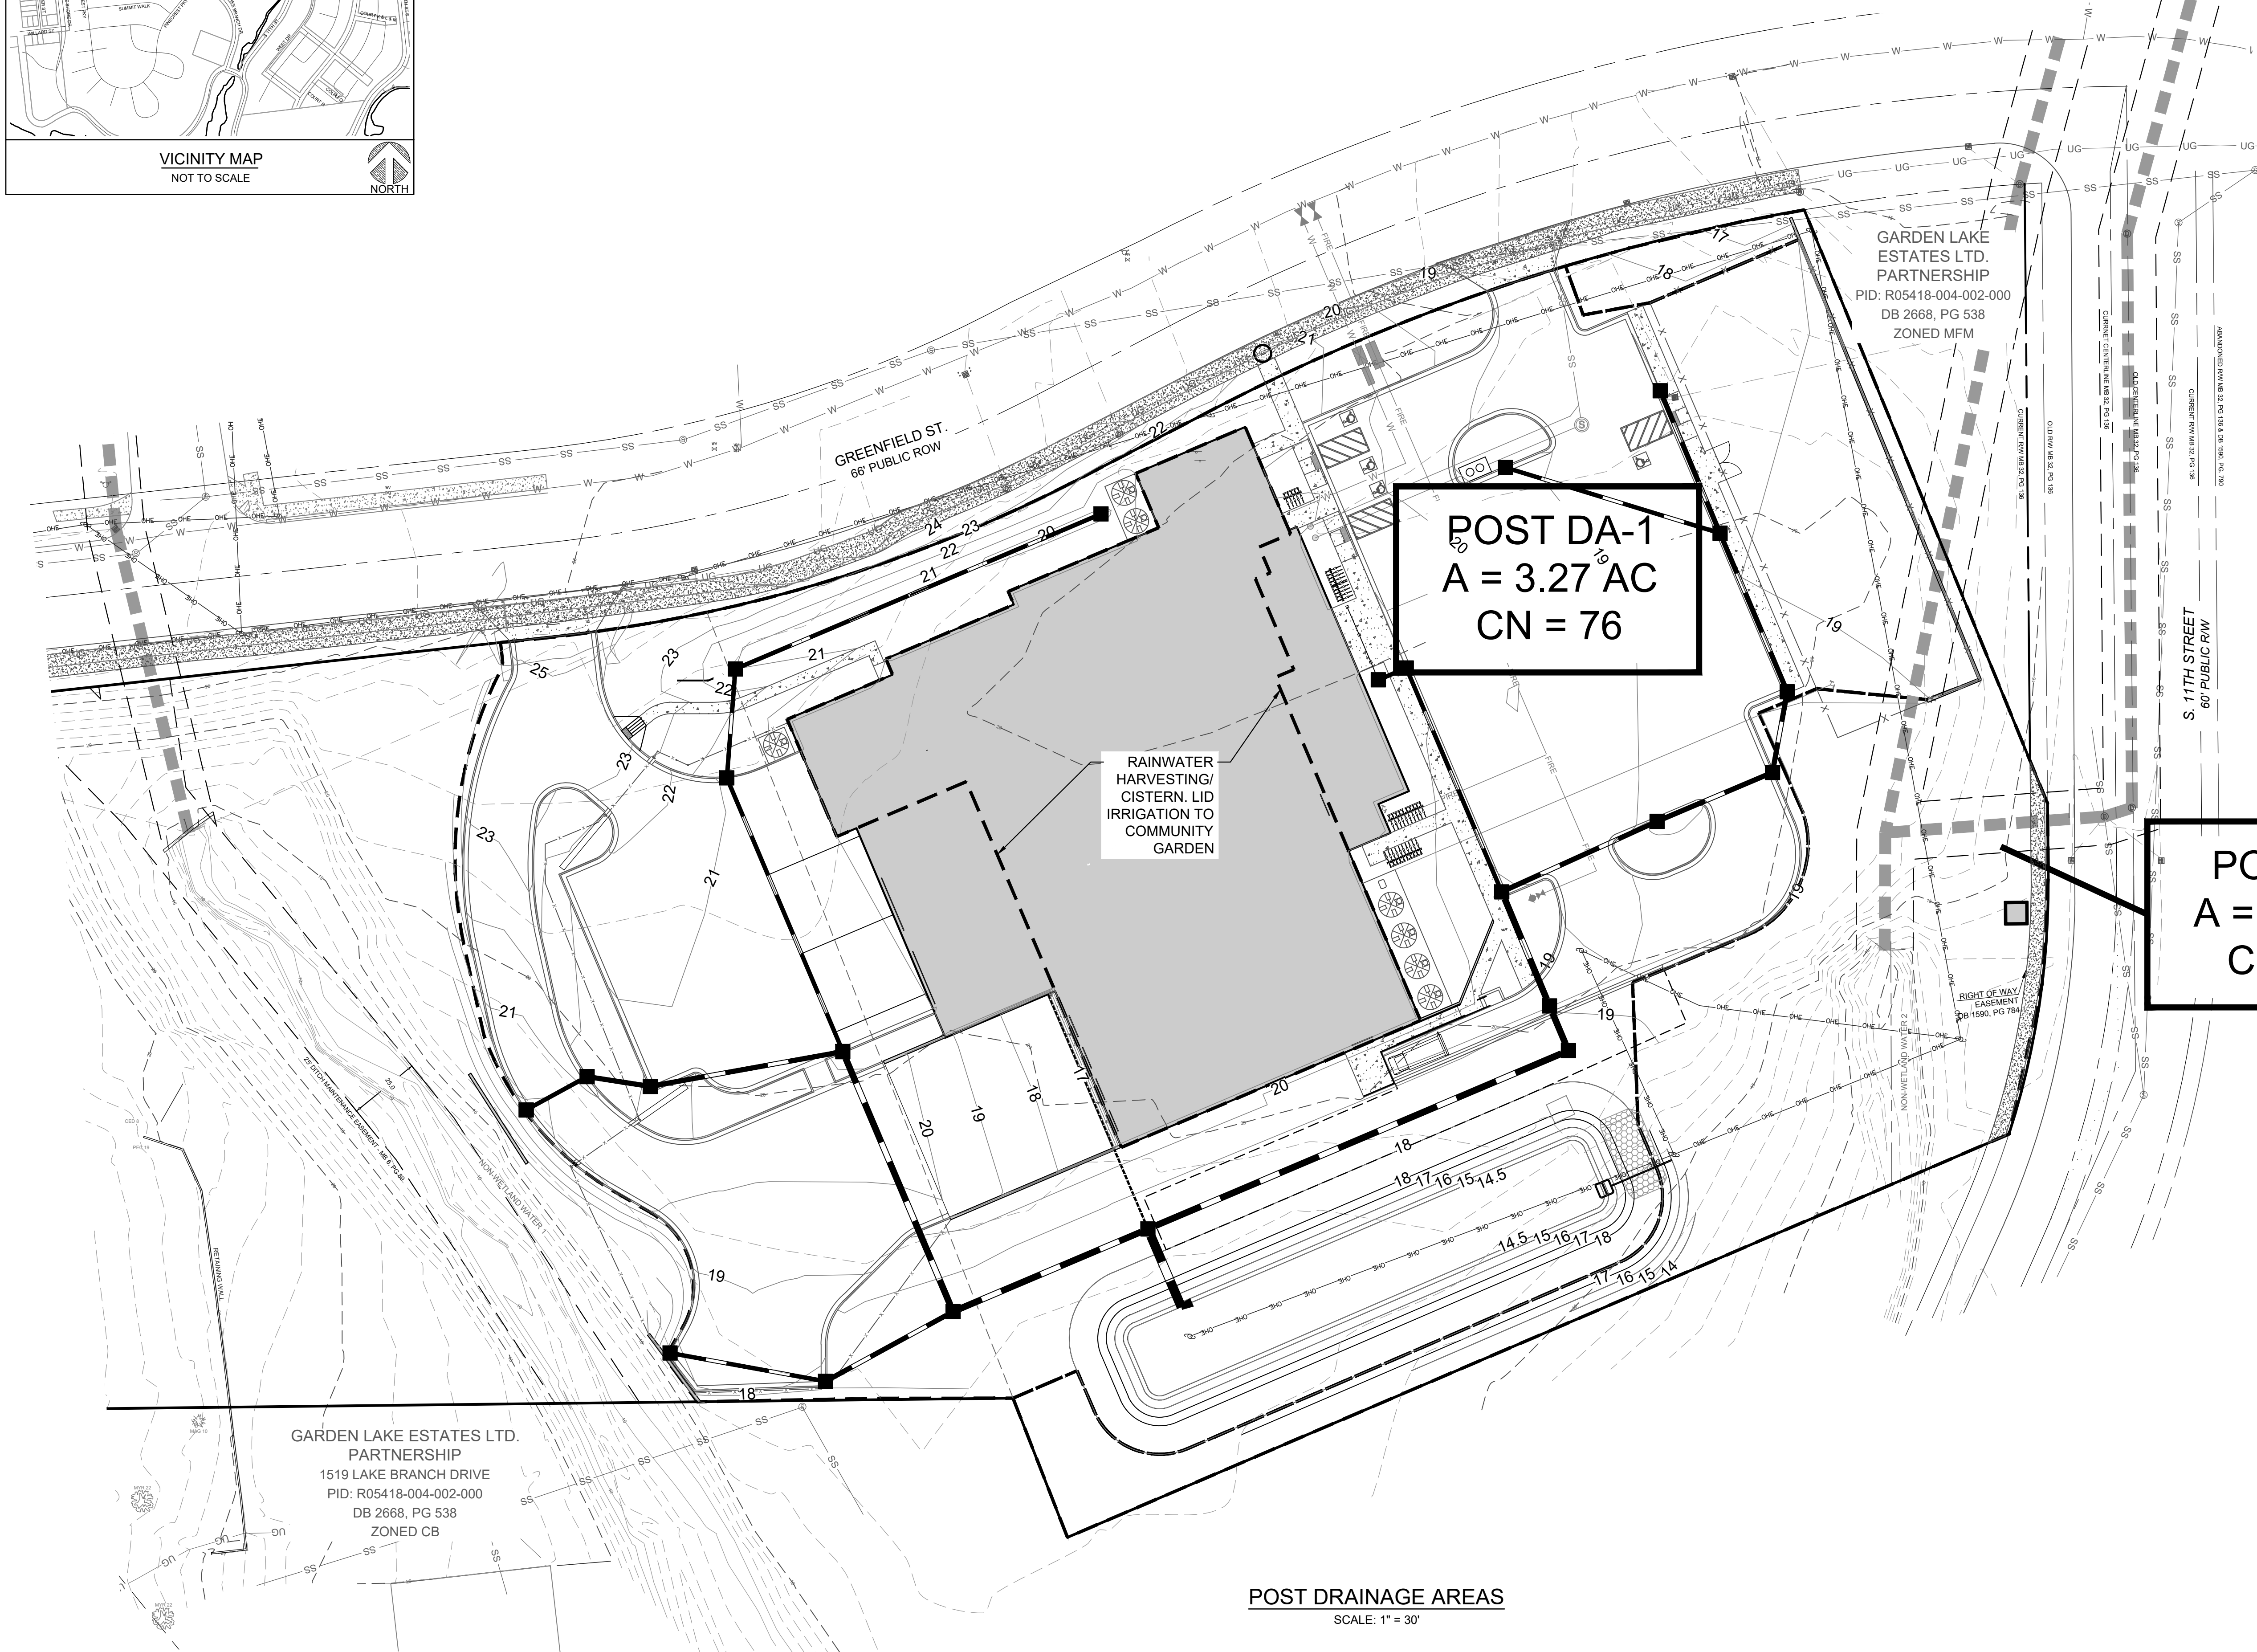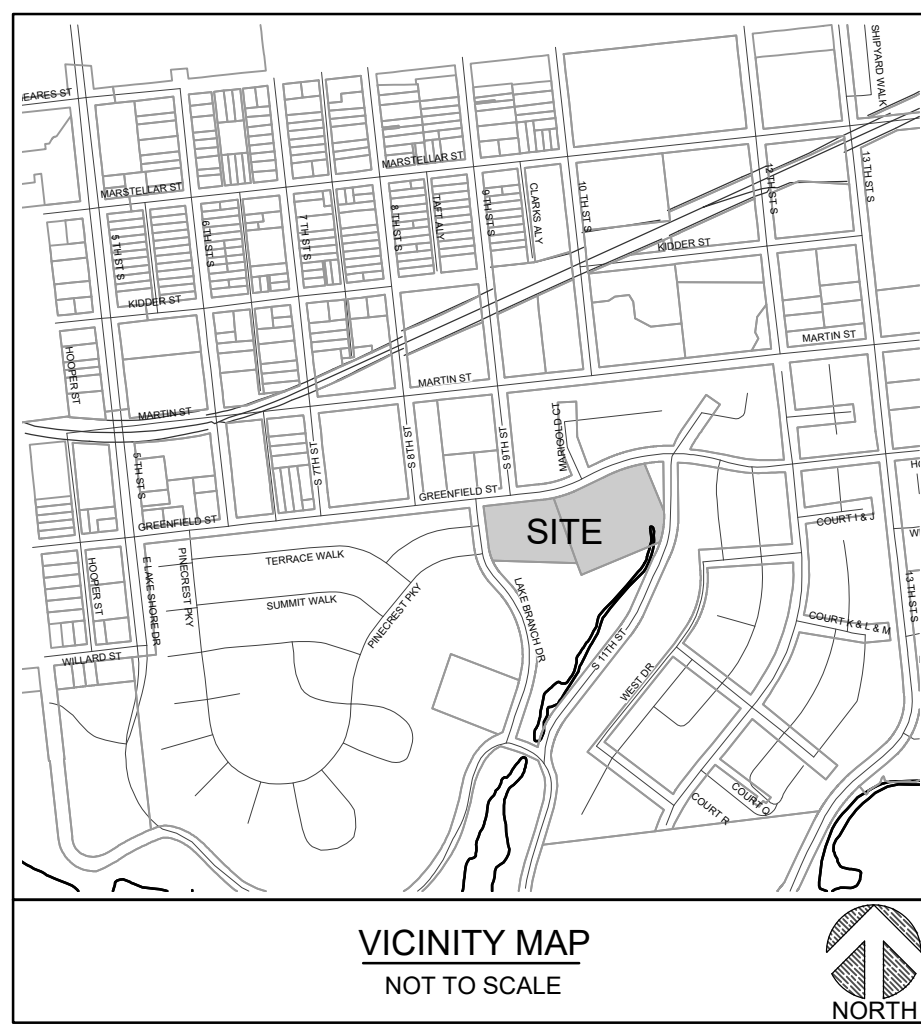

GARDEN LAKE ESTATES LTD.  
PARTNERSHIP  
1519 LAKE BRANCH DRIVE  
PID: R05418-004-002-000  
DB 2668, PG 538  
ZONED CB


GARDEN LAKE ESTATES LTD.  
PARTNERSHIP  
PID: R05418-004-002-000  
DB 2668, PG 538  
ZONED MFM

**POST DA-1**  
A = 3.27 AC  
CN = 76

**POST RA**  
A = 0.64 AC  
CN = 39

RAINWATER HARVESTING/  
CISTERN. LID  
IRRIGATION TO  
COMMUNITY  
GARDEN

**POST DRAINAGE AREAS**  
SCALE: 1" = 30'

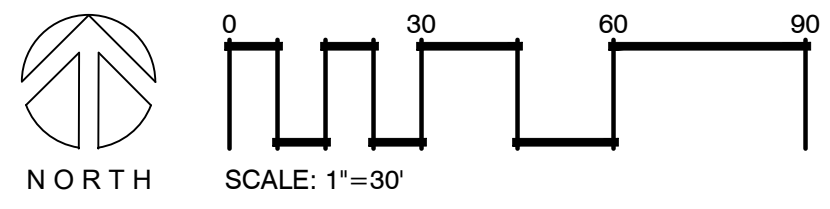

FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

REVISIONS:

CLIENT INFORMATION:  
FOOD BANK OF CENTRAL &  
EASTERN NORTH CAROLINA  
1924 CAPITAL BLVD.  
RALEIGH, NC 27604


**PARAMOUNTE**  
ENGINEERING INC.  
122 Cinema Drive  
Wilmington, North Carolina 28403  
(910) 791-6707 (O) (910) 791-6760 (F)  
NC License #: C-2846

**POST DA MAP**  
THE WILMINGTON FOOD BANK  
GREENFIELD STREET  
WILMINGTON, NORTH CAROLINA

PROJECT STATUS	DRAWING INFORMATION
ORIGINAL LAYOUT:	10/2022
FINAL DESIGN:	1" = 30'
RELEASED FOR CONSTRUCTION:	1" = 30'
DATE:	10/2022
SCALE:	1" = 30'
DRAWN BY:	GB
CHECKED:	GB


SEAL  
Professional Seal  
redacted on  
electronic copy  
per City of  
Wilmington Policy

**DA-2**  
PEI JOB#: 20484.PE

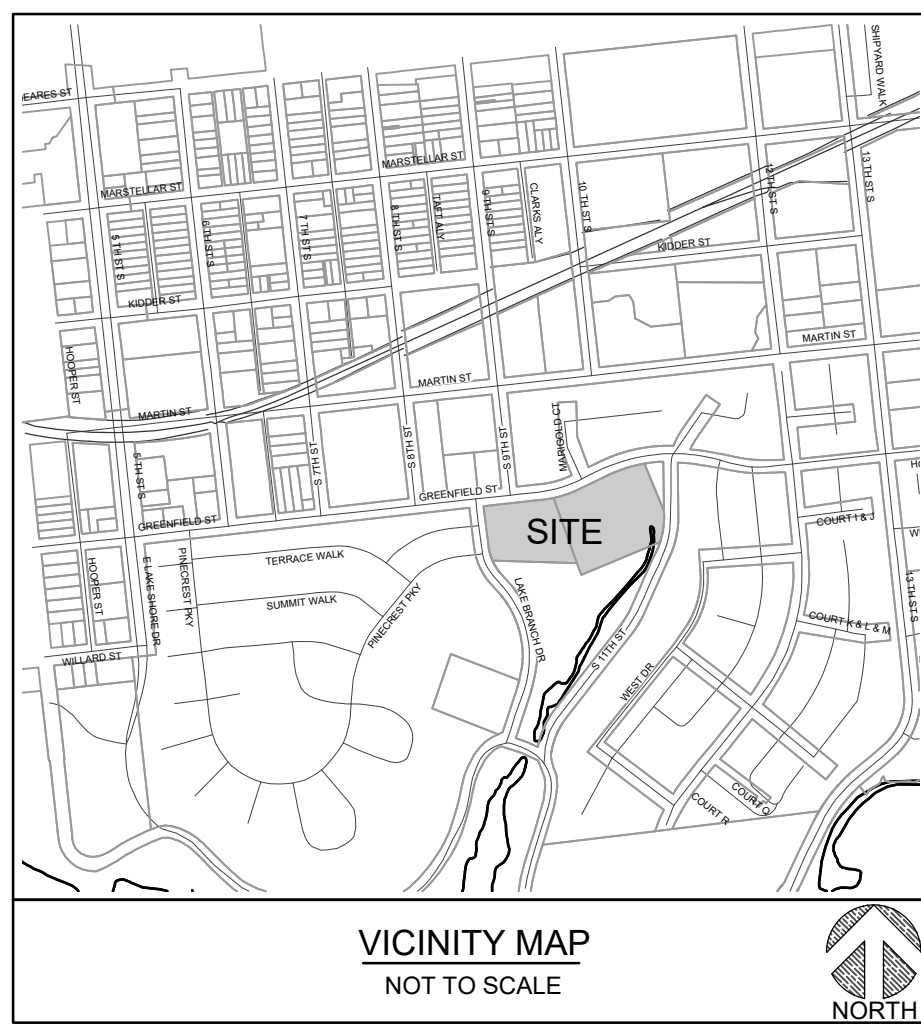


**INLET DRAINAGE AREAS:**

Storm Drainage Node	Drainage Area (sqft)	Drainage Area (Acres)
MH 101	0	0
MH 102	0	0
CB 103	6042.3	0.14
CB 104	1976.2	0.05
CB 105	10723.7	0.25
CB 106	5821	0.13
CB 107	1876.7	0.04
CB 108	3192.3	0.07
CB 109	1015.8	0.02
DI 110	1522	0.03
DI 111	7106.3	0.17
MH 120	0	0.00
CB 121	3160.9	0.07
CB 122	3733	0.09
CB 123	3107.8	0.07
DI 124	3213.6	0.07
CB 125	869	0.02
CB 126	5741.8	0.13
CB 127	6579.2	0.15
CB 128	876.1	0.02
CB 129	18125	0.42
CB 130	2432.1	0.06

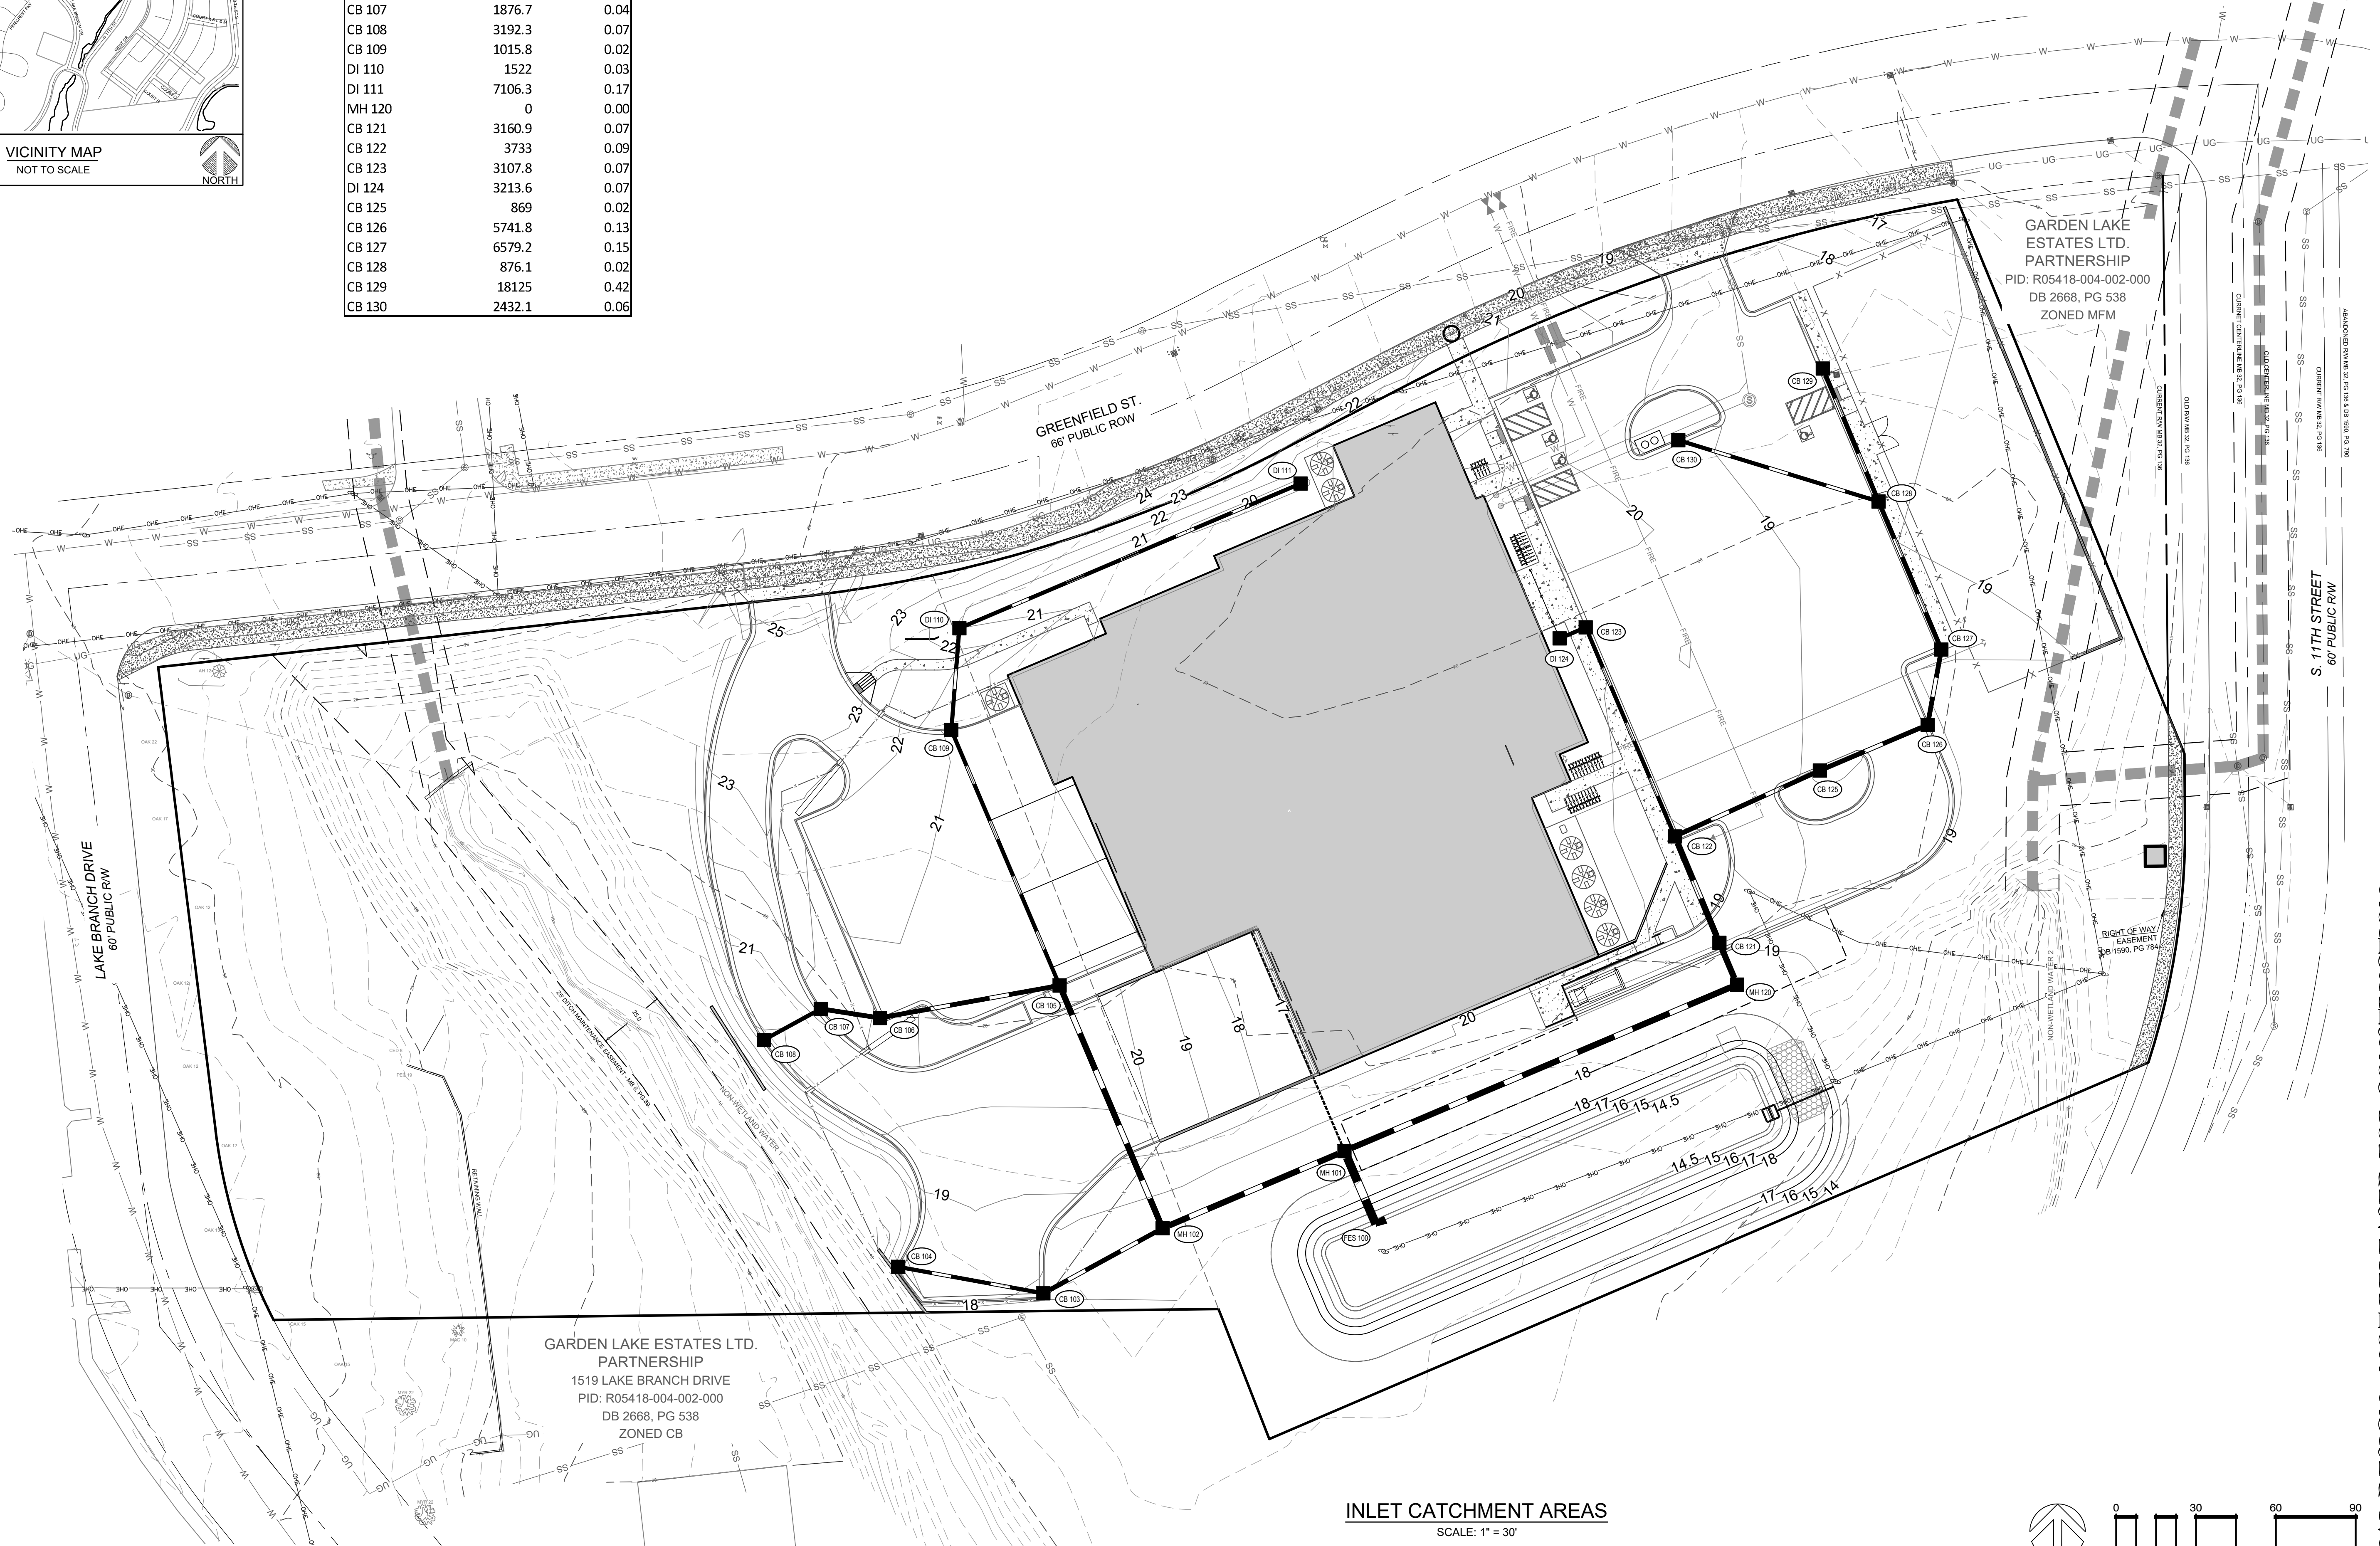

**INLET CATCHMENT AREAS**  
SCALE: 1" = 30'

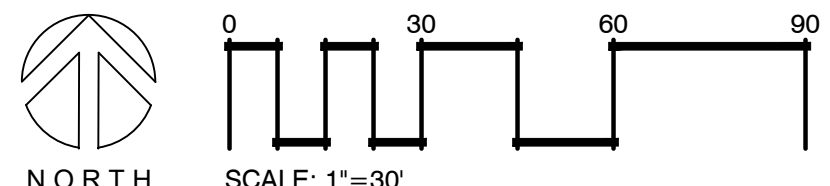

**REVISIONS:**

NO.	DATE	DESCRIPTION

**CLIENT INFORMATION:**  
**FOOD BANK OF CENTRAL & EASTERN NORTH CAROLINA**  
 1924 CAPITAL BLVD.  
 RALEIGH, NC 27604

**PARAMOUNTE ENGINEERING, INC.**  
 122 Cinema Drive  
 Wilmington, North Carolina 28403  
 (910) 791-6707 (O) (910) 791-6760 (F)  
 NC License #: C-2546

**INLET DA MAP**  
**THE WILMINGTON FOOD BANK**  
 GREENFIELD STREET  
 WILMINGTON, NORTH CAROLINA


**PROJECT STATUS**  
 ORIGINAL LAYOUT: \_\_\_\_\_  
 FINAL DESIGN: \_\_\_\_\_  
 RELEASED FOR CONSTRUCTION: \_\_\_\_\_

**DRAWING INFORMATION**  
 DATE: 1/29/22  
 SCALE: 1" = 30'  
 DRAWN BY: GIB  
 CHECKED: GIB

**SEAL**  
 Professional Seal redacted on electronic copy per City of Wilmington Policy

**DA-3**  
 PEI JOB#: 20484.PE

**FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION**

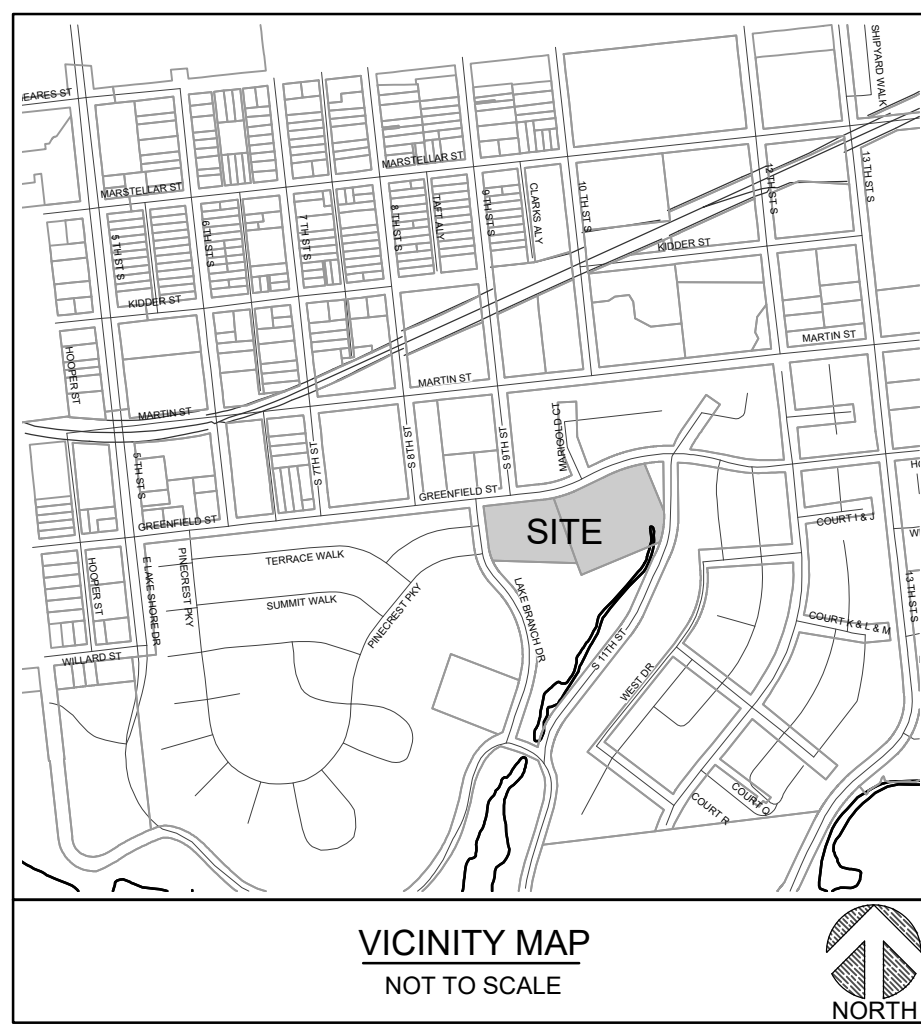

**SITE DATA:**

PROJECT ADDRESS: 1000 GREENFIELD STREET  
 PARCEL ID: R05418-004-004-000  
 R05418-004-001-000

CURRENT ZONING: UMX

PROPOSED USE: FOOD PANTRY & DISTRIBUTION

PROJECT SITE AREA: ± 5.141 ACRES (± 223,942SF)

OWNER INFORMATION: FOOD BANK OF CENTRAL & EASTERN NC  
 1924 CAPITAL BLVD  
 RALEIGH, NC 27604

FLOOD INFORMATION: THIS PARCEL IS NOT LOCATED IN A FEMA FLOOD ZONE

CAMA LAND USE CLASSIFICATION: URBAN

PROPOSED BUILDING SIZE: ± 32,000 SF

PROPOSED LOT COVERAGE: 14.3% (± 32,000 SF / ± 223,942 SF)

BUILDING CONSTRUCTION TYPE: TYPE 5B-SPRINKLED

PROPOSED DISTURBED AREA: ±140,000 SF

**STREETYARD CALCULATIONS:**  
 \*EMX EXEMPT

REQUIRED	PROVIDED
117.44 LF * 12 1 CANOPY / 600 SF (2.35 MULTIPLIER)	1,409 SF 3

**BUFFER YARD CALCULATIONS:**  
 \*EMX EXEMPT

REQUIRED	PROVIDED
GREENFIELD STREET 705 LF - 54 LF DRIVEWAYS = 651 LF TOTAL 651 LF / 30' = 22 TREES	22 TREES
LAKE BRANCH DRIVE 250 LF / 30' = 8.3 TREES	8 TREES

**SCREENING REQUIREMENTS**

1. SCREENING SHALL BE A MINIMUM OF SIX (6) FEET IN HEIGHT ALONG THE FRONT OR CORNER SIDE OF ANY LOT AND EIGHT (8) FEET IN HEIGHT ALONG ANY SIDE OR REAR PROPERTY LINE. CHAIN LINK FENCING SHALL NOT BE PERMITTED AS A SCREENING ALTERNATIVE.

**TREE REMOVAL NOTES:**

1. NO REGULATED TREES ARE TO BE REMOVED





- LANDSCAPE NOTES:**
- CONTRACTOR IS RESPONSIBLE FOR IDENTIFYING ALL UTILITIES PRIOR TO BEGINNING CONSTRUCTION AND COORDINATING ANY UTILITY RELOCATION WITH THE GENERAL CONTRACTOR PRIOR TO BEGINNING WORK.
  - TREES SHALL BE LOCATED NO CLOSER THAN 5 FEET FROM SEWER/WATER CONNECTIONS AND 8 FEET FROM FIRE HYDRANTS OR AS OTHERWISE DICTATED BY LOCAL REGULATIONS. CONTRACTOR SHALL BE LIABLE FOR DAMAGE TO ANY AND ALL PUBLIC OR PRIVATE UTILITIES.
  - AVOID PLACING TREES IN SIGHT DISTANCE TRIANGLE (SDT) UNLESS NECESSARY. ANY TREE IN SDT MUST FOLLOW CITY SIGHT LINE REQUIREMENTS. LIMB UP TO 7' MIN.
  - ALL PLANT MATERIAL SHALL MEET THE CURRENT VERSION OF THE AMERICAN ASSOCIATION OF NURSERYMEN'S STANDARDS.
  - NO TREE, OTHER THAN THOSE SHOWN ON APPROVED PLANS FOR REMOVAL WITH THESE PLANS AND/OR TREE REMOVAL PERMIT PLANS, SHALL BE REMOVED WITHOUT WRITTEN AUTHORIZATION FROM THE LANDSCAPE ARCHITECT OR OWNER'S REPRESENTATIVE.
  - ANY AND ALL SUBSTITUTIONS OF PLANT MATERIAL SHALL BE APPROVED BY LANDSCAPE ARCHITECT OR OWNER'S REPRESENTATIVE. FAILURE IN OBTAINING APPROVAL MAY RESULT IN LIABILITY TO THE CONTRACTOR.
  - ALL SHRUB BEDS AND/OR PLANTING AREAS EXCLUDING TURF AREAS SHALL BE MULCHED WITH 3 INCH MINIMUM

- AND 4 INCH MAXIMUM DEPTH PINE STRAW MULCH UNLESS OTHERWISE NOTED.
- ALL PLANTS, 4 FEET OR LESS APART, WILL BE CONNECTED IN ONE PLANTING BED. ALL GROUPS OF PLANTS SHOULD BE WITHIN ONE PLANTING BED WITH THE EDGE OF MULCH EXTENDING 2 FEET BEYOND THE EDGE OF PLANT MASS. ALL SINGLE TREES (INCLUDING BOTH PROPOSED AND EXISTING TREES) SHOULD HAVE A CIRCLE OF MULCH NOT LESS THAN 5 FEET DIAMETER.
- PLANTING SOIL MIX: MIX EXISTING SOIL WITH THE SOIL AMENDMENTS AND FERTILIZERS IN THE QUANTITIES RECOMMENDED BY THE SOIL TESTING LABORATORY. THIRD PARTY RECOGNIZED BY THE STATE DEPARTMENT OF AGRICULTURE OR AS OTHERWISE APPROVED BY THE LANDSCAPE ARCHITECT OR OWNER'S REPRESENTATIVE.
- THE CONTRACTOR SHALL PREPARE ALL SEEDED OR SODDED AREAS TO ASSURE THAT THE SUBGRADE HAS BEEN RAKED AND ROLLED TO ACCEPT THE SOD/SEED. ALL SOD/SEED AREAS MUST BE IRRIGATED OR HAND WATERED. ALL SOD SHALL BE PLACED WITH STAGGERED JOINTS AND NO GAPS BETWEEN SOD JOINTS. SOD SHOULD BE ROLLED AFTER INSTALLATION. ALL SEEDED AND/OR SODDED AREAS SHOULD PROVIDE A SMOOTH SURFACE FREE OF DIPS AND UNLEVELED GROUND. IRRIGATION OF SOD/SEED/TURF AREAS ARE NOT INCLUDED IN THE CISTERN IRRIGATED AREAS.
- CISTERN SYSTEM DESIGNED & INSTALLED BY OTHERS.

- IRRIGATION SHALL BE DESIGNED AND INSTALLED BY A LICENSED IRRIGATION CONTRACTOR IN THE STATE OF NORTH CAROLINA. CONTRACTOR RESPONSIBLE FOR IRRIGATING ALL LANDSCAPE / TURF AREAS EXCEPT COMMUNITY GARDEN.
- IRRIGATION PLANS AND SPECIFICATIONS FOR THE IRRIGATION DESIGN SHALL BE SUBMITTED TO THE OWNER OR OWNER'S REPRESENTATIVE FOR APPROVAL PRIOR TO PURCHASE OR INSTALLATION OF THE MATERIALS. UNLESS OTHERWISE NOTED, ALL DISTURBED AREAS SHALL BE SEEDED PERMANENTLY WITH BERMUDA TIFWAY 419 SEED. CONTRACTOR SHALL APPLY LIME AND OTHER SOIL AMENDMENTS IN ADVANCE.
- THE CONTRACTOR SHALL REPLACE DEAD AND/OR UNHEALTHY PLANT MATERIAL WITHIN 12 MONTHS OF ACCEPTANCE OF THE INSTALLED MATERIAL FROM THE OWNER OR OWNER'S REPRESENTATIVE.
- CONTRACTOR IS RESPONSIBLE FOR REMOVING TRASH, DEBRIS AND EXCESS MATERIALS FROM THE JOB SITE ONCE THE PROJECT IS COMPLETE. SECURING ANY MATERIALS LEFT ON SITE DURING THE COURSE OF THE PROJECT IS THE CONTRACTOR'S RESPONSIBILITY.
- ALL VEGETATION PROPOSED WITHIN SIGHT DISTANCE AREAS SHALL NOT INTERFERE WITH SIGHT DISTANCE FROM 30' TO 10'.

**PLANT SCHEDULE**

CANOPY TREES	CODE	QTY	BOTANICAL / COMMON NAME	SIZE
LO	30		QUERCUS VIRGINIANA SOUTHERN LIVE OAK	2' CAL MIN.
LBE	12		ULMUS PARVIFOLIA 'BOSSUE' BOSSUE LACEBARK ELM	2' CAL MIN.
SMALL EVERGREEN TREES	CODE	QTY	BOTANICAL / COMMON NAME	SIZE
WWM	20		MYRTICA CERIFERA WAX MYRTLE	2' CAL MIN.
SHRUBS	CODE	QTY	BOTANICAL / COMMON NAME	CONTAINER
BH	137		ILEX CORNUTA 'BURFORDII' BURFORD HOLLY	30" HT. AT INSTALL.
DYH	76		ILEX VOMITORIA 'NANA' DWARF YALPOUN	3 GAL.
PY	43		PODOCARPUS MACROPHYLLUS YEW PODOCARPUS	7 GAL.
ORNAMENTAL GRASSES	CODE	QTY	BOTANICAL / COMMON NAME	CONTAINER
PM	164		MUHLENBERGIA CAPILLARIS PINK MUHLEY	3 GAL.
TURF SEED	QTY	BOTANICAL / COMMON NAME	CONT.	
SEED	84,735 SF	CYNODON DACTYLON TIF 419 TIF 419 BERMUDA GRASS	SEED	
TURF SOD	QTY	BOTANICAL / COMMON NAME	CONT.	
SOD	28,254 SF	CYNODON DACTYLON BERMUDA GRASS	SOD	

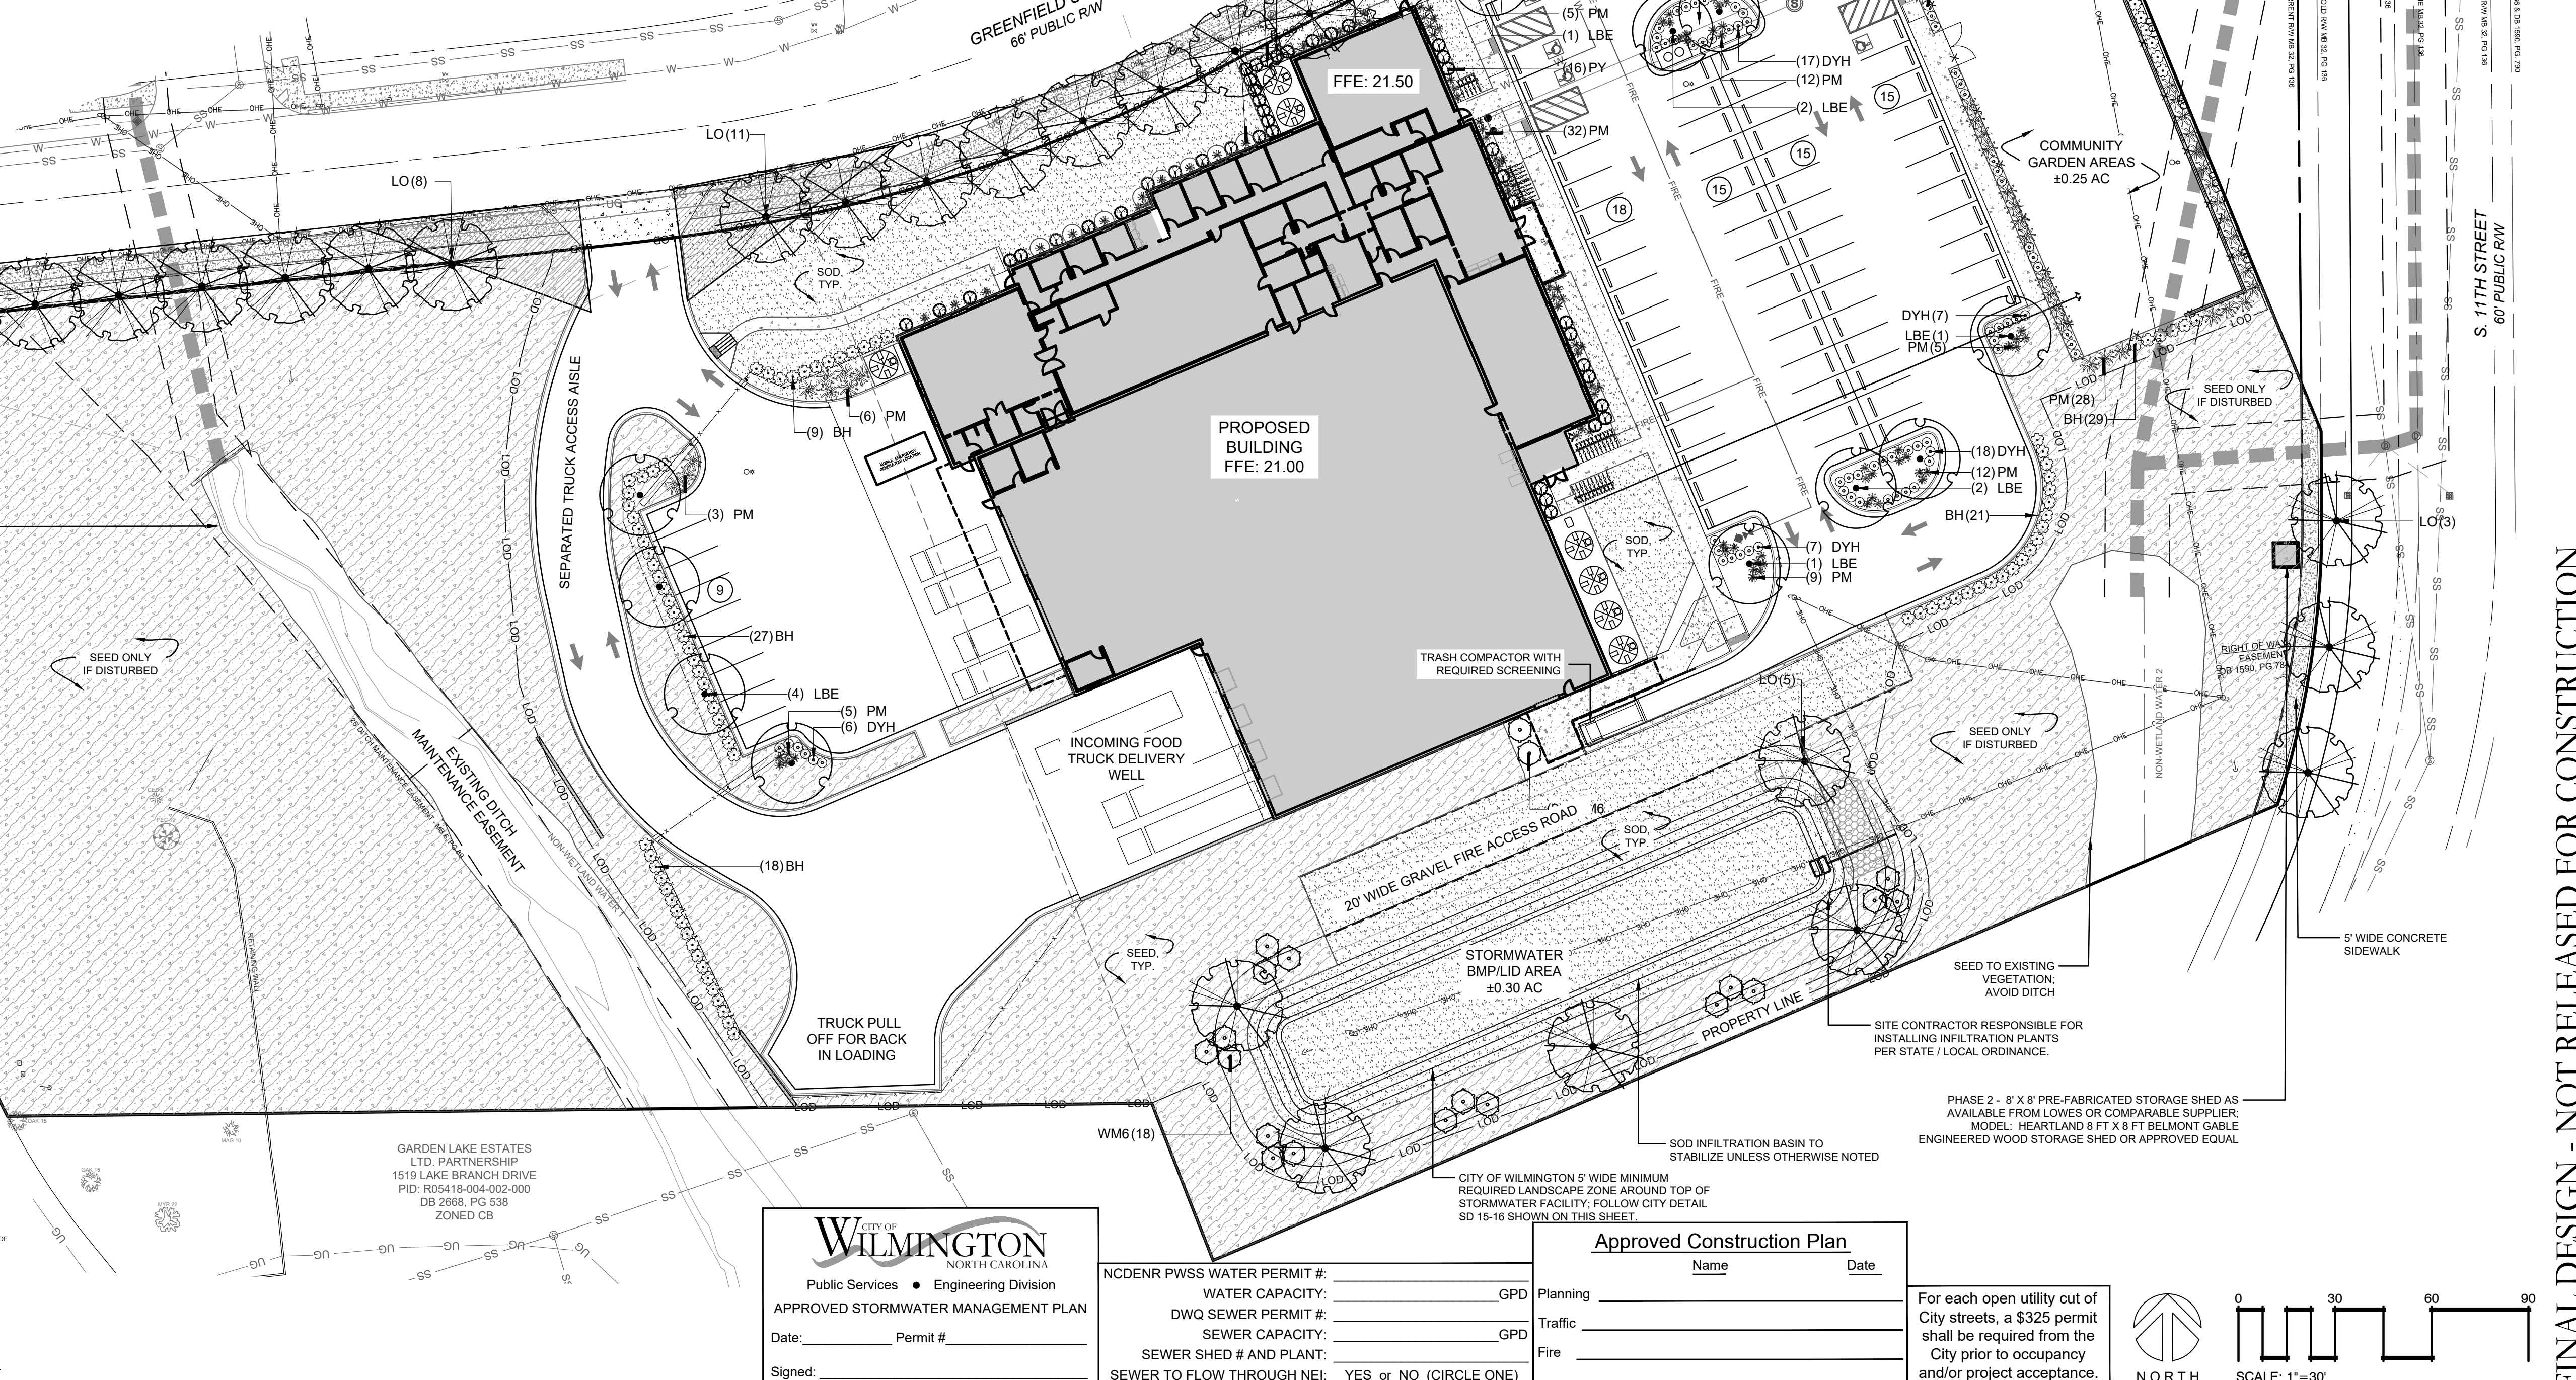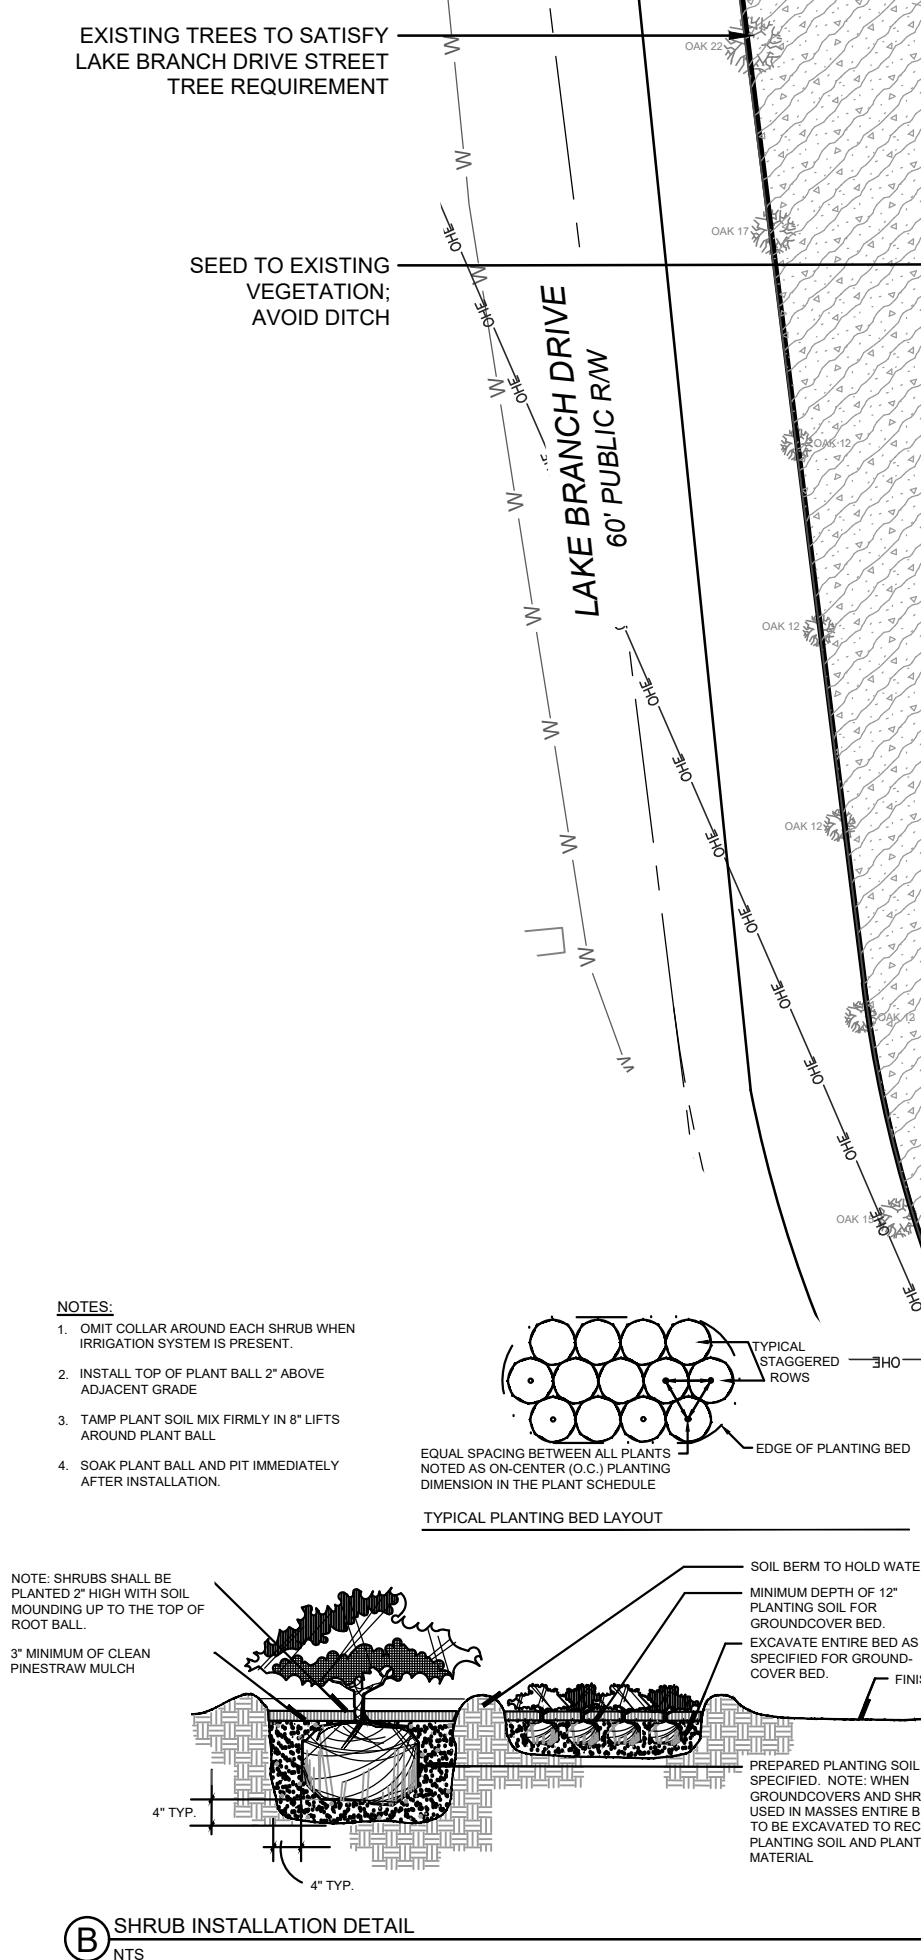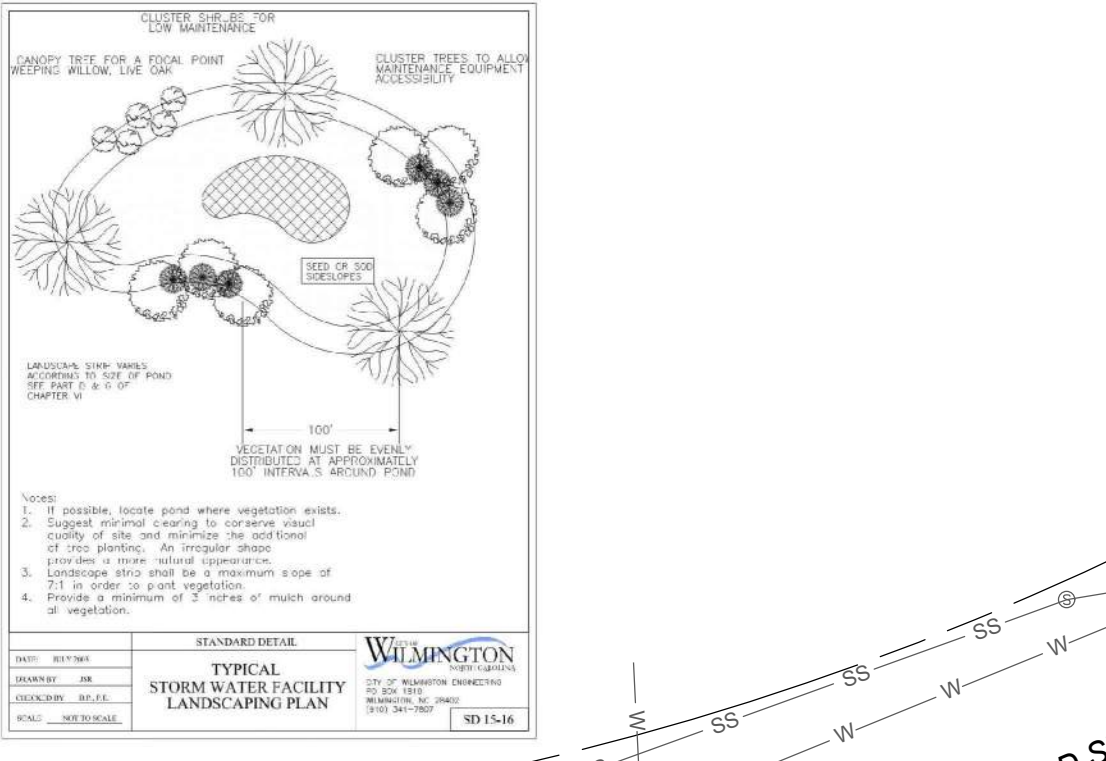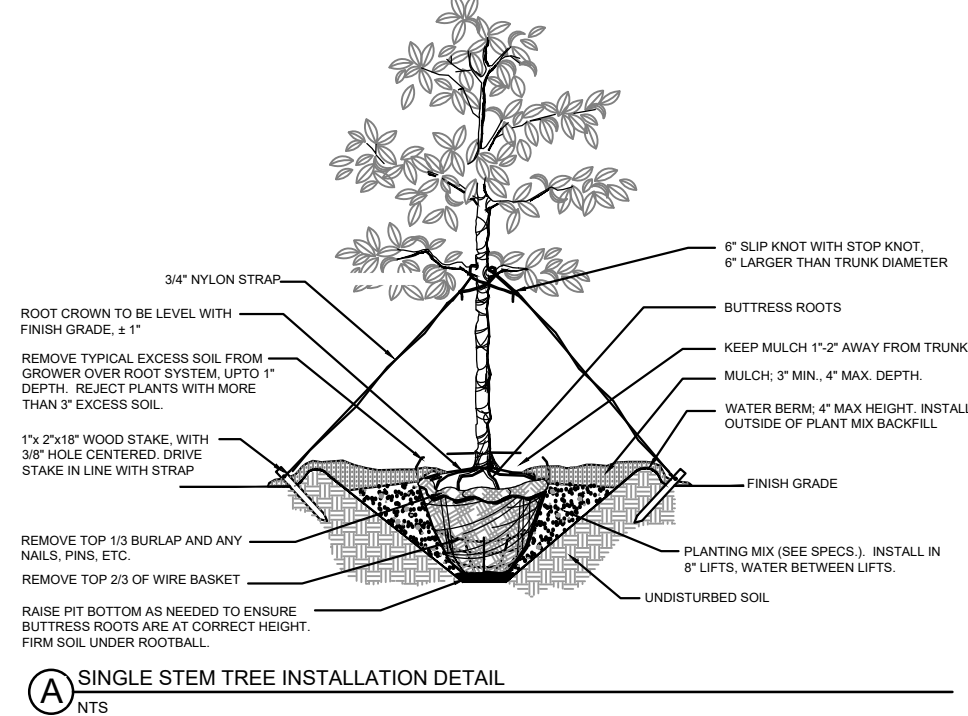


**CITY OF WILMINGTON**  
 NORTH CAROLINA  
 Public Services • Engineering Division  
 APPROVED STORMWATER MANAGEMENT PLAN  
 Date: \_\_\_\_\_ Permit # \_\_\_\_\_  
 Signed: \_\_\_\_\_

NC DENR PWSS WATER PERMIT #: \_\_\_\_\_  
 WATER CAPACITY: \_\_\_\_\_ GPD  
 DWQ SEWER PERMIT #: \_\_\_\_\_  
 SEWER CAPACITY: \_\_\_\_\_ GPD  
 SEWER SHED # AND PLANT: \_\_\_\_\_  
 SEWER TO FLOW THROUGH NEI: YES OR NO (CIRCLE ONE)

**Approved Construction Plan**

Name	Date
Planning _____	_____
Traffic _____	_____
Fire _____	_____

For each open utility cut of City streets, a \$325 permit shall be required from the City prior to occupancy and/or project acceptance.

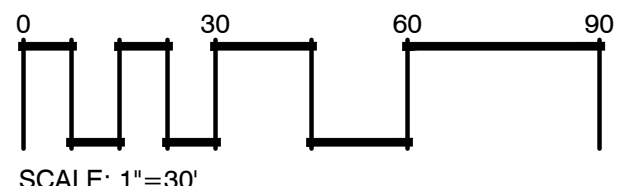

**REVISIONS:**

REV.	DESCRIPTION	DATE
1	ADDITIONAL NOTES ADDED	11/18/21
2	RFI RESPONSE	12/21/21
3	TRC COMMENT REVISIONS	2/02/22

**CLIENT INFORMATION:**

FOOD BANK OF CENTRAL & EASTERN NORTH CAROLINA  
 1924 CAPITAL BLVD.  
 RALEIGH, NC 27604

**PARAMOUNTE**  
 ENGINEERING, INC.  
 122 Cinema Drive  
 Wilmington, North Carolina 28403  
 (910) 791-6707 (O) (910) 791-6700 (F)  
 N.C. License #: C-2546

**LANDSCAPE PLAN**

THE WILMINGTON FOOD BANK  
 GREENFIELD STREET  
 WILMINGTON, NORTH CAROLINA

**PROJECT STATUS**

CONCEPTUAL LAYOUT: \_\_\_\_\_  
 PRELIMINARY LAYOUT: \_\_\_\_\_  
 FINAL DESIGN LAYOUT: \_\_\_\_\_  
 RELEASED FOR CONSTRUCTION: \_\_\_\_\_

**DRAWING INFORMATION**

DATE: 10.13.21  
 SCALE: 1" = 30'  
 DRAWING: ARC  
 CHECKED: \_\_\_\_\_

**Professional Seal**  
 redacted on electronic copy per City of Wilmington Policy

**L-2.0**

PEI JOB#: 20484.PE



FINAL DESIGN - NOT RELEASED FOR CONSTRUCTION

**RECEIVED**  
By Jeff Walton at 12:36 pm, Feb 03, 2022



**BOWMAN  
MURRAY  
HEMINGWAY**

ARCHITECTS  
514 Market Street  
Wilmington, NC 28401  
Tel - (910) 762-2621

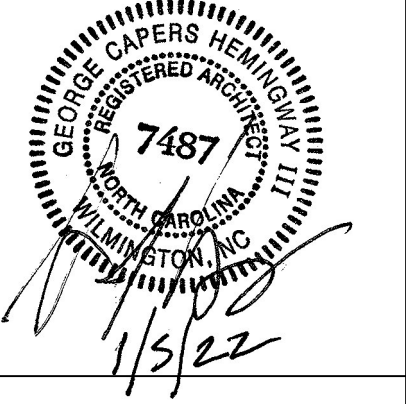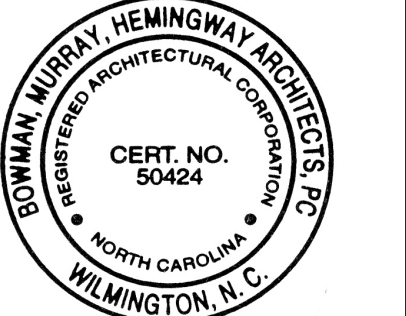

**The Wilmington Food Bank**  
Greenfield Street  
Wilmington, North Carolina 28403

A

B

C

D

E

1


2

3


4

5


6

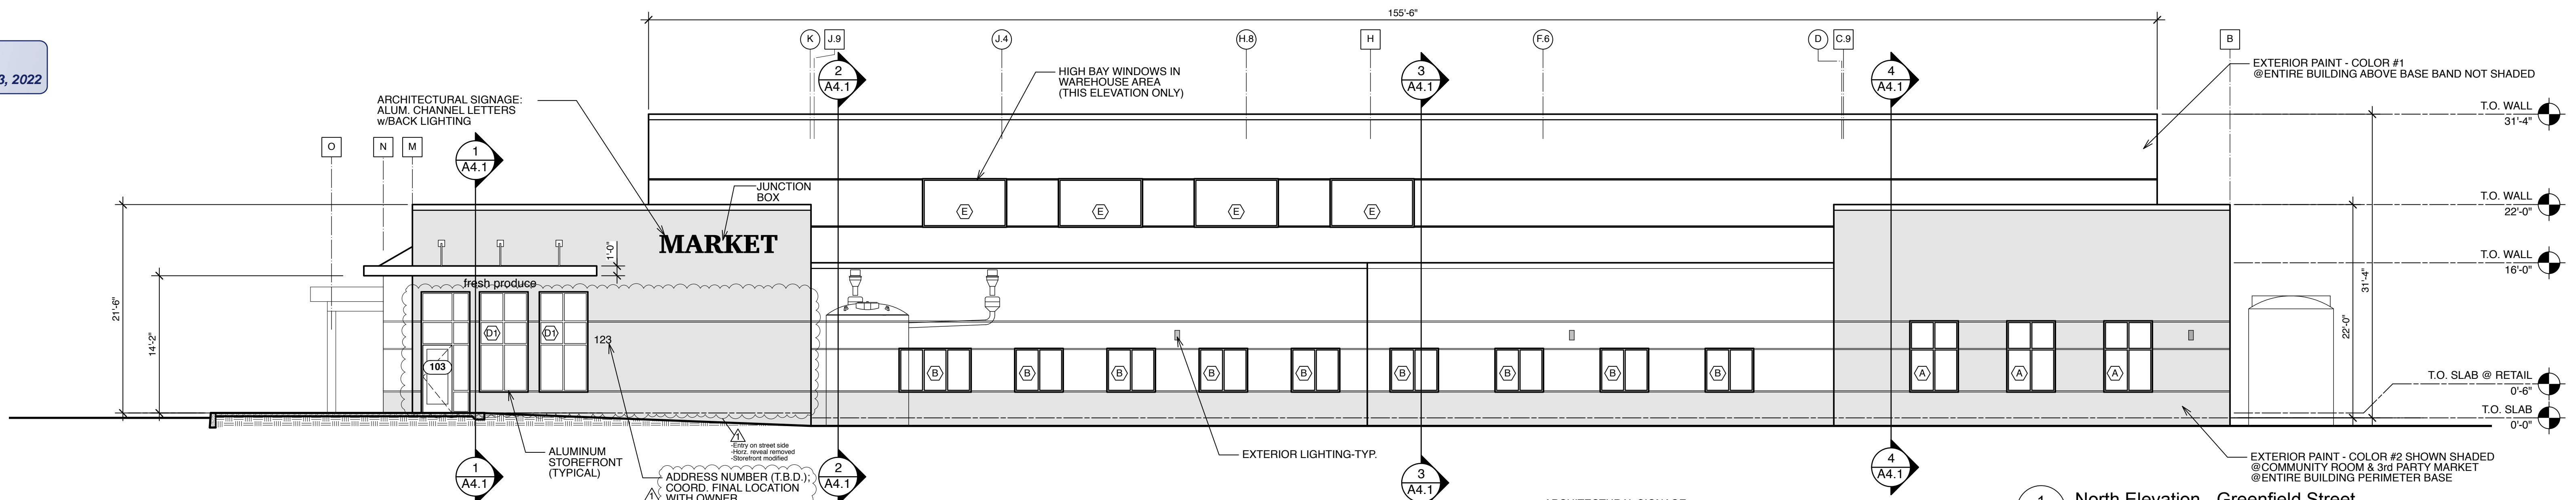


**1 North Elevation - Greenfield Street**  
Scale: 1/8" = 1'-0"

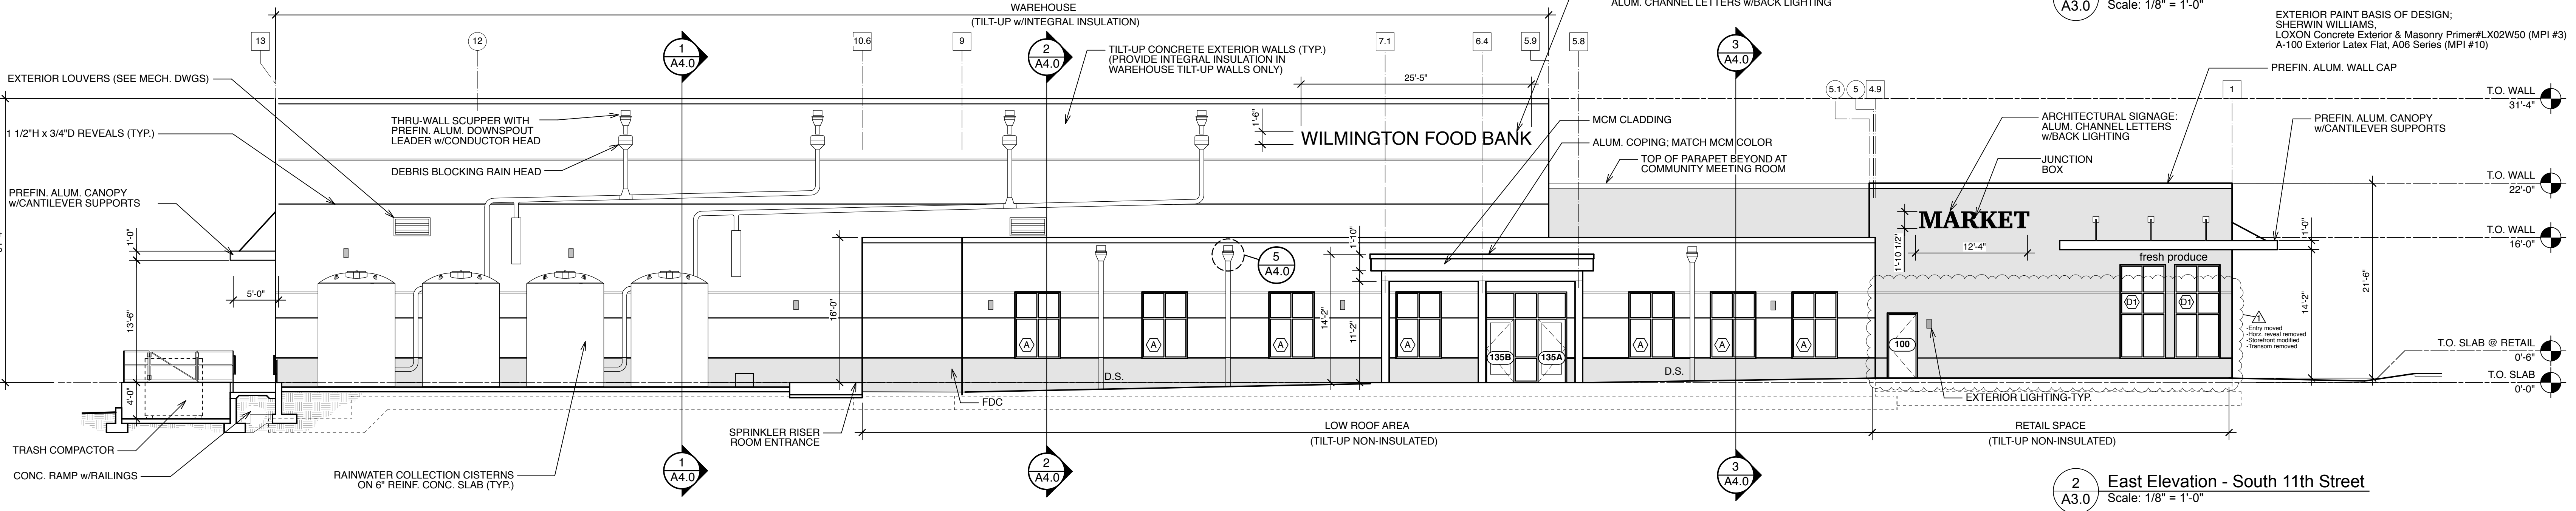

**2 East Elevation - South 11th Street**  
Scale: 1/8" = 1'-0"

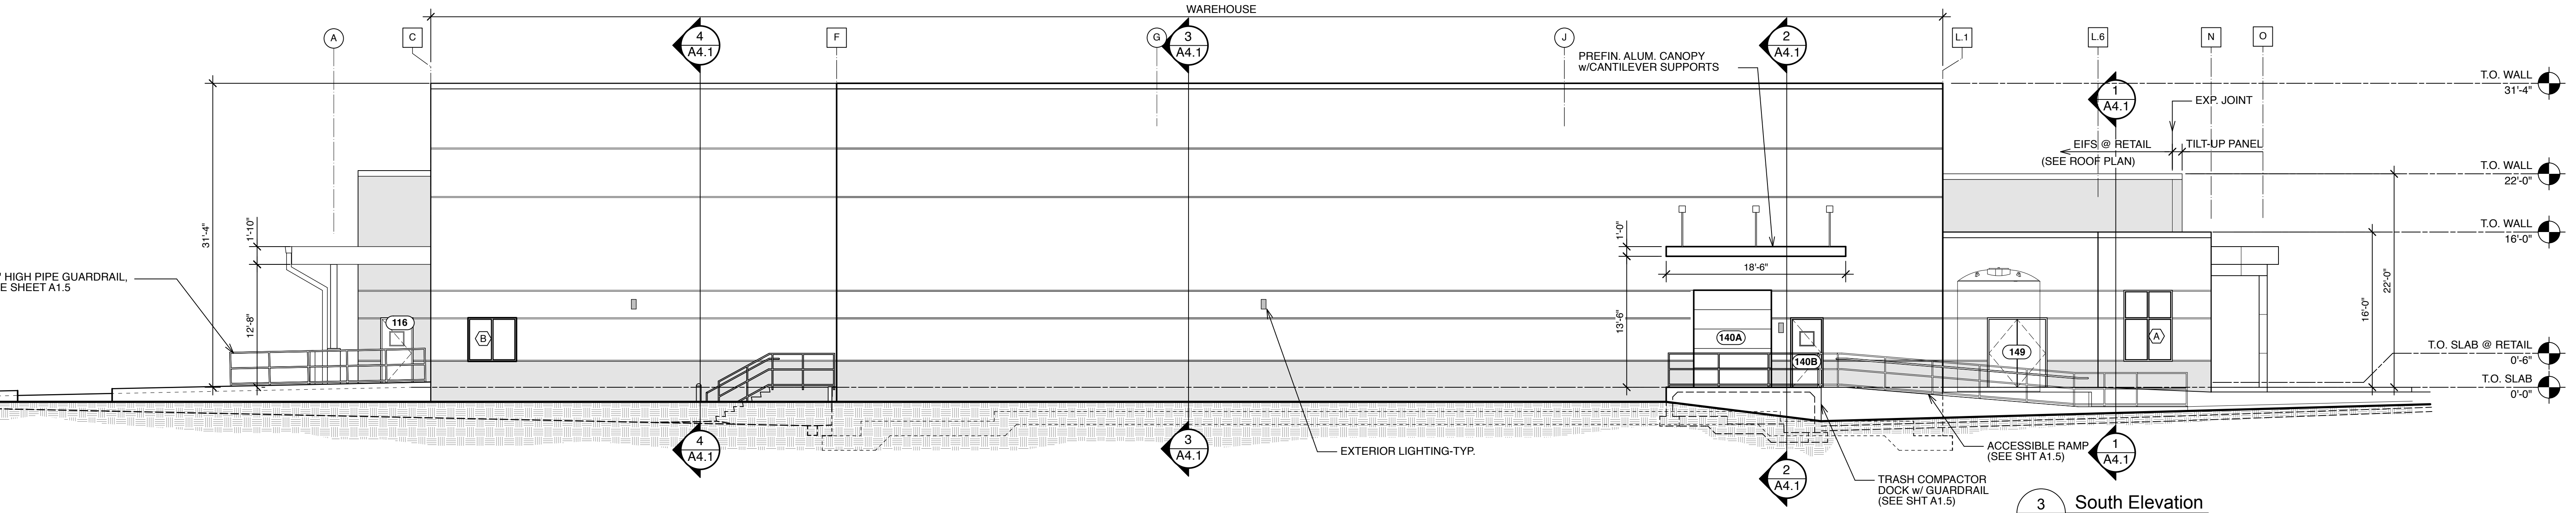

**3 South Elevation**  
Scale: 1/8" = 1'-0"

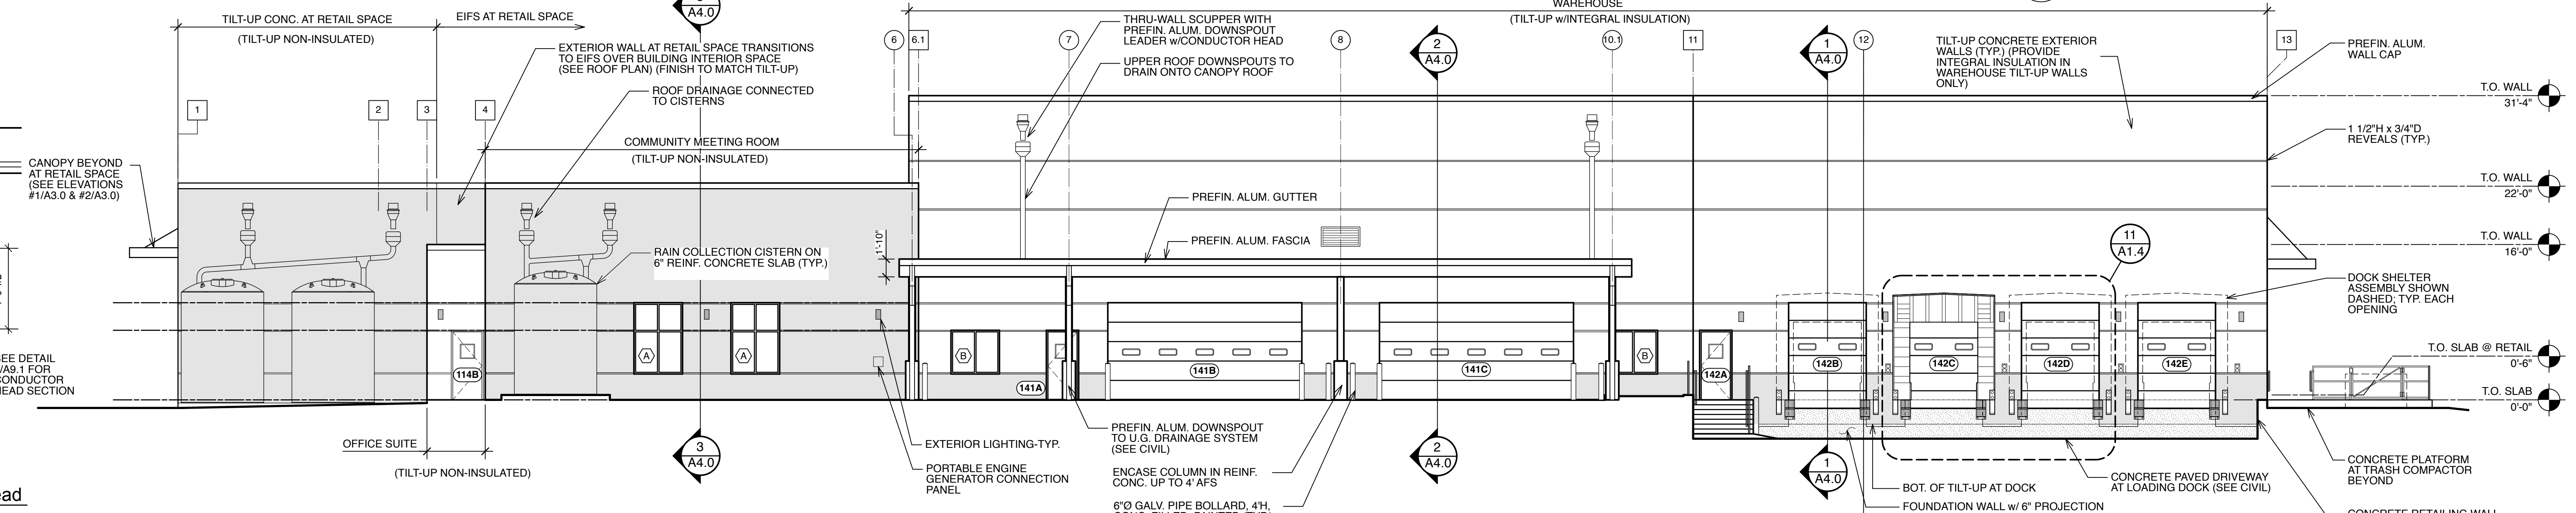

**4 West Elevation**  
Scale: 1/8" = 1'-0"

**5 Detail @ Conductor Head**  
Scale: 1" = 1'-0"

REV.	DATE	DESCRIPTION
1	1/26/22	Reloc retail entry, mod retail air filter
A	1/5/22	Issued For Permit
NO.	DATE	ISSUE NOTE
Project Manager		Drawn By: MG/DP/AT
Date	11.10.2021	Reviewed By: CH
Project ID		
Sheet Title	<b>Exterior Elevations</b>	
Sheet No.	<b>A3.0</b>	