



## **COMPREHENSIVE STORMWATER MANAGEMENT PERMIT**

### **HIGH DENSITY DEVELOPMENT**

#### **SECTION 1 – APPROVAL**

Having reviewed the application and all supporting materials, the City of Wilmington has determined that the application is complete and the proposed development meets the requirements of the City of Wilmington's Comprehensive Stormwater Ordinance.

PERMIT HOLDER: **Echo Farms, LLC C/O Matrix Development Group**  
PROJECT: **Woodlands at Echo Farms - Tract 2**  
ADDRESS: **4114 Echo Farms Boulevard**  
PERMIT #: **2020024**  
DATE: **August 7, 2020**

Therefore, the above referenced site is hereby approved and subject to all conditions set forth in Section 2 of this approval and all applicable provisions of the City of Wilmington Comprehensive Stormwater Management Ordinance.

This permit shall be effective from the date of issuance until August 7, 2040 and shall be subject to the following specified conditions and limitations:

#### **Section 2 - CONDITIONS**

1. This approval is valid only for the stormwater management system as proposed on the approved stormwater management plans dated July 21, 2020.
2. The project will be limited to the amount and type of built-upon area indicated in Section IV of the Stormwater Management Application Form submitted as part of the approved stormwater permit application package, and per the approved plans.
3. This permit shall become void unless the facilities are constructed in accordance with the approved stormwater management plans, specifications and supporting documentation, including information provided in the application and supplements.
4. The runoff from all built-upon area within any permitted drainage area must be directed into the permitted stormwater control system for that drainage area.
5. The permittee shall submit a revised stormwater management application packet to the City of Wilmington and shall have received approval prior to construction, for any modification to the approved plans, including, but not limited to, those listed below:
  - a. Any revision to any item shown on the approved plans, including the stormwater management measures, built-upon area, details, etc.
  - b. Redesign or addition to the approved amount of built-upon area or to the drainage area.
  - c. Further subdivision, acquisition, lease or sale of any part of the project area.
  - d. Filling in, altering, or piping of any vegetative conveyance shown on the approved plan.
  - e. Construction of any permitted future areas shown on the approved plans.



6. A copy of the approved plans and specifications shall be maintained on file by the Permittee.
7. During construction, erosion shall be kept to a minimum and any eroded areas of the system will be repaired immediately.
8. If the stormwater system was used as an Erosion Control device, it must be restored to design condition prior to operation as a stormwater treatment device, and prior to issuance of any certificate of occupancy for the project.
9. All areas must be maintained in a permanently stabilized condition. If vegetated, permanent seeding requirements must follow the guidelines established in the North Carolina Erosion and Sediment Control Planning and Design Manual unless an alternative is specified and approved by the City of Wilmington.
10. All stormwater treatment systems as well as access to nearest right-of-way must be located in recorded easements.
11. All applicable operation & maintenance agreements and easements pertaining to each stormwater treatment system shall be referenced on the final plat and recorded with the Register of Deeds upon final plat approval. If no plat is recorded for the site the operation and maintenance agreements and easements shall be recorded with the Register of Deeds so as to appear in the chain of title of all subsequent purchasers under generally accepted searching standards.
12. The stormwater management system shall be constructed in its entirety, vegetated and operational for its intended use prior to the construction of any built-upon surface unless prior approval is obtained. City Staff must be notified of any deviation prior to construction of the built-upon surface. Any deviation request shall include justification and must propose an alternative timeline or construction sequence. Notification shall not constitute approval. Any alternative timeline approved by City staff shall become an enforceable component of this permit.
13. The permittee shall at all times provide the operation and maintenance necessary to assure the permitted stormwater system functions at optimum efficiency. The approved Operation and Maintenance Agreement must be followed in its entirety and maintenance must occur at the scheduled intervals including, but not limited to:
  - a. Scheduled inspections (interval noted on the agreement).
  - b. Sediment removal.
  - c. Mowing and revegetation of slopes and the vegetated areas.
  - d. Maintenance of landscape plants, including those within the landscape buffer and on the vegetated shelf.
  - e. Immediate repair of eroded areas, especially slopes.
  - f. Debris removal and unclogging of outlet structure, orifice device, flow spreader, catch basins and/or piping.
  - g. Access to the outlet structure must be available at all times.
14. Records of inspection, maintenance and repair for the permitted stormwater system must be kept by the permittee for at least 5 years from the date of record and made available upon request to authorized personnel of the City of Wilmington. The records will indicate the date, activity, name of person performing the work and what actions were taken.



**Public Services**

Engineering  
212 Operations Center Drive  
Wilmington, NC 28412  
910 341-7807  
910 341-5881 fax  
wilmingtonnc.gov  
Dial 711 TTY/Voice

15. Upon completion of construction, before a Certificate of Occupancy shall be granted, and prior to operation or intended use of this permitted facility, the applicant shall submit to the City of Wilmington as-built plans for all stormwater management facilities. The plans shall show the final design specifications and the field location, type, depth, invert and planted vegetation of all measures, controls and devices, as installed. A certification shall be submitted, along with all supporting documentation that specifies, under seal that the as-built stormwater measures, controls and devices are in compliance with the approved stormwater management plans. A final inspection by City of Wilmington personnel will be required prior to issuance of a certificate of occupancy or operation of the permitted facility.
16. This permit is not transferable except after application and approval by the City of Wilmington. In the event of a change of ownership, name change or change of address the permittee must submit a completed Name/Ownership Change form to the City of Wilmington at least 30 days prior to the change. It shall be signed by all applicable parties and be accompanied by all required supporting documentation. Submittal of a complete application shall not be construed as an approved application. The application will be reviewed on its own merits by the City of Wilmington and may or may not be approved. The project must be in compliance with the terms of this permit in order for the transfer request to be considered. The permittee is responsible for compliance with all permit conditions until such time as the City of Wilmington approves the transfer request. Neither the sale of the project nor the conveyance of common area to a third party should be considered as an approved transfer of the permit.
17. Failure to abide by the conditions and limitations contained in this permit may subject the Permittee to enforcement action by the City of Wilmington, in accordance with Sections 18-52 and 18-53 and any other applicable section of the Land Development Code.
18. The City of Wilmington may notify the permittee when the permitted site does not meet one or more of the minimum requirements of the permit. Within the time frame specified in the notice, the permittee shall submit a written time schedule to the City of Wilmington for modifying the site to meet minimum requirements. The permittee shall provide copies of revised plans and certification in writing to the City of Wilmington that the changes have been made.
19. The issuance of this permit does not preclude the Permittee from complying with any and all statutes, rules, regulations, or ordinances, which may be imposed by other government agencies (local, state, and federal) having jurisdiction.
20. In the event that the facilities fail to perform satisfactorily, including the creation of nuisance conditions, the Permittee shall take immediate corrective action, including those as may be required by the City of Wilmington, such as the construction of additional or replacement stormwater management systems.
21. The permittee grants City of Wilmington Staff permission to enter the property during normal business hours for the purpose of inspecting all components of the permitted stormwater management facility.



**Public Services**

Engineering  
212 Operations Center Drive  
Wilmington, NC 28412  
910 341-7807  
910 341-5881 fax  
wilmingtonnc.gov  
Dial 711 TTY/Voice

22. The permit issued shall continue in force and effect until revoked or terminated by the City of Wilmington. The permit may be modified, revoked and reissued or terminated for cause. The filing of a request for a permit modification, revocation and re-issuance or termination does not stay any permit condition.
23. The approved stormwater management plans and all documentation submitted as part of the approved stormwater management permit application package for this project are incorporated by reference and are enforceable parts of the permit.
24. The permittee shall submit a renewal request with all required forms and documentation at least 180 days prior to the expiration date of this permit.
25. If any one or more of the conditions of this permit is found to be unenforceable or otherwise invalidated, all remaining conditions shall remain in full effect.

Stormwater Management Permit issued this the 7th day of August, 2020.

*Richard Christensen*  
\_\_\_\_\_  
for Sterling Cheatham, City Manager  
City of Wilmington



**Public Services**  
 Engineering  
 414 Chestnut St, Suite 200  
 Wilmington, NC 28401  
 910 341-7807  
 910 341-5881 fax  
 wilmingtonnc.gov  
 Dial 711 TTY/Voice

**STORMWATER MANAGEMENT PERMIT APPLICATION FORM**  
 (Form SWP 2.2)

**I. GENERAL INFORMATION**

1. Project Name (subdivision, facility, or establishment name - should be consistent with project name on plans, specifications, letters, operation and maintenance agreements, etc.):

The Woodlands at Echo Farms - Tract 2

2. Location of Project (street address):

4114 Echo Farms Boulevard

City: Wilmington County: New Hanover Zip: 28412

3. Directions to project (from nearest major intersection):

Located 0.80 miles south of the intersection of Hwy. 421 (Carolina Beach Road) and Independence Boulevard (S.R. 1209). Project site is on the SE side of Independence Boulevard.

**II. PERMIT INFORMATION**

1. Specify the type of project (check one):  Low Density  High Density  
 Drains to an Offsite Stormwater System  Drainage Plan  Other  
 If the project drains to an Offsite System, list the Stormwater Permit Number(s):

City of Wilmington: \_\_\_\_\_ State – NCDENR/DWQ: \_\_\_\_\_

2. Is the project currently covered (whole or in part) by an existing City or State (NCDENR/DWQ) Stormwater Permit?  Yes  No

If yes, list all applicable Stormwater Permit Numbers:

City of Wilmington: \_\_\_\_\_ State – NCDENR/DWQ: \_\_\_\_\_

3. Additional Project Permit Requirements (check all applicable):

CAMA Major  Sedimentation/Erosion Control  
 NPDES Industrial Stormwater  404/401 Permit: Proposed Impacts: \_\_\_\_\_

If any of these permits have already been acquired please provide the Project Name, Project/Permit Number, issue date and the type of each permit:

\_\_\_\_\_

**III. CONTACT INFORMATION**

1. Print Applicant / Signing Official's name and title (specifically the developer, property owner, lessee, designated government official, individual, etc. who owns the project):

Applicant / Organization: Echo Farms, LLC C/O Matrix Development Group

Signing Official & Title:  Joseph S. Taylor - Manager

- a. Contact information for Applicant / Signing Official:

Street Address: CN 400 Forsgate Drive

City: Cranbury State: NJ Zip: 08512

Phone: 732-521-2900 Fax: 609-395-8289 Email: jtaylor@matrixcompanies.com

Mailing Address (if different than physical address): \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

- b. Please check the appropriate box. The applicant listed above is:

- The property owner (Skip to item 3)  
 Lessee\* (Attach a copy of the lease agreement and complete items 2 and 2a below)  
 Purchaser\* (Attach a copy of the pending sales agreement and complete items 2 and 2a below)  
 Developer\* (Complete items 2 and 2a below.)

2. Print Property Owner's name and title below, if you are the lessee, purchaser, or developer. (This is the person who owns the property that the project is on.)

Property Owner / Organization: \_\_\_\_\_

Signing Official & Title: \_\_\_\_\_

- a. Contact information for Property Owner:

Street Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

Phone: \_\_\_\_\_ Fax: \_\_\_\_\_ Email: \_\_\_\_\_

Mailing Address (if different than physical address): \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

3. (Optional) Print the name and title of another contact such as the project's construction supervisor or another person who can answer questions about the project:

Other Contact Person / Organization: \_\_\_\_\_

Signing Official & Title: \_\_\_\_\_

a. Contact information for person listed in item 3 above:

Street Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

Phone: \_\_\_\_\_ Fax: \_\_\_\_\_ Email: \_\_\_\_\_

Mailing Address (if different than physical address): \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

#### IV. PROJECT INFORMATION

1. In the space provided below, briefly summarize how the stormwater runoff will be treated.

Stormwater runoff will be treated utilizing a piped network that conveys the storm  
water runoff to one of three separate wet detention ponds with forebays.

2. Total Property Area: 1,165,205 square feet

3. Total Coastal Wetlands Area: 0 square feet

4. Total Surface Water Area: 0 square feet

5. Total Property Area (2) – Total Coastal Wetlands Area (3) – Total Surface Water Area (4) = Total Project Area: 1,165,205 square feet.

6. Existing Impervious Surface within Property Area: 29,076 square feet

7. Existing Impervious Surface to be Removed/Demolished: 29,076 square feet

8. Existing Impervious Surface to Remain: 0 square feet

9. Total Onsite (within property boundary) Newly Constructed Impervious Surface (*in square feet*):

Buildings/Lots	270,000
Impervious Pavement	64,262
Pervious Pavement (adj. total, with % credit applied)	0
Impervious Sidewalks	21,013
Pervious Sidewalks (adj. total, with % credit applied)	0
Other (describe)	0
Future Development	3,025
<b>Total Onsite Newly Constructed Impervious Surface</b>	<b>358,300</b>

10. Total Onsite Impervious Surface

(Existing Impervious Surface to remain + Onsite Newly Constructed Impervious Surface) = 358,300 square feet

11. Project percent of impervious area: (Total Onsite Impervious Surface / Total Project Area) x100 = 31 %

12. Total Offsite Newly Constructed Impervious Area (improvements made outside of property boundary, in square feet):

Impervious Pavement	3,016
Pervious Pavement (adj. total, with % credit applied)	0
Impervious Sidewalks	4,732
Pervious Sidewalks (adj. total, with % credit applied)	0
Other (describe)	0
<b>Total Offsite Newly Constructed Impervious Surface</b>	<b>7,748</b>

13. Total Newly Constructed Impervious Surface

(Total Onsite + Offsite Newly Constructed Impervious Surface) = 366048 square feet

14. Complete the following information for each Stormwater BMP drainage area. If there are more than three drainage areas in the project, attach an additional sheet with the information for each area provided in the same format as below. Low Density projects may omit this section and skip to Section V.

Basin Information	Wet Pond BMP # 1	Wet Pond BMP # 2	Wet Pond BMP # 3
Receiving Stream Name	Barnards Creek	Barnards Creek	Barnards Creek
Receiving Stream Index Number	18-80	18-80	18-80
Stream Classification	C;Sw	C;Sw	C;Sw
Total Drainage Area (sf)	414128	274962	154638
On-Site Drainage Area (sf)	412078	273992	154638
Off-Site Drainage Area (sf)	2050	970	0
<b>Total Impervious Area (sf)</b>	<b>187616</b>	<b>122938</b>	<b>66200</b>
Buildings/Lots (sf)	130000	90000	50000
Impervious Pavement (sf)	34325	18130	11807
Pervious Pavement, % credit (sf)	0	0	0
Impervious Sidewalks (sf)	10088	6532	4393
Pervious Sidewalks, % credit (sf)	0	0	0
Other (sf)			
Future Development (sf)	11153	7306	0
Existing Impervious to remain (sf)			
Offsite (sf)	2050	970	0
Percent Impervious Area (%)	45.3%	44.7%	42.8%

15. How was the off-site impervious area listed above determined? Provide documentation:

Off-site impervious is the proposed sidewalk and driveway within existing Independence Blvd. and Echo Farms Blvd. Right-of-Way.



## V. SUBMITTAL REQUIREMENTS

1. Supplemental and Operation & Maintenance Forms - One applicable City of Wilmington Stormwater BMP supplement form and checklist must be submitted for **each** BMP specified for this project. One applicable proposed operation and maintenance (O&M) form must be submitted for **each type** of stormwater BMP. Once approved, the operation and maintenance forms must be referenced on the final plat and recorded with the register of deeds office.
2. Deed Restrictions and Restrictive Covenants - For all subdivisions, outparcels, and future development, the appropriate property restrictions and protective covenants are required to be recorded prior to the sale of any lot. Due to variability in lot sizes or the proposed BUA allocations, a table listing each lot number, lot size, and the allowable built-upon area must be provided as an attachment to the completed and notarized deed restriction form. The appropriate deed restrictions and protective covenants forms can be downloaded at the link listed in section V (3). Download the latest versions for each submittal.

In instances where the applicant is different than the property owner, it is the responsibility of the property owner to sign the deed restrictions and protective covenants form while the applicant is responsible for ensuring that the deed restrictions are recorded.

**By the notarized signature(s) below, the permit holder(s) certify that the recorded property restrictions and protective covenants for this project, if required, shall include all the items required in the permit and listed on the forms available on the website, that the covenants will be binding on all parties and persons claiming under them, that they will run with the land, that the required covenants cannot be changed or deleted without concurrence from the City of Wilmington, and that they will be recorded prior to the sale of any lot.**

3. Only complete application packages will be accepted and reviewed by the City. A complete package includes all of the items listed on the City Engineering Plan Review Checklist, including the fee. Copies of the Engineering Plan Review Checklist, all Forms, Deed Restrictions as well as detailed instructions on how to complete this application form may be downloaded from:

<http://www.wilmingtonnc.gov/PublicServices/Engineering/PlanReview/StormwaterPermits.aspx>

The complete application package should be submitted to the following address:

City of Wilmington – Engineering  
Plan Review Section  
414 Chestnut Street, Suite 200  
Wilmington, NC 28402

**VI. CONSULTANT INFORMATION AND AUTHORIZATION**

1. Applicant: Complete this section if you wish to designate authority to another individual and/or firm (such as a consulting engineer and /or firm) so that they may provide information on your behalf for this project (such as addressing requests for additional information).

Consulting Engineer: Rob Balland, PE

Consulting Firm: Paramounte Engineering, Inc.

a. Contact information for consultant listed above:

Mailing Address: 122 Cinema Drive

City: Wilmington State: NC Zip: 28403


Phone: 910-791-6707 Fax: 910-791-6760 Email: rballand@paramounte-eng.com

**VII. PROPERTY OWNER AUTHORIZATION** (If Section III(2) has been filled out, complete this section)

I, *(print or type name of person listed in Contact Information, item 2)* \_\_\_\_\_, certify that I own the property identified in this permit application, and thus give permission to *(print or type name of person listed in Contact Information, item 1)* \_\_\_\_\_ with *(print or type name of organization listed in Contact Information, item 1)* \_\_\_\_\_ to develop the project as currently proposed. A copy of the lease agreement or pending property sales contract has been provided with the submittal, which indicates the party responsible for the operation and maintenance of the stormwater system.

As the legal property owner I acknowledge, understand, and agree by my signature below, that if my designated agent *(entity listed in Contact Information, item 1)* dissolves their company and/or cancels or defaults on their lease agreement, or pending sale, responsibility for compliance with the City of Wilmington Stormwater Permit reverts back to me, the property owner. As the property owner, it is my responsibility to notify the City of Wilmington immediately and submit a completed Name/Ownership Change Form within 30 days; otherwise I will be operating a stormwater treatment facility without a valid permit. I understand that the operation of a stormwater treatment facility without a valid permit is a violation of the City of Wilmington Municipal Code of Ordinances and may result in appropriate enforcement including the assessment of civil penalties.

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

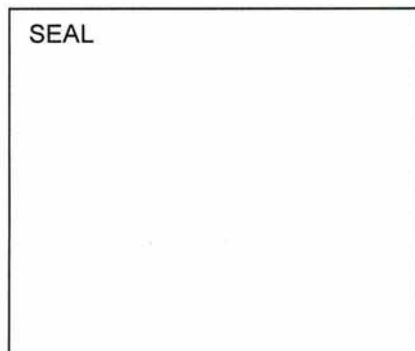


I, \_\_\_\_\_, a Notary Public for the State of \_\_\_\_\_, County of \_\_\_\_\_, do hereby certify that \_\_\_\_\_ personally appeared before me this day of \_\_\_\_\_, \_\_\_\_\_, and acknowledge the due execution of the application for a stormwater permit. Witness my hand and official seal,

\_\_\_\_\_  
My commission expires: \_\_\_\_\_


**VIII. APPLICANT'S CERTIFICATION**

I, (print or type name of person listed in Contact Information, item 1) Joseph S. Taylor certify that the information included on this permit application form is, to the best of my knowledge, correct and that the project will be constructed in conformance with the approved plans, that the required deed restrictions and protective covenants will be recorded, and that the proposed project complies with the requirements of the applicable stormwater rules under.

Signature:  Date: 12-28-17

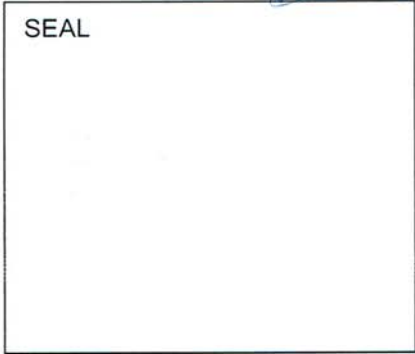

I, MAUREEN ANN PETRIGNANI, a Notary Public for the State of NEW JERSEY, County of \_\_\_\_\_, do hereby certify that JOSEPH S. TAYLOR personally appeared before me this day of DECEMBER 28, 2017, and acknowledge the due execution of the application for a stormwater permit. Witness my hand and official seal.

  
My commission expires: 6/8/18

MAUREEN ANN PETRIGNANI  
Notary Public of New Jersey  
ID # 2045907  
My Commission Expires June 8, 2018

**High Density Residential Subdivisions**  
**Deed Restrictions & Protective Covenances**

In accordance with Article 14, Division III of the City of Wilmington Land Development Code, deed restrictions and protective covenants are required for High Density Residential Subdivisions where lots will be subdivided and sold and runoff will be treated in an engineered stormwater control facility. Deed restrictions and protective covenants are necessary to ensure that the development maintains a "built-upon" area consistent with the design criteria used to size the stormwater control facility.

I, Joseph S. Taylor, acknowledge, affirm and agree by my signature below, that I will cause the following deed restrictions and covenants to be recorded prior to the sale of any lot:

1. *The following covenants are intended to ensure ongoing compliance with the city of Wilmington Stormwater Management Permit Number \_\_\_\_\_, as issued by the City of Wilmington/Engineering*
2. *The City of Wilmington is made a beneficiary of these covenants to the extent necessary to maintain compliance with the stormwater management permit.*
3. *These covenants are to run with the land and be binding on all persons and parties claiming under them.*
4. *The covenants pertaining to stormwater may not be altered or rescinded without the express written consent of the City of Wilmington.*
5. *Alteration of the drainage as shown on the approved plan may not take place without the concurrence of the City of Wilmington*
6. *The maximum allowable built-upon area per lot is 5,000 square feet. This allotted amount includes any built-upon area constructed within the lot property boundaries, and that portion of the right-of-way between the front lot line and the edge of the pavement. Built upon area includes, but is not limited to, structures, asphalt, concrete, gravel, brick, stone, slate, coquina and parking areas, but does not include raised, open wood decking, or the water surface of swimming pools.*

**OR, if the proposed built-upon areas per lot will vary, please REPLACE #6 above with the following:**

*The maximum built-upon area per lot, in square feet, is as listed below:*

Lot #	BUA	Lot #	BUA	Lot #	BUA	Lot #	BUA
-------	-----	-------	-----	-------	-----	-------	-----

*This allotted amount includes any built-upon area constructed within the lot property boundaries, and that portion of the right-of-way between the front lot line and the edge of the pavement. Built upon area includes, but is not limited to, structures, asphalt, concrete, gravel, brick, stone, slate, coquina and parking areas, but does not include raised, open wood decking, or the water surface of swimming pools.*

7. *All runoff from the built-upon areas on the lot must drain into the permitted system. This may be accomplished through a variety of means including roof drain gutters which drain to the street, grading the lot to drain toward the street, or grading perimeter swales to collect the lot runoff and directing them into a component of the stormwater collection system. Lots that will naturally drain into the system are not required to provide these additional measures.*

Signature: \_\_\_\_\_

Date: 2-15-18

I, JENNIFER A. TORRE, a Notary Public in the State of NEW JERSEY,  
County of MONMOUTH, do hereby certify that JOSEPH S. TAYLOR  
personally appeared before me this the 15TH day of FEBRUARY, 2018, and acknowledge the  
due execution of the foregoing instrument. Witness my hand and official seal,

SEAL

Jennifer A. Torre  
Signature  
My Commission expires



STORMWATER MANAGEMENT PERMIT APPLICATION FORM  
401 CERTIFICATION APPLICATION FORM  
**WET DETENTION BASIN SUPPLEMENT**

This form must be filled out, printed and submitted.  
The Required Items Checklist (Part III) must be printed, filled out and submitted along with all of the required information.

I. PROJECT INFORMATION	
Project name	Woodlands @ Echo Farms Tract 2
Contact person	Joseph S. Taylor
Phone number	732-521-2900
Date	2/19/2018
Drainage area number	1

II. DESIGN INFORMATION	
<b>Site Characteristics</b>	
Drainage area	414,128 ft <sup>2</sup>
Impervious area, post-development	187,616 ft <sup>2</sup>
% impervious	45.30 %
Design rainfall depth	1.5 in
<b>Storage Volume: Non-SA Waters</b>	
Minimum volume required	23,696 ft <sup>3</sup> OK
Volume provided	96,358 ft <sup>3</sup> OK, volume provided is equal to or in excess of volume required.
<b>Storage Volume: SA Waters</b>	
1.5" runoff volume	ft <sup>3</sup>
Pre-development 1-yr, 24-hr runoff	ft <sup>3</sup>
Post-development 1-yr, 24-hr runoff	ft <sup>3</sup>
Minimum volume required	ft <sup>3</sup>
Volume provided	ft <sup>3</sup>
<b>Peak Flow Calculations</b>	
Is the pre/post control of the 1yr 24hr storm peak flow required?	N (Y or N)
1-yr, 24-hr rainfall depth	in
Rational C, pre-development	(unitless)
Rational C, post-development	(unitless)
Rainfall intensity: 1-yr, 24-hr storm	in/hr
Pre-development 1-yr, 24-hr peak flow	ft <sup>3</sup> /sec
Post-development 1-yr, 24-hr peak flow	ft <sup>3</sup> /sec
Pre/Post 1-yr, 24-hr peak flow control	ft <sup>3</sup> /sec
<b>Elevations</b>	
Temporary pool elevation	7.60 fmsl
Permanent pool elevation	5.00 fmsl
SHWT elevation (approx. at the perm. pool elevation)	5.00 fmsl
Top of 10ft vegetated shelf elevation	5.00 fmsl
Bottom of 10ft vegetated shelf elevation	4.00 fmsl
Sediment cleanout, top elevation (bottom of pond)	-1.00 fmsl
Sediment cleanout, bottom elevation	-2.00 fmsl
Sediment storage provided	1.00 ft
Is there additional volume stored above the state-required temp. pool?	Y (Y or N)
Elevation of the top of the additional volume	7.6 fmsl OK

**II. DESIGN INFORMATION**
**Surface Areas**

Area, temporary pool	40,911	ft <sup>2</sup>	
Area REQUIRED, permanent pool	18,766	ft <sup>2</sup>	
SA/DA ratio	4.53	(unitless)	
Area PROVIDED, permanent pool, $A_{perm\_pool}$	33,266	ft <sup>2</sup>	OK
Area, bottom of 10ft vegetated shelf, $A_{bot\_shelf}$	25,117	ft <sup>2</sup>	
Area, sediment cleanout, top elevation (bottom of pond), $A_{bot\_pond}$	8,212	ft <sup>2</sup>	

**Volumes**

Volume, temporary pool	96,358	ft <sup>3</sup>	OK
Volume, permanent pool, $V_{perm\_pool}$	109,759	ft <sup>3</sup>	
Volume, forebay (sum of forebays if more than one forebay)	23,035	ft <sup>3</sup>	
Forebay % of permanent pool volume	21.0%	%	OK

**SA/DA Table Data**

Design TSS removal	90	%	
Coastal SA/DA Table Used?	Y	(Y or N)	
Mountain/Piedmont SA/DA Table Used?	N	(Y or N)	
SA/DA ratio	4.53	(unitless)	

Average depth (used in SA/DA table):

Calculation option 1 used? (See Figure 10-2b)	N	(Y or N)	
Volume, permanent pool, $V_{perm\_pool}$	109,759	ft <sup>3</sup>	
Area provided, permanent pool, $A_{perm\_pool}$	33,266	ft <sup>2</sup>	
Average depth calculated		ft	Need 3 ft min.
Average depth used in SA/DA, $d_{av}$ , (Round to nearest 0.5ft)		ft	
Calculation option 2 used? (See Figure 10-2b)	Y	(Y or N)	
Area provided, permanent pool, $A_{perm\_pool}$	33,266	ft <sup>2</sup>	
Area, bottom of 10ft vegetated shelf, $A_{bot\_shelf}$	25,117	ft <sup>2</sup>	
Area, sediment cleanout, top elevation (bottom of pond), $A_{bot\_pond}$	8,212	ft <sup>2</sup>	
"Depth" (distance b/w bottom of 10ft shelf and top of sediment)	5.00	ft	
Average depth calculated	3.60	ft	OK
Average depth used in SA/DA, $d_{av}$ , (Round to nearest 0.5ft)	3.5	ft	OK

**Drawdown Calculations**

Drawdown through orifice?	Y	(Y or N)	
Diameter of orifice (if circular)	3.00	in	
Area of orifice (if non-circular)		in <sup>2</sup>	
Coefficient of discharge ( $C_D$ )	0.60	(unitless)	
Driving head ( $H_0$ )	0.87	ft	
Drawdown through weir?	N	(Y or N)	
Weir type		(unitless)	
Coefficient of discharge ( $C_w$ )		(unitless)	
Length of weir (L)		ft	
Driving head (H)		ft	
Pre-development 1-yr, 24-hr peak flow		ft <sup>3</sup> /sec	
Post-development 1-yr, 24-hr peak flow		ft <sup>3</sup> /sec	
Storage volume discharge rate (through discharge orifice or weir)	0.22	ft <sup>3</sup> /sec	Storage volume discharge rate greater than pre-dev. 1yr24hr.
Storage volume drawdown time	5.07	days	Insufficient drawdown time. Must be within 2-5 days.

**Additional Information**

Vegetated side slopes	3	:1	OK
Vegetated shelf slope	6	:1	Insufficient shelf slope.
Vegetated shelf width	6.0	ft	Insufficient shelf length.
Length of flowpath to width ratio	4	:1	OK
Length to width ratio	4.0	:1	OK
Trash rack for overflow & orifice?	Y	(Y or N)	OK
Freeboard provided	1.0	ft	OK
Vegetated filter provided?	N	(Y or N)	OK
Recorded drainage easement provided?	Y	(Y or N)	OK
Capures all runoff at ultimate build-out?	Y	(Y or N)	OK
Drain mechanism for maintenance or emergencies is:	pump		

STORMWATER MANAGEMENT PERMIT APPLICATION FORM  
401 CERTIFICATION APPLICATION FORM  
**WET DETENTION BASIN SUPPLEMENT**

This form must be filled out, printed and submitted.  
The Required Items Checklist (Part III) must be printed, filled out and submitted along with all of the required information.

I. PROJECT INFORMATION	
Project name	Woodlands @ Echo Farms Tract 2
Contact person	Joseph S. Taylor
Phone number	732-521-2900
Date	2/19/2018
Drainage area number	2

II. DESIGN INFORMATION	
------------------------	--

<b>Site Characteristics</b>	
Drainage area	274,902 ft <sup>2</sup>
Impervious area, post-development	122,938 ft <sup>2</sup>
% impervious	44.72 %
Design rainfall depth	1.5 in
<b>Storage Volume: Non-SA Waters</b>	
Minimum volume required	15,547 ft <sup>3</sup> Insufficient required volume.
Volume provided	27,298 ft <sup>3</sup> OK, volume provided is equal to or in excess of volume required.
<b>Storage Volume: SA Waters</b>	
1.5" runoff volume	ft <sup>3</sup>
Pre-development 1-yr, 24-hr runoff	ft <sup>3</sup>
Post-development 1-yr, 24-hr runoff	ft <sup>3</sup>
Minimum volume required	ft <sup>3</sup>
Volume provided	ft <sup>3</sup>
<b>Peak Flow Calculations</b>	
Is the pre/post control of the 1yr 24hr storm peak flow required?	N (Y or N)
1-yr, 24-hr rainfall depth	in
Rational C, pre-development	(unitless)
Rational C, post-development	(unitless)
Rainfall intensity: 1-yr, 24-hr storm	in/hr
Pre-development 1-yr, 24-hr peak flow	ft <sup>3</sup> /sec
Post-development 1-yr, 24-hr peak flow	ft <sup>3</sup> /sec
Pre/Post 1-yr, 24-hr peak flow control	ft <sup>3</sup> /sec
<b>Elevations</b>	
Temporary pool elevation	6.75 fmsl
Permanent pool elevation	5.00 fmsl
SHWT elevation (approx. at the perm. pool elevation)	5.00 fmsl
Top of 10ft vegetated shelf elevation	5.00 fmsl
Bottom of 10ft vegetated shelf elevation	4.00 fmsl
Sediment cleanout, top elevation (bottom of pond)	-1.00 fmsl
Sediment cleanout, bottom elevation	-2.00 fmsl
Sediment storage provided	1.00 ft
Is there additional volume stored above the state-required temp. pool?	Y (Y or N)
Elevation of the top of the additional volume	6.8 fmsl OK

**II. DESIGN INFORMATION**
**Surface Areas**

Area, temporary pool	16,974	ft <sup>2</sup>	
Area REQUIRED, permanent pool	12,286	ft <sup>2</sup>	
SA/DA ratio	4.47	(unitless)	
Area PROVIDED, permanent pool, $A_{perm\_pool}$	14,245	ft <sup>2</sup>	OK
Area, bottom of 10ft vegetated shelf, $A_{bot\_shelf}$	10,616	ft <sup>2</sup>	
Area, sediment cleanout, top elevation (bottom of pond), $A_{bot\_pond}$	3,459	ft <sup>2</sup>	

**Volumes**

Volume, temporary pool	27,298	ft <sup>3</sup>	OK
Volume, permanent pool, $V_{perm\_pool}$	46,090	ft <sup>3</sup>	
Volume, forebay (sum of forebays if more than one forebay)	8,401	ft <sup>3</sup>	
Forebay % of permanent pool volume	18.2%	%	OK

**SA/DA Table Data**

Design TSS removal	90	%	
Coastal SA/DA Table Used?	Y	(Y or N)	
Mountain/Piedmont SA/DA Table Used?	N	(Y or N)	
SA/DA ratio	4.47	(unitless)	

Average depth (used in SA/DA table):

Calculation option 1 used? (See Figure 10-2b)	N	(Y or N)	
Volume, permanent pool, $V_{perm\_pool}$	46,090	ft <sup>3</sup>	
Area provided, permanent pool, $A_{perm\_pool}$	14,245	ft <sup>2</sup>	
Average depth calculated		ft	Need 3 ft min.
Average depth used in SA/DA, $d_{av}$ , (Round to nearest 0.5ft)		ft	
Calculation option 2 used? (See Figure 10-2b)	Y	(Y or N)	
Area provided, permanent pool, $A_{perm\_pool}$	14,245	ft <sup>2</sup>	
Area, bottom of 10ft vegetated shelf, $A_{bot\_shelf}$	10,616	ft <sup>2</sup>	
Area, sediment cleanout, top elevation (bottom of pond), $A_{bot\_pond}$	3,459	ft <sup>2</sup>	
"Depth" (distance b/w bottom of 10ft shelf and top of sediment)	5.00	ft	
Average depth calculated	3.70	ft	OK
Average depth used in SA/DA, $d_{av}$ , (Round to nearest 0.5ft)	3.5	ft	OK

**Drawdown Calculations**

Drawdown through orifice?	Y	(Y or N)	
Diameter of orifice (if circular)	2.00	in	
Area of orifice (if non-circular)		in <sup>2</sup>	
Coefficient of discharge ( $C_D$ )	0.60	(unitless)	
Driving head ( $H_0$ )	1.75	ft	
Drawdown through weir?	N	(Y or N)	
Weir type		(unitless)	
Coefficient of discharge ( $C_w$ )		(unitless)	
Length of weir (L)		ft	
Driving head (H)		ft	
Pre-development 1-yr, 24-hr peak flow		ft <sup>3</sup> /sec	
Post-development 1-yr, 24-hr peak flow		ft <sup>3</sup> /sec	
Storage volume discharge rate (through discharge orifice or weir)	0.08	ft <sup>3</sup> /sec	Storage volume discharge rate greater than pre-dev. 1yr24hr.
Storage volume drawdown time	3.94	days	OK, draws down in 2-5 days.

**Additional Information**

Vegetated side slopes	3	:1	OK
Vegetated shelf slope	6	:1	Insufficient shelf slope.
Vegetated shelf width	6.0	ft	Insufficient shelf length.
Length of flowpath to width ratio	4	:1	OK
Length to width ratio	4.0	:1	OK
Trash rack for overflow & orifice?	Y	(Y or N)	OK
Freeboard provided	1.0	ft	OK
Vegetated filter provided?	N	(Y or N)	OK
Recorded drainage easement provided?	Y	(Y or N)	OK
Capures all runoff at ultimate build-out?	Y	(Y or N)	OK
Drain mechanism for maintenance or emergencies is:	pump		



STORMWATER MANAGEMENT PERMIT APPLICATION FORM  
401 CERTIFICATION APPLICATION FORM  
**WET DETENTION BASIN SUPPLEMENT**

This form must be filled out, printed and submitted.  
The Required Items Checklist (Part III) must be printed, filled out and submitted along with all of the required information.

I. PROJECT INFORMATION	
Project name	Woodlands @ Echo Farms Tract 2
Contact person	Joseph S. Taylor
Phone number	732-521-2900
Date	2/19/2018
Drainage area number	3

II. DESIGN INFORMATION	
------------------------	--

<b>Site Characteristics</b>	
Drainage area	154,638 ft <sup>2</sup>
Impervious area, post-development	66,200 ft <sup>2</sup>
% impervious	42.81 %
Design rainfall depth	1.5 in
<b>Storage Volume: Non-SA Waters</b>	
Minimum volume required	8,414 ft <sup>3</sup> OK
Volume provided	15,714 ft <sup>3</sup> OK, volume provided is equal to or in excess of volume required.
<b>Storage Volume: SA Waters</b>	
1.5" runoff volume	ft <sup>3</sup>
Pre-development 1-yr, 24-hr runoff	ft <sup>3</sup>
Post-development 1-yr, 24-hr runoff	ft <sup>3</sup>
Minimum volume required	ft <sup>3</sup>
Volume provided	ft <sup>3</sup>
<b>Peak Flow Calculations</b>	
Is the pre/post control of the 1yr 24hr storm peak flow required?	N (Y or N)
1-yr, 24-hr rainfall depth	in
Rational C, pre-development	(unitless)
Rational C, post-development	(unitless)
Rainfall intensity: 1-yr, 24-hr storm	in/hr
Pre-development 1-yr, 24-hr peak flow	ft <sup>3</sup> /sec
Post-development 1-yr, 24-hr peak flow	ft <sup>3</sup> /sec
Pre/Post 1-yr, 24-hr peak flow control	ft <sup>3</sup> /sec
<b>Elevations</b>	
Temporary pool elevation	6.75 fmsl
Permanent pool elevation	5.00 fmsl
SHWT elevation (approx. at the perm. pool elevation)	5.00 fmsl
Top of 10ft vegetated shelf elevation	5.00 fmsl
Bottom of 10ft vegetated shelf elevation	4.00 fmsl
Sediment cleanout, top elevation (bottom of pond)	-1.00 fmsl
Sediment cleanout, bottom elevation	-2.00 fmsl
Sediment storage provided	1.00 ft
Is there additional volume stored above the state-required temp. pool?	Y (Y or N)
Elevation of the top of the additional volume	6.8 fmsl OK

**II. DESIGN INFORMATION**
**Surface Areas**

Area, temporary pool	10,303	ft <sup>2</sup>	
Area REQUIRED, permanent pool	7,435	ft <sup>2</sup>	
SA/DA ratio	4.81	(unitless)	
Area PROVIDED, permanent pool, $A_{perm\_pool}$	7,633	ft <sup>2</sup>	OK
Area, bottom of 10ft vegetated shelf, $A_{bot\_shelf}$	5,207	ft <sup>2</sup>	
Area, sediment cleanout, top elevation (bottom of pond), $A_{bot\_pond}$	801	ft <sup>2</sup>	

**Volumes**

Volume, temporary pool	15,714	ft <sup>3</sup>	OK
Volume, permanent pool, $V_{perm\_pool}$	19,008	ft <sup>3</sup>	
Volume, forebay (sum of forebays if more than one forebay)	4,155	ft <sup>3</sup>	
Forebay % of permanent pool volume	21.9%	%	OK

**SA/DA Table Data**

Design TSS removal	90	%	
Coastal SA/DA Table Used?	Y	(Y or N)	
Mountain/Piedmont SA/DA Table Used?	N	(Y or N)	
SA/DA ratio	4.81	(unitless)	

Average depth (used in SA/DA table):

Calculation option 1 used? (See Figure 10-2b)	N	(Y or N)	
Volume, permanent pool, $V_{perm\_pool}$	19,008	ft <sup>3</sup>	
Area provided, permanent pool, $A_{perm\_pool}$	7,633	ft <sup>2</sup>	
Average depth calculated		ft	Need 3 ft min.
Average depth used in SA/DA, $d_{av}$ , (Round to nearest 0.5ft)		ft	

Calculation option 2 used? (See Figure 10-2b)

Area provided, permanent pool, $A_{perm\_pool}$	7,633	ft <sup>2</sup>	
Area, bottom of 10ft vegetated shelf, $A_{bot\_shelf}$	5,207	ft <sup>2</sup>	
Area, sediment cleanout, top elevation (bottom of pond), $A_{bot\_pond}$	801	ft <sup>2</sup>	

"Depth" (distance b/w bottom of 10ft shelf and top of sediment)

"Depth" (distance b/w bottom of 10ft shelf and top of sediment)	5.00	ft	
Average depth calculated	3.30	ft	OK
Average depth used in SA/DA, $d_{av}$ , (Round to nearest 0.5ft)	3.0	ft	Insufficient. Check calculation.

**Drawdown Calculations**

Drawdown through orifice?	Y	(Y or N)	
Diameter of orifice (if circular)	1.75	in	
Area of orifice (if non-circular)		in <sup>2</sup>	
Coefficient of discharge ( $C_D$ )	0.60	(unitless)	
Driving head ( $H_0$ )	1.75	ft	
Drawdown through weir?	N	(Y or N)	
Weir type		(unitless)	
Coefficient of discharge ( $C_w$ )		(unitless)	
Length of weir (L)		ft	
Driving head (H)		ft	
Pre-development 1-yr, 24-hr peak flow		ft <sup>3</sup> /sec	
Post-development 1-yr, 24-hr peak flow		ft <sup>3</sup> /sec	
Storage volume discharge rate (through discharge orifice or weir)	0.06	ft <sup>3</sup> /sec	Storage volume discharge rate greater than pre-dev. 1yr24hr.
Storage volume drawdown time	2.96	days	OK, draws down in 2-5 days.

**Additional Information**

Vegetated side slopes	3	:1	OK
Vegetated shelf slope	6	:1	Insufficient shelf slope.
Vegetated shelf width	6.0	ft	Insufficient shelf length.
Length of flowpath to width ratio	4	:1	OK
Length to width ratio	4.0	:1	OK
Trash rack for overflow & orifice?	Y	(Y or N)	OK
Freeboard provided	1.0	ft	OK
Vegetated filter provided?	N	(Y or N)	OK
Recorded drainage easement provided?	Y	(Y or N)	OK
Capures all runoff at ultimate build-out?	Y	(Y or N)	OK
Drain mechanism for maintenance or emergencies is:	pump		

## Wet Detention Basin Operation and Maintenance Agreement

I will keep a maintenance record on this BMP. This maintenance record will be kept in a log in a known set location. Any deficient BMP elements noted in the inspection will be corrected, repaired or replaced immediately. These deficiencies can affect the integrity of structures, safety of the public, and the removal efficiency of the BMP.

The wet detention basin system is defined as the wet detention basin, pretreatment including forebays and the vegetated filter if one is provided.

**This system (check one):**

does  does not incorporate a vegetated filter at the outlet.

**This system (check one):**

does  does not incorporate pretreatment other than a forebay.

Important maintenance procedures:

- Immediately after the wet detention basin is established, the plants on the vegetated shelf and perimeter of the basin should be watered twice weekly if needed, until the plants become established (commonly six weeks).
- No portion of the wet detention pond should be fertilized after the first initial fertilization that is required to establish the plants on the vegetated shelf.
- Stable groundcover should be maintained in the drainage area to reduce the sediment load to the wet detention basin.
- If the basin must be drained for an emergency or to perform maintenance, the flushing of sediment through the emergency drain should be minimized to the maximum extent practical.
- Once a year, a dam safety expert should inspect the embankment.

After the wet detention pond is established, it should be inspected **once a month and within 24 hours after every storm event greater than 1.5 inches**. Records of operation and maintenance should be kept in a known set location and must be available upon request. Inspection activities shall be performed as follows. Any problems that are found shall be repaired immediately.

BMP element:	Potential problem:	How I will remediate the problem:
The entire BMP	Trash/debris is present.	Remove the trash/debris.
The side slopes of the wet detention basin	Areas of bare soil and/or erosive gullies have formed.	Regrade the soil if necessary to remove the gully, and then plant a ground cover and water until it is established. Provide lime and a one-time fertilizer application.
	Vegetation is too short or too long.	Maintain vegetation at a height of approximately six inches.

Permit Number: \_\_\_\_\_  
 (to be provided by City of Wilmington)  
 BMP Drainage Basin #: \_\_\_\_\_

<b>BMP element:</b>	<b>Potential problem:</b>	<b>How I will remediate the problem:</b>
<b>The inlet device: pipe or swale</b>	The pipe is clogged.	Unclog the pipe. Dispose of the sediment off-site.
	The pipe is cracked or otherwise damaged.	Replace the pipe.
	Erosion is occurring in the swale.	Regrade the swale if necessary to smooth it over and provide erosion control devices such as reinforced turf matting or riprap to avoid future problems with erosion.
<b>The forebay</b>	Sediment has accumulated to a depth greater than the original design depth for sediment storage.	Search for the source of the sediment and remedy the problem if possible. Remove the sediment and dispose of it in a location where it will not cause impacts to streams or the BMP.
	Erosion has occurred.	Provide additional erosion protection such as reinforced turf matting or riprap if needed to prevent future erosion problems.
	Weeds are present.	Remove the weeds, preferably by hand. If pesticide is used, wipe it on the plants rather than spraying.
<b>The vegetated shelf</b>	Best professional practices show that pruning is needed to maintain optimal plant health.	Prune according to best professional practices
	The plant community and coverage is significantly (>25%) different from approved landscape plan.	Restore plant vegetation to approved condition. If landscape plan needs to be adjusted to specify vegetation more appropriate for site conditions, contact City Stormwater or Engineering Staff.
	Cattails or other invasive plants cover >25% of the veg't shelf. A monoculture of plants must be avoided)	Remove all invasives by physical removal or by wiping them with pesticide (do not spray) – consult a professional.
	Plants are dead, diseased or dying.	Determine the source of the problem: soils, hydrology, disease, etc. Remedy the problem and replace plants. Provide a one-time fertilizer application to establish the ground cover if a soil test indicates it is necessary.
<b>The main treatment area</b>	Sediment has accumulated to a depth greater than the original design sediment storage depth.	Search for the source of the sediment and remedy the problem if possible. Remove the sediment and dispose of it in a location where it will not cause impacts to streams or the BMP.

Permit Number: \_\_\_\_\_  
 (to be provided by City of Wilmington)  
 BMP Drainage Basin #: \_\_\_\_\_

BMP element:	Potential problem:	How I will remediate the problem:
<b>The main treatment area (continued)</b>	Algal growth covers over 25% of the area.	Consult a professional to remove and control the algal growth.
	Cattails or other invasive plants cover >25% of the veg't shelf. A monoculture of plants must be avoided)	Remove all invasives by physical removal or by wiping them with pesticide (do not spray) – consult a professional.
<b>The embankment</b>	Shrubs have started to grow on the embankment.	Remove shrubs immediately.
	Evidence of muskrat or beaver activity is present.	Use traps to remove muskrats and consult a professional to remove beavers.
	A tree has started to grow on the embankment.	Consult a dam safety specialist to remove the tree.
	An annual inspection by an appropriate professional shows that the embankment needs repair. (if applicable)	Make all needed repairs.
<b>The outlet device</b>	Clogging has occurred.	Clean out the outlet device. Dispose of the sediment off-site.
	The outlet device is damaged	Repair or replace the outlet device.
<b>The receiving water</b>	Erosion or other signs of damage have occurred at the outlet.	Contact the local NC Division of Water Quality Regional Office, or the 401 Oversight Unit at 919-733-1786.


The measuring device used to determine the sediment elevation shall be such that it will give an accurate depth reading and not readily penetrate into accumulated sediments.

When the permanent pool depth reads 6.0 feet in the main pond, the sediment shall be removed.

When the permanent pool depth reads 6(#1), 4(#2) feet in the forebay, the sediment shall be removed.

**BASIN DIAGRAM**

(fill in the blanks)

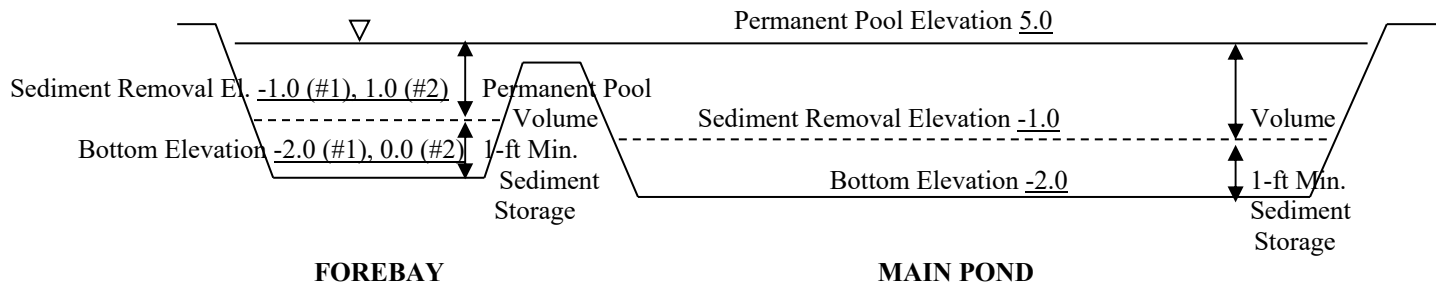

Permit Number: \_\_\_\_\_  
(to be provided by City of Wilmington)

I acknowledge and agree by my signature below that I am responsible for the performance of the maintenance procedures listed above. I agree to notify the City of Wilmington of any problems with the system or prior to any changes to the system or responsible party.

Project name: The Woodlands at Echo Farms Tract 2

BMP drainage basin number: 1

Print name: Joseph S. Taylor

Title: Manager

Address: CN 4000, Forsgate Drive, Cranbury, NJ 08512

Phone: 732-521-2900

Signature: [Handwritten Signature]

Date: 12-28-17

Note: The legally responsible party should not be a homeowners association unless more than 50% of the lots have been sold and a resident of the subdivision has been named the president.

I, MAUREEN ANN PETRIGNANI, a Notary Public for the State of NEW JERSEY, County of MONMOUTH, do hereby certify that JOSEPH S. TAYLOR personally appeared before me this 28<sup>TH</sup> day of DECEMBER, 2017, and acknowledge the due execution of the forgoing wet detention basin maintenance requirements. Witness my hand and official seal, [Handwritten Signature]



SEAL

MAUREEN ANN PETRIGNANI  
Notary Public of New Jersey  
ID # 2045907  
My Commission Expires June 8, 2018

My commission expires \_\_\_\_\_

## Wet Detention Basin Operation and Maintenance Agreement

I will keep a maintenance record on this BMP. This maintenance record will be kept in a log in a known set location. Any deficient BMP elements noted in the inspection will be corrected, repaired or replaced immediately. These deficiencies can affect the integrity of structures, safety of the public, and the removal efficiency of the BMP.

The wet detention basin system is defined as the wet detention basin, pretreatment including forebays and the vegetated filter if one is provided.

**This system (check one):**

does  does not incorporate a vegetated filter at the outlet.

**This system (check one):**

does  does not incorporate pretreatment other than a forebay.

Important maintenance procedures:

- Immediately after the wet detention basin is established, the plants on the vegetated shelf and perimeter of the basin should be watered twice weekly if needed, until the plants become established (commonly six weeks).
- No portion of the wet detention pond should be fertilized after the first initial fertilization that is required to establish the plants on the vegetated shelf.
- Stable groundcover should be maintained in the drainage area to reduce the sediment load to the wet detention basin.
- If the basin must be drained for an emergency or to perform maintenance, the flushing of sediment through the emergency drain should be minimized to the maximum extent practical.
- Once a year, a dam safety expert should inspect the embankment.

After the wet detention pond is established, it should be inspected **once a month and within 24 hours after every storm event greater than 1.5 inches**. Records of operation and maintenance should be kept in a known set location and must be available upon request. Inspection activities shall be performed as follows. Any problems that are found shall be repaired immediately.

BMP element:	Potential problem:	How I will remediate the problem:
The entire BMP	Trash/debris is present.	Remove the trash/debris.
The side slopes of the wet detention basin	Areas of bare soil and/or erosive gullies have formed.	Regrade the soil if necessary to remove the gully, and then plant a ground cover and water until it is established. Provide lime and a one-time fertilizer application.
	Vegetation is too short or too long.	Maintain vegetation at a height of approximately six inches.

Permit Number: \_\_\_\_\_  
 (to be provided by City of Wilmington)  
 BMP Drainage Basin #: \_\_\_\_\_

BMP element:	Potential problem:	How I will remediate the problem:
The inlet device: pipe or swale	The pipe is clogged.	Unclog the pipe. Dispose of the sediment off-site.
	The pipe is cracked or otherwise damaged.	Replace the pipe.
	Erosion is occurring in the swale.	Regrade the swale if necessary to smooth it over and provide erosion control devices such as reinforced turf matting or riprap to avoid future problems with erosion.
The forebay	Sediment has accumulated to a depth greater than the original design depth for sediment storage.	Search for the source of the sediment and remedy the problem if possible. Remove the sediment and dispose of it in a location where it will not cause impacts to streams or the BMP.
	Erosion has occurred.	Provide additional erosion protection such as reinforced turf matting or riprap if needed to prevent future erosion problems.
	Weeds are present.	Remove the weeds, preferably by hand. If pesticide is used, wipe it on the plants rather than spraying.
The vegetated shelf	Best professional practices show that pruning is needed to maintain optimal plant health.	Prune according to best professional practices
	The plant community and coverage is significantly (>25%) different from approved landscape plan.	Restore plant vegetation to approved condition. If landscape plan needs to be adjusted to specify vegetation more appropriate for site conditions, contact City Stormwater or Engineering Staff.
	Cattails or other invasive plants cover >25% of the veg't shelf. A monoculture of plants must be avoided)	Remove all invasives by physical removal or by wiping them with pesticide (do not spray) - consult a professional.
	Plants are dead, diseased or dying.	Determine the source of the problem: soils, hydrology, disease, etc. Remedy the problem and replace plants. Provide a one-time fertilizer application to establish the ground cover if a soil test indicates it is necessary.
The main treatment area	Sediment has accumulated to a depth greater than the original design sediment storage depth.	Search for the source of the sediment and remedy the problem if possible. Remove the sediment and dispose of it in a location where it will not cause impacts to streams or the BMP.



Permit Number: \_\_\_\_\_  
 (to be provided by City of Wilmington)  
 BMP Drainage Basin #: \_\_\_\_\_

BMP element:	Potential problem:	How I will remediate the problem:
The main treatment area (continued)	Algal growth covers over 25% of the area.	Consult a professional to remove and control the algal growth.
	Cattails or other invasive plants cover >25% of the veg't shelf. A monoculture of plants must be avoided)	Remove all invasives by physical removal or by wiping them with pesticide (do not spray) - consult a professional.
The embankment	Shrubs have started to grow on the embankment.	Remove shrubs immediately.
	Evidence of muskrat or beaver activity is present.	Use traps to remove muskrats and consult a professional to remove beavers.
	A tree has started to grow on the embankment.	Consult a dam safety specialist to remove the tree.
	An annual inspection by an appropriate professional shows that the embankment needs repair. (if applicable)	Make all needed repairs.
The outlet device	Clogging has occurred.	Clean out the outlet device. Dispose of the sediment off-site.
	The outlet device is damaged	Repair or replace the outlet device.
The receiving water	Erosion or other signs of damage have occurred at the outlet.	Contact the local NC Division of Water Quality Regional Office, or the 401 Oversight Unit at 919-733-1786.


The measuring device used to determine the sediment elevation shall be such that it will give an accurate depth reading and not readily penetrate into accumulated sediments.

When the permanent pool depth reads 6.0 feet in the main pond, the sediment shall be removed.

When the permanent pool depth reads 6.0 feet in the forebay, the sediment shall be removed.

### BASIN DIAGRAM

(fill in the blanks)

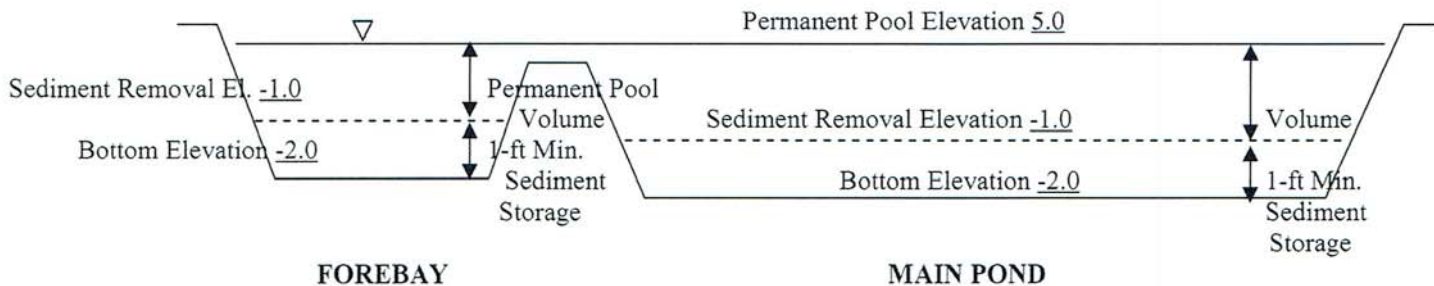

Permit Number: \_\_\_\_\_  
(to be provided by City of Wilmington)

I acknowledge and agree by my signature below that I am responsible for the performance of the maintenance procedures listed above. I agree to notify the City of Wilmington of any problems with the system or prior to any changes to the system or responsible party.

Project name: The Woodlands at Echo Farms Tract 2

BMP drainage basin number: 2

Print name: Joseph S. Taylor

Title: Manager

Address: CN 4000, Forsgate Drive, Cranbury, NJ 08512


Phone: 732-521-2900

Signature: [Handwritten Signature]

Date: 12-28-17

Note: The legally responsible party should not be a homeowners association unless more than 50% of the lots have been sold and a resident of the subdivision has been named the president.

I, MAUREEN ANN PETRIGNANI, a Notary Public for the State of NEW JERSEY, County of MONMOUTH, do hereby certify that JOSEPH S. TAYLOR personally appeared before me this 28TH day of DECEMBER, 2017, and acknowledge the due execution of the forgoing wet detention basin maintenance requirements. Witness my hand and official seal, Maureen Ann Petrucci

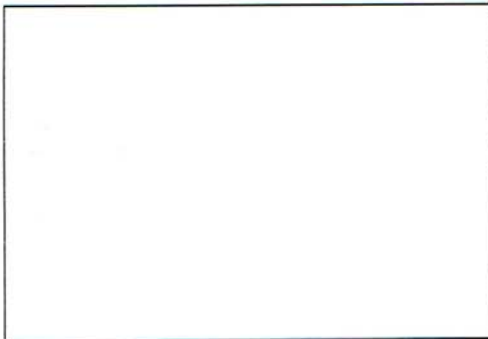

SEAL

MAUREEN ANN PETRIGNANI  
Notary Public of New Jersey  
ID # 2045907  
My Commission Expires June 8, 2018

My commission expires \_\_\_\_\_

## Wet Detention Basin Operation and Maintenance Agreement

I will keep a maintenance record on this BMP. This maintenance record will be kept in a log in a known set location. Any deficient BMP elements noted in the inspection will be corrected, repaired or replaced immediately. These deficiencies can affect the integrity of structures, safety of the public, and the removal efficiency of the BMP.

The wet detention basin system is defined as the wet detention basin, pretreatment including forebays and the vegetated filter if one is provided.

**This system (check one):**

does  does not **incorporate a vegetated filter at the outlet.**

**This system (check one):**

does  does not **incorporate pretreatment other than a forebay.**

Important maintenance procedures:

- Immediately after the wet detention basin is established, the plants on the vegetated shelf and perimeter of the basin should be watered twice weekly if needed, until the plants become established (commonly six weeks).
- No portion of the wet detention pond should be fertilized after the first initial fertilization that is required to establish the plants on the vegetated shelf.
- Stable groundcover should be maintained in the drainage area to reduce the sediment load to the wet detention basin.
- If the basin must be drained for an emergency or to perform maintenance, the flushing of sediment through the emergency drain should be minimized to the maximum extent practical.
- Once a year, a dam safety expert should inspect the embankment.

After the wet detention pond is established, it should be inspected **once a month and within 24 hours after every storm event greater than 1.5 inches**. Records of operation and maintenance should be kept in a known set location and must be available upon request. Inspection activities shall be performed as follows. Any problems that are found shall be repaired immediately.

BMP element:	Potential problem:	How I will remediate the problem:
The entire BMP	Trash/debris is present.	Remove the trash/debris.
The side slopes of the wet detention basin	Areas of bare soil and/or erosive gullies have formed.	Regrade the soil if necessary to remove the gully, and then plant a ground cover and water until it is established. Provide lime and a one-time fertilizer application.
	Vegetation is too short or too long.	Maintain vegetation at a height of approximately six inches.

Permit Number: \_\_\_\_\_  
 (to be provided by City of Wilmington)  
 BMP Drainage Basin #: \_\_\_\_\_

<b>BMP element:</b>	<b>Potential problem:</b>	<b>How I will remediate the problem:</b>
<b>The inlet device: pipe or swale</b>	The pipe is clogged.	Unclog the pipe. Dispose of the sediment off-site.
	The pipe is cracked or otherwise damaged.	Replace the pipe.
	Erosion is occurring in the swale.	Regrade the swale if necessary to smooth it over and provide erosion control devices such as reinforced turf matting or riprap to avoid future problems with erosion.
<b>The forebay</b>	Sediment has accumulated to a depth greater than the original design depth for sediment storage.	Search for the source of the sediment and remedy the problem if possible. Remove the sediment and dispose of it in a location where it will not cause impacts to streams or the BMP.
	Erosion has occurred.	Provide additional erosion protection such as reinforced turf matting or riprap if needed to prevent future erosion problems.
	Weeds are present.	Remove the weeds, preferably by hand. If pesticide is used, wipe it on the plants rather than spraying.
<b>The vegetated shelf</b>	Best professional practices show that pruning is needed to maintain optimal plant health.	Prune according to best professional practices
	The plant community and coverage is significantly (>25%) different from approved landscape plan.	Restore plant vegetation to approved condition. If landscape plan needs to be adjusted to specify vegetation more appropriate for site conditions, contact City Stormwater or Engineering Staff.
	Cattails or other invasive plants cover >25% of the veg't shelf. A monoculture of plants must be avoided)	Remove all invasives by physical removal or by wiping them with pesticide (do not spray) – consult a professional.
	Plants are dead, diseased or dying.	Determine the source of the problem: soils, hydrology, disease, etc. Remedy the problem and replace plants. Provide a one-time fertilizer application to establish the ground cover if a soil test indicates it is necessary.
<b>The main treatment area</b>	Sediment has accumulated to a depth greater than the original design sediment storage depth.	Search for the source of the sediment and remedy the problem if possible. Remove the sediment and dispose of it in a location where it will not cause impacts to streams or the BMP.

Permit Number: \_\_\_\_\_  
 (to be provided by City of Wilmington)  
 BMP Drainage Basin #: \_\_\_\_\_

BMP element:	Potential problem:	How I will remediate the problem:
<b>The main treatment area (continued)</b>	Algal growth covers over 25% of the area.	Consult a professional to remove and control the algal growth.
	Cattails or other invasive plants cover >25% of the veg't shelf. A monoculture of plants must be avoided)	Remove all invasives by physical removal or by wiping them with pesticide (do not spray) – consult a professional.
<b>The embankment</b>	Shrubs have started to grow on the embankment.	Remove shrubs immediately.
	Evidence of muskrat or beaver activity is present.	Use traps to remove muskrats and consult a professional to remove beavers.
	A tree has started to grow on the embankment.	Consult a dam safety specialist to remove the tree.
	An annual inspection by an appropriate professional shows that the embankment needs repair. (if applicable)	Make all needed repairs.
<b>The outlet device</b>	Clogging has occurred.	Clean out the outlet device. Dispose of the sediment off-site.
	The outlet device is damaged	Repair or replace the outlet device.
<b>The receiving water</b>	Erosion or other signs of damage have occurred at the outlet.	Contact the local NC Division of Water Quality Regional Office, or the 401 Oversight Unit at 919-733-1786.


The measuring device used to determine the sediment elevation shall be such that it will give an accurate depth reading and not readily penetrate into accumulated sediments.

When the permanent pool depth reads 6.0 feet in the main pond, the sediment shall be removed.

When the permanent pool depth reads 4.0 feet in the forebay, the sediment shall be removed.

**BASIN DIAGRAM**

(fill in the blanks)

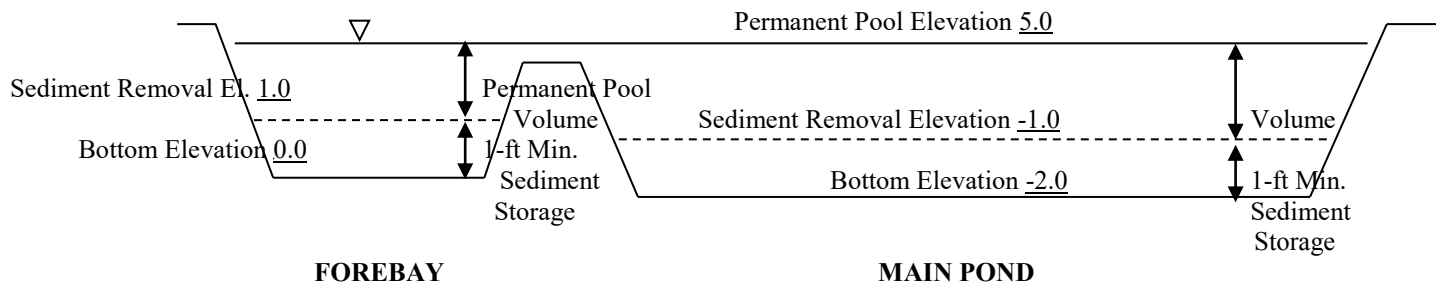

Permit Number: \_\_\_\_\_  
(to be provided by City of Wilmington)

I acknowledge and agree by my signature below that I am responsible for the performance of the maintenance procedures listed above. I agree to notify the City of Wilmington of any problems with the system or prior to any changes to the system or responsible party.

Project name: The Woodlands at Echo Farms Tract 2

BMP drainage basin number: 43

Print name: Joseph S. Taylor

Title: Manager

Address: CN 4000, Forsgate Drive, Cranbury, NJ 08512

Phone: 732-521-2900

Signature: [Handwritten Signature]

Date: 12-28-17

Note: The legally responsible party should not be a homeowners association unless more than 50% of the lots have been sold and a resident of the subdivision has been named the president.

I, Maureen Ann Petrigani, a Notary Public for the State of NEW JERSEY, County of MONMOUTH, do hereby certify that JOSEPH S. TAYLOR personally appeared before me this 28<sup>TH</sup> day of DECEMBER, 2017, and acknowledge the due execution of the forgoing wet detention basin maintenance requirements. Witness my hand and official seal, Maureen Ann Petrigani



SEAL

MAUREEN ANN PETRIGNANI  
Notary Public of New Jersey  
ID # 2045907  
My Commission Expires June 8, 2018

My commission expires \_\_\_\_\_